

ASHRAE Standard 140-2020

Results Comparison for Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests

Results for TRNSYS 18.05.0001
(TRNSYS18)
vs.
Informative Annex B8, Section B8.2 Example Results

Prepared By
Thermal Energy System Specialists, LLC
(TESS)

Results Developed
15-Apr-2023

ASHRAE Standard 140-2020
Computer Programs, Program Authors, and Producers of Example Results for
Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests

The programs used to generate the example results are described in Table B11-2. Under the computer program column, the first entry in each cell is the proper program name and version number. The entries in parentheses are the abbreviations for the programs generally used in the tables and charts which follow.

The second column ("Authoring Organization") indicates the national research facility, university, or industry organization with expertise in building science that wrote the simulation software.

The third column ("Implemented By") indicates the national research facility, university, or industry organization with expertise in building science that performed the simulations. The majority of organizations that performed simulations either ran software written by their organization or otherwise ran other building energy simulation software in addition to that written by their organization.

See Standard 140, Annex B11 for further details.

TABLE B11-2
Ground-Coupled Slab-On-Grade Analytical Verification
Participating Organizations and Models

| Analytical Solution, Case GC10a | Authoring Organization | Implemented by |
|--|---|---|
| Delsante, Stokes, and Walsh (1983) | Commonwealth Scientific and Industrial Research Organisation, Australia | NREL/JNA, a,b United States |
| Verified Numerical Model | | |
| FLUENT 6.0.20 | Fluent, Incorporated, United States | PAAET,c Kuwait |
| MATLAB 7.0.4.365 (R14) | The MathWorks, Inc., United States | Dublin Institute of Technology, Ireland |
| TRNSYS 16.1 | University of Wisconsin/TESS,d United States | TESS,d United States |
| Simulation Program | | |
| BASECALC V1.0e | CETC,e Canada | CETC,e Canada |
| EnergyPlus 2.0.0.025 | LBNL/UIUC/DOE-BT,f,g,h United States | GARD Analytics, Inc., United States |
| ESP-r/BASESIMP | CETC/ESRU,e,i Canada/United Kingdom | CETC,e Canada |
| GHT | NREL,a United States | NREL,a United States |
| SUNREL-GC 1.14.01 | NREL,a United States | NREL,a United States |
| VA114 2.20/ISO-13370 | VABI Software BV, The Netherlands; CEN/ISOj,k | VABI Software BV, The Netherlands |

aNREL: National Renewable Energy Laboratory, United States

bJNA: J. Neymark & Associates, United States

cPAAET: Public Authority for Applied Education and Training, Kuwait

dTESS: Thermal Energy Systems Specialists, United States

eCETC: CANMET Energy Technology Centre, Natural Resources Canada, Canada

fLBNL: Lawrence Berkeley National Laboratory, United States

gUIUC: University of Illinois Urbana/Champaign, United States

hDOE-BT: U.S. Department of Energy, Office of Building Technologies, Energy Efficiency and Renewable Energy, United States

iESRU: Energy Systems Research Unit, University of Strathclyde, United Kingdom

jCEN: European Committee for Standardization, Belgium

kISO: International Organization for Standardization, Switzerland

**ASHRAE Standard 140-2010 Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests
 TRNSYS 18.05.0001 (TRNSYS18) vs. Annex B8, Section B8.2 Example Results
 By Thermal Energy System Specialists, LLC (TESS), 15-Apr-2023**

List of Tables

| <i>Table</i> | <i>Description</i> | <i>Sheet Tab</i> | <i>Cell Range</i> |
|--------------|--|------------------|-------------------|
| B8.2-1 | "a"-Series Case Summary, Numerical Model Verification | Tables 1 | B7-L24 |
| B8.2-2 | Steady-State Conduction | Tables 2 | B7-Q26 |
| B8.2-3 | Steady-State Supporting Information | | B29-Q42 |
| B8.2-4 | Steady-Periodic Last-Simulation-Year Conduction | | B46-Q83 |
| B8.2-5 | Steady-Periodic Last-Simulation-Year Peak-Hour Conduction | Tables 3 | B7-AA62 |
| B8.2-6 | Time from Coldest Hour (Jan15, Hour 4) to Peak Conduction Occurrence | Tables 4 | B7-Q33 |
| B8.2-7 | Steady-Periodic Supporting Information | | B35-Q60 |
| B8.2-8 | Steady-Periodic Minimum ODB and Time of Occurrence | Tables 5 | B8-AE38 |
| B8.2-9 | Delta Steady-State Conduction | Tables 6 | B7-Q30 |
| B8.2-10 | Delta Steady-Periodic Annual Total Conduction | | B32-Q56 |
| B8.2-11 | Delta Steady-Periodic Last-Year Peak Hour Floor Conduction | | B58-Q82 |
| B8.2-12 | Delta Steady-Periodic Conduction v Coldest Hour Phase Shift | | B84-Q108 |

ASHRAE Standard 140-2010 Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests
TRNSYS 18.05.0001 (TRNSYS18) vs. Annex B8, Section B8.2 Example Results
By Thermal Energy System Specialists, LLC (TESS), 15-Apr-2023

List of Figures

| Figure | Title | Sheet Tab |
|---------------|---|--------------------------------|
| B8.2-1 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-State Floor Conduction | Fig B8.2-1 QFSS |
| B8.2-2 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-State Floor Conduction Sensitivity | Fig B8.2-2 dQFSS |
| B8.2-3 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-State Zone Heating Load | Fig B8.2-3 QZSS |
| B8.2-4 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-State Zone Heating Load Sensitivity | Fig B8.2-4 dQZSS |
| B8.2-5 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-State (Zone Heating Load) - (Floor Conduction) | Fig B8.2-5 QZ-FSS |
| B8.2-6 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Case GC10a Modeling Parameters | Fig B8.2-6 GC10Par |
| B8.2-7 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-State Zone Temperature | Fig B8.2-7 TZSS |
| B8.2-8 | IEA BESTEST Ground Coupling: In-Depth Floor Slab, GC10a Steady-State Surface Temperatures (Y=0, thru edge center) | Fig B8.2-8 TempGC10a-Surf |
| B8.2-9 | IEA BESTEST Ground Coupling: In-Depth Floor Slab, GC10a Steady-State Surface Temperatures (Y=X, thru corner) | Fig B8.2-9 TempGC10a-Surf-diag |
| B8.2-10 | IEA BESTEST Ground Coupling: In-Depth Floor Slab, GC10a, GC30a Steady-State Near-Surface Temperatures (Y=0, thru center of edge) | Fig B8.2-10 TempGC10a-30a |
| B8.2-11 | IEA BESTEST Ground Coupling: In-Depth Floor Slab, GC10a, GC30a Steady-State Near-Surface Temperatures (Y=X, thru corner) | Fig B8.2-11 TempGC10a-30a-diag |
| B8.2-12 | IEA BESTEST: In-Depth Floor Slab, GC30b, GC60b, GC65b Steady-State Near-Surface Temperatures (Y=0, thru center of edge) | Fig B8.2-12 TempGC30b-65b |
| B8.2-13 | IEA BESTEST: In-Depth Floor Slab, GC30b, GC60b, GC65b Steady-State Near-Surface Temperatures (Y=X, thru corner) | Fig B8.2-13 TempGC30b-65b-diag |
| B8.2-14 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Annual Floor Conduction | Fig B8.2-14 QFSP |
| B8.2-15 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Annual Floor Conduction Sensitivity | Fig B8.2-15 dQFSP |
| B8.2-16 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Annual Zone Heating Load | Fig B8.2-16 QZSP |
| B8.2-17 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Annual Zone Heating Load Sensitivity | Fig B8.2-17 dQZSP |
| B8.2-18 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic (Zone Heating Load) - (Floor Conduction) | Fig B8.2-18 QZ-FSP |
| B8.2-19 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Hourly Floor Conduction, GC40a | Fig B8.2-19 GC40aHourly-1 |
| B8.2-20 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Hourly Floor Conduction, GC40b | Fig B8.2-20 GC40bHourly-2 |
| B8.2-21 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Hourly Floor Conduction, GC40c | Fig B8.2-21 GC40cHourly-1 |
| B8.2-22 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Phase Shift, Time from Coldest ODB to Peak Floor Conduction | Fig B8.2-22 PhF |
| B8.2-23 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Phase Shift Sensitivity, Floor Conduction v. ODB | Fig B8.2-23 dPhF |
| B8.2-24 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Phase Shift, Time from Coldest ODB to Peak Zone Load | Fig B8.2-24 PhZ |

**ASHRAE Standard 140-2010 Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests
 TRNSYS 18.05.0001 (TRNSYS18) vs. Annex B8, Section B8.2 Example Results
 By Thermal Energy System Specialists, LLC (TESS), 15-Apr-2023**

List of Figures

| Figure | Title | Sheet Tab |
|---------------|--|--------------------|
| B8.2-25 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Delta Steady-Periodic Phase Shift Sensitivity, Zone Load v. ODB | Fig B8.2-25 dPhZ |
| B8.2-26 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Annual Peak-Hour Floor Conduction | Fig B8.2-26 PFSP |
| B8.2-27 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Annual Peak-Hour Floor Conduction Sensitivity | Fig B8.2-27 dPFSP |
| B8.2-28 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Annual Peak-Hour Zone Heating Load | Fig B8.2-28 PZSP |
| B8.2-29 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Annual Peak-Hour Zone Heating Load Sensitivity | Fig B8.2-29 dPZSP |
| B8.2-30 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic (Peak Zone Heating Load) - (Peak Floor Conduction) | Fig B8.2-30 PZ-FSP |
| B8.2-31 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Zone Temperature | Fig B8.2-31 TZSP |
| B8.2-32 | IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Minimum ODB | Fig B8.2-32 ODBmin |

**ASHRAE Standard 140-2020 Results Comparison for Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests
 TRNSYS 18.05.0001 (TRNSYS18) vs. Annex B8, Section B8.2 Example Results
 By Thermal Energy System Specialists, LLC (TESS), 15-Apr-2023**

Note: The statistics in the tables below are based on the Standard 140 informative example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8.2-1. "a"-Series Case Summary, Numerical Model Verification

| | Analytical Solution CSIRO | Verified Numerical Models | | | Statistics | | | GHT NREL | GHT/ V.M.Meana -1 | TRNSYS18 TESS |
|--|------------------------------|---------------------------|-----------------|---------------|------------|-------|--------------------|-------------|-------------------------|------------------|
| | | TRNSYS TESS | FLUENT PAAET | MATLAB DIT | Min | Max | (Max-Min) /Mean | | | |
| Floor Conduction | | | | | | | | | | |
| GC10a (W or Wh/h) | 2433 | 2427 | 2425 | 2432 | 2425 | 2432 | 0.3% | 2415 | -0.5% | 2431 |
| GC30a (W or Wh/h) | | 2642 | 2585 | 2695 | 2585 | 2695 | 4.2% | 2457 | -7.0% | 2642 |
| GC40a (kWh) | | 23033 | 22761 | 23609 | 22761 | 23609 | 3.7% | 20812 | -10.0% | 23129 |
| Phase Shift for Floor Conduction Peak (hours) | | | | | | | | | | |
| GC40a | | 416 | 416 | 416 | 416 | 416 | 0.0% | 487 | 17.1% | 416 |
| GC10a Modeling Parameters | | | | | | | | | | |
| E (depth, m) | infinite | 40 | 40 | 300 | 40 | 300 | | 30 | | 40 |
| F (far-field, m) | infinite | 40 | 40 | 150 | 40 | 150 | | 20 | | 40 |
| Time Simulated (Years) | | | | | | | | | | |
| GC10a | s.s. soln. | 8.0 | s.s. model | s.s. model | | | | 6.0 | | 7.0 |
| GC30a | | 7.0 | s.s. model | s.s. model | | | | 6.0 | | 7.0 |
| GC40a | | 6.0 | 5.0 | 10.0 | 5.0 | 10.0 | | 6.0 | | 6.0 |

^a "V.M.Meana" is average of verified numerical-model results.

ASHRAE Standard 140-2020 Results Comparison for Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests
TRNSYS 18.05.0001 (TRNSYS18) vs. Annex B8, Section B8.2 Example Results
By Thermal Energy System Specialists, LLC (TESS), 15-Apr-2023

Note: The statistics in the tables below are based on the Standard 140 informative example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8.2-2. Steady-State Conduction

| | Verified Numerical Models | | | | (Max-Min) /Mean | GHT NREL | SUNREL-GC NREL | EnergyPlus GARD | VA114/ ISO-13370 VABI | ESP-r/ BASESIMP NRCan | BASECALC NRCan | Statistics, Other Simulation Models | | | TRNSYS18 TESS |
|--|---------------------------|-----------------|---------------|--|--------------------|-------------|-------------------|--------------------|-----------------------------|-----------------------------|-------------------|-------------------------------------|------|---------------------------------------|------------------|
| | TRNSYS TESS | FLUENT PAAET | MATLAB DIT | | | | | | | | | Min | Max | (Max-Min)/ (V.M.Mean) ^a | |
| Floor Conduction (W or Wh/h) | | | | | | | | | | | | | | | |
| GC30b | 2533 | 2504 | 2570 | | 2.6% | 2341 | 2341 | 2652 | 2421 | | | 2341 | 2652 | 12.3% | 2533 |
| GC30c | 2137 | 2123 | 2154 | | 1.5% | | | 2308 | 2092 | 1973 | 1973 | 1973 | 2308 | 15.7% | 2137 |
| GC60b | 2113 | 2104 | 2128 | | 1.1% | | 1999 | 2219 | 2069 | | | 1999 | 2219 | 10.4% | 2113 |
| GC65b | 1994 | 1991 | 2004 | | 0.7% | | 1895 | 1616 | 1920 | | | 1616 | 1920 | 15.3% | 1994 |
| Zone Heating Load (W or Wh/h) | | | | | | | | | | | | | | | |
| GC30b | | | | | | | 2341 | 2652 | 2427 | | | 2341 | 2652 | 12.3% | 2533 |
| GC30c | | | | | | | | 2308 | 2098 | 2003 | 2003 | 2003 | 2308 | 14.3% | 2137 |
| GC60b | | | | | | | 1999 | 2219 | 2075 | | | 1999 | 2219 | 10.4% | 2113 |
| GC65b | | | | | | | 1895 | 1616 | 1925 | | | 1616 | 1925 | 15.5% | 1994 |
| (Zone Heating Load) - (Floor Conduction), [W or Wh/h] | | | | | | | | | | | | | | | |
| GC30b | | | | | | | 0 | 0 | 6 | | | 0 | 6 | | 0 |
| GC30c | | | | | | | | 0 | 6 | 30 | 30 | 0 | 30 | | 0 |
| GC60b | | | | | | | 0 | 0 | 6 | | | 0 | 6 | | 0 |
| GC65b | | | | | | | 0 | 0 | 5 | | | 0 | 5 | | 0 |

^a "V.M.Mean" is average of verified numerical-model results; for zone load results the average of the floor conduction results is used.

Table B8.2-3. Steady-State Supporting Information

| | Verified Numerical Models | | | | (Max-Min) /Mean | GHT NREL | SUNREL-GC NREL | EnergyPlus GARD | VA114/ ISO-13370 VABI | ESP-r/ BASESIMP NRCan | BASECALC NRCan | Statistics, All Results | | | TRNSYS18 TESS |
|------------------------------------|---------------------------|-----------------|---------------|--|--------------------|-------------|-------------------|--------------------|-----------------------------|-----------------------------|-------------------|-------------------------|------|--------------------|------------------|
| | TRNSYS TESS | FLUENT PAAET | MATLAB DIT | | | | | | | | | Min | Max | (Max-Min) /Mean | |
| Zone Air Temperature (°C) | | | | | | | | | | | | | | | |
| GC30b | | | | | | | 30.0 | 30.0 | 30.0 | | | 30.0 | 30.0 | 0.0% | 30.0 |
| GC30c | | | | | | | | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 0.0% | 30.0 |
| GC60b | | | | | | | 30.0 | 30.0 | 30.0 | | | 30.0 | 30.0 | 0.0% | 30.0 |
| GC65b | | | | | | | 30.0 | 30.0 | 30.0 | | | 30.0 | 30.0 | 0.0% | 30.0 |
| Simulation Duration (Years) | | | | | | | | | | | | | | | |
| GC30b | 6.0 | s.s. model | s.s. model | | | 5.0 | 5.0 | 7.0 | 1.0 | | | 0.0 | 7.0 | | 6.0 |
| GC30c | 6.0 | s.s. model | s.s. model | | | | | 6.0 | 1.0 | 2.0 | 3.0 | 0.0 | 6.0 | | 6.0 |
| GC60b | 6.0 | s.s. model | s.s. model | | | | 5.0 | 7.0 | 1.0 | | | 0.0 | 7.0 | | 6.0 |
| GC65b | 6.0 | s.s. model | s.s. model | | | | 5.0 | 8.0 | 1.0 | | | 0.0 | 8.0 | | 6.0 |

ASHRAE Standard 140-2020 Results Comparison for Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests
TRNSYS 18.05.0001 (TRNSYS18) vs. Annex B8, Section B8.2 Example Results
By Thermal Energy System Specialists, LLC (TESS), 15-Apr-2023

Note: The statistics in the tables below are based on the Standard 140 informative example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8.2-4. Steady-Periodic Last-Simulation-Year Conduction

| | Verified Numerical Models | | | | GHT NREL | SUNREL-GC NREL | EnergyPlus GARD | VA114/ ISO-13370 VABI | ESP-r/ BASESIMP NRCan | BASECALC NRCan | Statistics, Other Simulation Models | | | TRNSYS18 TESS | |
|---|---------------------------|-----------------|---------------|--------------------|-------------|-------------------|--------------------|-----------------------------|-----------------------------|-------------------|-------------------------------------|--------|---------------------------------------|------------------|--------|
| | TRNSYS TESS | FLUENT PAAET | MATLAB DIT | (Max-Min) /Mean | | | | | | | Min | Max | (Max-Min)/ (V.M.Mean) ^a | | |
| Floor Conduction (kWh) | | | | | | | | | | | | | | | |
| GC40b | 22099 | 21932 | 22513 | 2.6% | 20513 | 20513 | 23204 | 21206 | | | | 20513 | 23204 | 12.1% | 22183 |
| GC45b | 32758 | 32456 | 33483 | 3.1% | | | 33415 | 30856 | | | | 30856 | 33415 | 7.8% | 32524 |
| GC50b | 277923 | 277988 | 281418 | 1.3% | | | 324257 | 289925 | | | | 289925 | 324257 | 12.3% | 278538 |
| GC55b | 35075 | 34879 | 35491 | 1.7% | | 33211 | 39932 | 31601 | | | | 31601 | 39932 | 23.7% | 35123 |
| GC70b | 17396 | 17434 | 17552 | 0.9% | | 16607 | 15553 | 16817 | | | | 15553 | 16817 | 7.2% | 17459 |
| GC80b | 6029 | 5939 | 6151 | 3.5% | | 5661 | 6059 | 5728 | | | | 5661 | 6059 | 6.6% | 6153 |
| GC40c | 18649 | 18598 | 18873 | 1.5% | | | 20255 | 18330 | 17285 | 17285 | | 17285 | 20255 | 15.9% | 18711 |
| GC45c | 27004 | 26906 | 27392 | 1.8% | | | 28707 | 26038 | 23849 | 23849 | | 23849 | 28707 | 17.9% | 27111 |
| GC55c | 20760 | 20714 | 20986 | 1.3% | | | 22570 | 20172 | 20850 | 20850 | | 20172 | 22570 | 11.5% | 20810 |
| GC80c | 9192 | 9137 | 9314 | 1.9% | | | 10073 | 8966 | 8635 | 8635 | | 8635 | 10073 | 15.6% | 9225 |
| Zone Heating Load (kWh) | | | | | | | | | | | | | | | |
| GC40b | n/a | n/a | | | | 20513 | 23204 | 21260 | | | | 20513 | 23204 | 12.1% | 22183 |
| GC45b | n/a | n/a | | | | | 33415 | 30924 | | | | 30924 | 33415 | 7.6% | 32524 |
| GC50b | n/a | n/a | | | | | 324257 | 291502 | | | | 291502 | 324257 | 11.7% | 278538 |
| GC55b | n/a | n/a | | | | 33211 | 39932 | 31654 | | | | 31654 | 39932 | 23.6% | 35123 |
| GC70b | n/a | n/a | | | | 16607 | 15553 | 16865 | | | | 15553 | 16865 | 7.5% | 17459 |
| GC80b | n/a | n/a | | | | 5661 | 6059 | 5778 | | | | 5661 | 6059 | 6.6% | 6153 |
| GC40c | n/a | n/a | | | | | 20255 | 18379 | 17545 | 17545 | | 17545 | 20255 | 14.5% | 18711 |
| GC45c | n/a | n/a | | | | | 28707 | 26101 | 24185 | 24185 | | 24185 | 28707 | 16.7% | 27111 |
| GC55c | n/a | n/a | | | | | 22570 | 20221 | 21111 | 21111 | | 20221 | 22570 | 11.3% | 20810 |
| GC80c | n/a | n/a | | | | | 10073 | 9013 | 8848 | 8848 | | 8848 | 10073 | 13.3% | 9225 |
| (Zone Heating Load) - (Floor Conduction) [kWh] | | | | | | | | | | | | | | | |
| GC40b | | | | | | 0 | 0 | 54 | | | | 0 | 54 | | 0 |
| GC45b | | | | | | | 0 | 68 | | | | 0 | 68 | | 0 |
| GC50b | | | | | | | 0 | 1577 | | | | 0 | 1577 | | 0 |
| GC55b | | | | | | 0 | 0 | 53 | | | | 0 | 53 | | 0 |
| GC70b | | | | | | 0 | 0 | 48 | | | | 0 | 48 | | 0 |
| GC80b | | | | | | 0 | 0 | 50 | | | | 0 | 50 | | 0 |
| GC40c | | | | | | | 0 | 49 | 260 | 260 | | 0 | 260 | | 0 |
| GC45c | | | | | | | 0 | 63 | 336 | 336 | | 0 | 336 | | 0 |
| GC55c | | | | | | | 0 | 49 | 261 | 261 | | 0 | 261 | | 0 |
| GC80c | | | | | | | 0 | 47 | 213 | 213 | | 0 | 213 | | 0 |

^a "V.M.Mean" is average of verified numerical-model results; for zone load results the average of the floor conduction results is used.

**ASHRAE Standard 140-2020 Results Comparison for Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests
 TRNSYS 18.05.0001 (TRNSYS18) vs. Annex B8, Section B8.2 Example Results
 By Thermal Energy System Specialists, LLC (TESS), 15-Apr-2023**

Note: The statistics in the tables below are based on the Standard 140 informative example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8.2-6. Time from Coldest Hour (Jan 15, Hour 4) to Peak Conduction Occurrence

| | Verified Numerical Models | | | | VA114/ ESP-r/ Statistics, Other Simulation Models | | | | | | TRNSYS18 TESS | | | |
|--|---------------------------|-----------------|---------------|--------------------|---|-------------------|--------------------|-------------------|-------------------|-------------------|------------------|------|--------|---------------------------------------|
| | TRNSYS TESS | FLUENT PAAET | MATLAB DIT | (Max-Min) /Mean | GHT NREL | SUNREL-GC NREL | EnergyPlus GARD | ISO-13370 VABI | BASESIMP NRCan | BASECALC NRCan | | Min | Max | (Max-Min)/ (V.M.Mean) ^a |
| Phase Shift for Floor Conduction Peak (hours) | | | | | | | | | | | | | | |
| GC40b | 417 | 465 | 441 | 10.9% | 489 | 489 | | 886 | | | 489 | 886 | 90.0% | 417 |
| GC45b | 417 | 441 | 441 | 5.5% | | | | 880 | | | 880 | 880 | 0.0% | 417 |
| GC50b | 489 | 465 | 465 | 5.1% | | | | 867 | | | 867 | 867 | 0.0% | 489 |
| GC55b | 177 | 153 | 153 | 14.9% | | 178 | | 884 | | | 178 | 884 | 438.5% | 177 |
| GC70b | 660 | 659 | 660 | 0.2% | | 662 | | 958 | | | 662 | 958 | 44.9% | 658 |
| GC80b | 568 | 591 | 567 | 4.2% | | 618 | | 1174 | | | 618 | 1174 | 96.6% | 567 |
| GC40c | 562 | 562 | 538 | 4.3% | | | | 961 | 388 | | 388 | 961 | 103.4% | 560 |
| GC45c | 490 | 538 | 538 | 9.2% | | | | 981 | 386 | | 386 | 981 | 114.0% | 488 |
| GC55c | 490 | 538 | 538 | 9.2% | | | | 978 | 355 | | 355 | 978 | 119.3% | 488 |
| GC80c | 613 | 613 | 589 | 4.0% | | | | 1100 | 433 | | 433 | 1100 | 110.2% | 611 |
| Phase Shift for Zone Load Peak (hours) | | | | | | | | | | | | | | |
| GC40b | | | | | | 489 | | 912 | | | 489 | 912 | 95.9% | 417 |
| GC45b | | | | | | | | 912 | | | 912 | 912 | 0.0% | 417 |
| GC50b | | | | | | | | 887 | | | 887 | 887 | 0.0% | 489 |
| GC55b | | | | | | 178 | | 911 | | | 178 | 911 | 455.3% | 177 |
| GC70b | | | | | | 662 | | 1031 | | | 662 | 1031 | 55.9% | 660 |
| GC80b | | | | | | 618 | | 1248 | | | 618 | 1248 | 109.5% | 567 |
| GC40c | | | | | | | | 1007 | 424 | | 424 | 1007 | 105.2% | 562 |
| GC45c | | | | | | | | 1007 | 384 | | 384 | 1007 | 119.3% | 490 |
| GC55c | | | | | | | | 984 | 312 | | 312 | 984 | 128.7% | 490 |
| GC80c | | | | | | | | 1151 | 384 | | 384 | 1151 | 126.8% | 613 |

^a "V.M.Mean" is average of verified numerical-model results; for zone load results the average of the floor conduction results is used.

**ASHRAE Standard 140-2020 Results Comparison for Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests
 TRNSYS 18.05.0001 (TRNSYS18) vs. Annex B8, Section B8.2 Example Results
 By Thermal Energy System Specialists, LLC (TESS), 15-Apr-2023**

Note: The statistics in the tables below are based on the Standard 140 informative example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8.2-7. Steady-Periodic Supporting Information

| | Verified Numerical Models | | | GHT NREL | SUNREL-GC NREL | EnergyPlus GARD | VA114/ ISO-13370 VABI | ESP-r/ BASESIMP NRCan | BASECALC NRCan | Statistics, All Results | | | TRNSYS18 TESS | |
|--|---------------------------|-----------------|---------------|-------------|-------------------|--------------------|-----------------------------|-----------------------------|-------------------|-------------------------|------|--------------------|------------------|------|
| | TRNSYS TESS | FLUENT PAAET | MATLAB DIT | | | | | | | Min | Max | (Max-Min) /Mean | | |
| | | | | | | | | | | | | | | |
| Mean Annual Zone Air Temperature (°C) | | | | | | | | | | | | | | |
| GC40b | | | | | 30.0 | 30.0 | 30.0 | | | | 30.0 | 30.0 | 0.0% | 30.0 |
| GC45b | | | | | | 30.0 | 30.0 | | | | 30.0 | 30.0 | 0.0% | 30.0 |
| GC50b | | | | | | 30.0 | 30.0 | | | | 30.0 | 30.0 | 0.0% | 30.0 |
| GC55b | | | | | 30.0 | 30.0 | 30.0 | | | | 30.0 | 30.0 | 0.0% | 30.0 |
| GC70b | | | | | 30.0 | 30.0 | 30.0 | | | | 30.0 | 30.0 | 0.0% | 30.0 |
| GC80b | | | | | 30.0 | 30.0 | 30.0 | | | | 30.0 | 30.0 | 0.0% | 30.0 |
| GC40c | | | | | | 30.0 | 30.0 | 30.0 | 30.0 | | 30.0 | 30.0 | 0.0% | 30.0 |
| GC45c | | | | | | 30.0 | 30.0 | 30.0 | 30.0 | | 30.0 | 30.0 | 0.0% | 30.0 |
| GC55c | | | | | | 30.0 | 30.0 | 30.0 | 30.0 | | 30.0 | 30.0 | 0.0% | 30.0 |
| GC80c | | | | | | 30.0 | 30.0 | 30.0 | 30.0 | | 30.0 | 30.0 | 0.0% | 30.0 |
| Simulation Duration (Years) | | | | | | | | | | | | | | |
| GC40b | 5.0 | 6.0 | 10.0 | 5.0 | 5.0 | 7.0 | 1.0 | | | | 1.0 | 10.0 | | 5.0 |
| GC45b | 5.0 | 3.0 | 10.0 | | | 7.0 | 1.0 | | | | 1.0 | 10.0 | | 4.0 |
| GC50b | 8.0 | 8.0 | 10.0 | | | 8.0 | 1.0 | | | | 1.0 | 10.0 | | 8.0 |
| GC55b | 3.0 | 3.0 | 10.0 | | 2.0 | 3.0 | 1.0 | | | | 1.0 | 10.0 | | 2.0 |
| GC70b | 6.0 | 3.0 | 10.0 | | 5.0 | 7.0 | 1.0 | | | | 1.0 | 10.0 | | 5.0 |
| GC80b | 10.0 | 3.0 | 10.0 | | 5.0 | 16.0 | 1.0 | | | | 1.0 | 16.0 | | 5.0 |
| GC40c | 5.0 | 3.0 | 10.0 | | | 6.0 | 1.0 | 2.0 | 3.0 | | 1.0 | 10.0 | | 5.0 |
| GC45c | 5.0 | 3.0 | 10.0 | | | 6.0 | 1.0 | 2.0 | 3.0 | | 1.0 | 10.0 | | 4.0 |
| GC55c | 3.0 | 3.0 | 10.0 | | | 3.0 | 1.0 | 2.0 | 3.0 | | 1.0 | 10.0 | | 2.0 |
| GC80c | 8.0 | 4.0 | 10.0 | | | 10.0 | 1.0 | 2.0 | 3.0 | | 1.0 | 10.0 | | 8.0 |

ASHRAE Standard 140-2020 Results Comparison for Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests
TRNSYS 18.05.0001 (TRNSYS18) vs. Annex B8, Section B8.2 Example Results
By Thermal Energy System Specialists, LLC (TESS), 15-Apr-2023

Note: The statistics in the tables below are based on the Standard 140 informative example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8.2-8. Steady-Periodic Minimum ODB and Time of Occurrence

| | Verified Numerical-Model Results | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|--|----------------------------------|-------|------|--------|-----------|-------|------|--------|------------|-------|-------|--------|-----------------|-------|------|--------|----------------|-------|------|--------|----------|------|------|--------|----------|-------|------|--------|
| | TRNSYS | | | | FLUENT | | | | MATLAB | | | | | | | | | | | | | | | | | | | |
| | TESS | Date | Hour | ODBmin | PAAET | Date | Hour | ODBmin | DIT | Date | Hour | ODBmin | | | | | | | | | | | | | | | | |
| Outdoor Dry-Bulb Temperature (°C) | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| GC40a | 2.1 | 8-Jan | 4.0 | 30.0 | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | | | | | | | | | | | | | | | | |
| GC40b | 2.1 | 8-Jan | 4.0 | 30.0 | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | | | | | | | | | | | | | | | | |
| GC45b | 2.1 | 8-Jan | 4.0 | 30.0 | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | | | | | | | | | | | | | | | | |
| GC50b | 2.1 | 8-Jan | 4.0 | 30.0 | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | | | | | | | | | | | | | | | | |
| GC55b | 2.1 | 8-Jan | 4.0 | 30.0 | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | | | | | | | | | | | | | | | | |
| GC70b | 2.1 | 8-Jan | 4.0 | 30.0 | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | | | | | | | | | | | | | | | | |
| GC80b | 2.1 | 8-Jan | 4.0 | 30.0 | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | | | | | | | | | | | | | | | | |
| GC40c | 2.1 | 8-Jan | 4.0 | 30.0 | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | | | | | | | | | | | | | | | | |
| GC45c | 2.1 | 8-Jan | 4.0 | 30.0 | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | | | | | | | | | | | | | | | | |
| GC55c | 2.1 | 8-Jan | 4.0 | 30.0 | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | | | | | | | | | | | | | | | | |
| GC80c | 2.1 | 8-Jan | 4.0 | 30.0 | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | | | | | | | | | | | | | | | | |
| | Other Simulation Results | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | GHT | | | | SUNREL-GC | | | | EnergyPlus | | | | VA114/ISO-13370 | | | | ESP-r/BASESIMP | | | | BASECALC | | | | TRNSYS18 | | | |
| | NREL | Date | Hour | ODBmin | NREL | Date | Hour | ODBmin | GARD | Date | Hour | ODBmin | VABI | Date | Hour | ODBmin | NRCan | Date | Hour | ODBmin | NRCan | Date | Hour | ODBmin | TESS | Date | Hour | ODBmin |
| Outdoor Dry-Bulb Temperature (°C) | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| GC40a | 2.0 | 8-Jan | 4.0 | 15.0 | | | | | | | | | | | | | | | | | | | | | 2.1 | 8-Jan | 4.0 | 30.0 |
| GC40b | 2.0 | 8-Jan | 4.0 | 15.0 | 2.0 | 8-Jan | 4.0 | 15.0 | 2.0 | 01/08 | 04:00 | 15.0 | 2.0 | 8-Jan | 4.0 | 16.0 | | | | | | | | | 2.1 | 8-Jan | 4.0 | 30.0 |
| GC45b | | | | | | | | | 2.0 | 01/08 | 04:00 | 15.0 | 2.0 | 8-Jan | 4.0 | 16.0 | | | | | | | | | 2.1 | 8-Jan | 4.0 | 30.0 |
| GC50b | | | | | | | | | 2.0 | 01/08 | 04:00 | 15.0 | 2.0 | 8-Jan | 4.0 | 16.0 | | | | | | | | | 2.1 | 8-Jan | 4.0 | 30.0 |
| GC55b | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | 2.0 | 01/08 | 04:00 | 15.0 | 2.0 | 8-Jan | 4.0 | 16.0 | | | | | | | | | 2.1 | 8-Jan | 4.0 | 30.0 |
| GC70b | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | 2.0 | 01/08 | 04:00 | 15.0 | 2.0 | 8-Jan | 4.0 | 16.0 | | | | | | | | | 2.1 | 8-Jan | 4.0 | 30.0 |
| GC80b | | | | | 2.0 | 8-Jan | 4.0 | 15.0 | 2.0 | 01/08 | 04:00 | 15.0 | 2.0 | 8-Jan | 4.0 | 16.0 | | | | | | | | | 2.1 | 8-Jan | 4.0 | 30.0 |
| GC40c | | | | | | | | | 2.0 | 01/08 | 04:00 | 15.0 | 2.0 | 8-Jan | 4.0 | 16.0 | 2.0 | 8-Jan | 4.0 | 15.0 | 4.0 | Jan | 0.0 | 744.0 | 2.1 | 8-Jan | 4.0 | 30.0 |
| GC45c | | | | | | | | | 2.0 | 01/08 | 04:00 | 15.0 | 2.0 | 8-Jan | 4.0 | 16.0 | 2.0 | 8-Jan | 4.0 | 15.0 | 4.0 | Jan | 0.0 | 744.0 | 2.1 | 8-Jan | 4.0 | 30.0 |
| GC55c | | | | | | | | | 2.0 | 01/08 | 04:00 | 15.0 | 2.0 | 8-Jan | 4.0 | 16.0 | 2.0 | 8-Jan | 4.0 | 15.0 | 4.0 | Jan | 0.0 | 744.0 | 2.1 | 8-Jan | 4.0 | 30.0 |
| GC80c | | | | | | | | | 2.0 | 01/08 | 04:00 | 15.0 | 2.0 | 8-Jan | 4.0 | 16.0 | 2.0 | 8-Jan | 4.0 | 15.0 | 4.0 | Jan | 0.0 | 744.0 | 2.1 | 8-Jan | 4.0 | 30.0 |

**ASHRAE Standard 140-2020 Results Comparison for Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests
 TRNSYS 18.05.0001 (TRNSYS18) vs. Annex B8, Section B8.2 Example Results
 By Thermal Energy System Specialists, LLC (TESS), 15-Apr-2023**

Note: The statistics in the tables below are based on the Standard 140 informative example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8.2-9. Delta Steady-State Conduction

| | Verified Numerical Models | | | | (Max-Min) /Mean | GHT NREL | SUNREL-GC NREL | EnergyPlus GARD | VA114/ ISO-13370 VABI | ESP-r/ BASESIMP NRCan | BASECALC NRCan | Statistics, Other Simulation Models | | | TRNSYS18 TESS |
|-------------------------------------|---------------------------|-----------------|---------------|---------|--------------------|-------------|-------------------|--------------------|-----------------------------|-----------------------------|-------------------|-------------------------------------|-------|---------------------------------------|------------------|
| | TRNSYS TESS | FLUENT PAAET | MATLAB DIT | | | | | | | | | Min | Max | (Max-Min)/ (V.M.Mean) ^a | |
| Floor Conduction (W or Wh/h) | | | | | | | | | | | | | | | |
| GC30a-GC10a | 214 | 160 | 263 | 48.5% | 42 | | | | | | | 42 | 42 | 0.0% | 211 |
| GC40ab-GC30a | -12.4 | 13.2 | 0.1 | 8227.4% | -80.9 | | | | | | | -80.9 | -80.9 | 0.0% | -1.8 |
| GC40bb-GC30b | -10.3 | -0.1 | 0.0 | -297.9% | 0.5 | 0.5 | -3.6 | -0.2 | | | | -3.6 | 0.5 | -117.7% | -0.6 |
| GC40cb-GC30c | -7.9 | 0.2 | 0.0 | -314.3% | | | 4.3 | 0.5 | 0.2 | 0.2 | | 0.2 | 4.3 | -160.0% | -0.7 |
| GC30a-GC30b | 109 | 81 | 125 | 41.7% | 116 | | | | | | | 116 | 116 | 0.0% | 109 |
| GC30a-GC30c | 505 | 462 | 541 | 15.6% | | | | | | | | | | | 505 |
| GC30b-GC60b | 420 | 400 | 442 | 10.0% | | 342 | 434 | 352 | | | | 342 | 434 | 21.8% | 420 |
| GC60b-GC65b | 120 | 114 | 125 | 9.3% | | 104 | 603 | 149 | | | | 104 | 603 | 418.5% | 120 |
| GC30b-GC65b | 539 | 513 | 566 | 9.9% | | 446 | 1037 | 501 | | | | 446 | 1037 | 109.5% | 539 |
| GC70bb-GC65b | -7.9 | -0.4 | 0.0 | -284.9% | | 0.5 | 160.0 | -0.3 | | | | -0.3 | 160.0 | -5797.5% | -0.6 |
| Zone Load (W or Wh/h) | | | | | | | | | | | | | | | |
| GC40bb-GC30b | | | | | | 0.5 | -3.6 | -0.1 | | | | -3.6 | 0.5 | -117.7% | -0.6 |
| GC40cb-GC30c | | | | | | | 4.3 | 0.1 | -0.1 | -0.1 | | -0.1 | 4.3 | -172.4% | -0.7 |
| GC30b-GC60b | | | | | | 342 | 434 | 352 | | | | 342 | 434 | 21.8% | 420 |
| GC60b-GC65b | | | | | | 104 | 603 | 150 | | | | 104 | 603 | 418.5% | 120 |
| GC30b-GC65b | | | | | | 446 | 1037 | 502 | | | | 446 | 1037 | 109.5% | 539 |
| GC70bb-GC65b | | | | | | 0.5 | 160.0 | 0.2 | | | | 0.2 | 160.0 | -5780.2% | -0.6 |

^a "V.M.Mean" is average of verified numerical-model results; for zone load results the average of the floor conduction results is used.

^b Values for GC40a, GC40b, GC40c and GC70b are: annual total × 1000 (W/kW) / 8760 (h/y)

**ASHRAE Standard 140-2020 Results Comparison for Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests
 TRNSYS 18.05.0001 (TRNSYS18) vs. Annex B8, Section B8.2 Example Results
 By Thermal Energy System Specialists, LLC (TESS), 15-Apr-2023**

Note: The statistics in the tables below are based on the Standard 140 informative example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8.2-10. Delta Steady-Periodic Annual Total Conduction

| | Verified Numerical Models | | | | (Max-Min) /Mean | GHT NREL | SUNREL-GC NREL | EnergyPlus GARD | VA114/ ISO-13370 VABI | ESP-r/ BASESIMP NRCan | BASECALC NRCan | Statistics, Other Simulation Models | | | TRNSYS18 TESS |
|-------------------------------|---------------------------|-----------------|---------------|-------|--------------------|-------------|-------------------|--------------------|-----------------------------|-----------------------------|-------------------|-------------------------------------|-------|---------------------------------------|------------------|
| | TRNSYS TESS | FLUENT PAAET | MATLAB DIT | | | | | | | | | Min | Max | (Max-Min)/ (V.M.Mean) ^a | |
| Floor Conduction (kWh) | | | | | | | | | | | | | | | |
| GC40a-GC40b | 933 | 829 | 1096 | 28.1% | 299 | | | | | | | 299 | 299 | 0.0% | 946 |
| GC45b-GC40b | 10659 | 10524 | 10971 | 4.2% | | | 10211 | 9650 | | | | 9650 | 10211 | 5.2% | 10341 |
| GC40b-GC50bc | 15846 | 15677 | 16181 | 3.2% | | | | 15908 | 14683 | | | 14683 | 15908 | 7.7% | 15916 |
| GC55b-GC40b | 12976 | 12947 | 12978 | 0.2% | | 12698 | 16728 | 10395 | | | | 10395 | 16728 | 48.8% | 12940 |
| GC40b-GC70b | 4704 | 4498 | 4961 | 9.8% | | 3906 | 7650 | 4389 | | | | 3906 | 7650 | 79.3% | 4725 |
| GC40b-GC80b | 16071 | 15993 | 16362 | 2.3% | | 14852 | 17145 | 15478 | | | | 14852 | 17145 | 14.2% | 16030 |
| GC45c-GC40c | 8355 | 8309 | 8519 | 2.5% | | | 8452 | 7708 | 6564 | 6564 | 6564 | 6564 | 8452 | 22.5% | 8400 |
| GC55c-GC40c | 2111 | 2117 | 2113 | 0.3% | | | 2315 | 1842 | 3565 | 3565 | 3565 | 1842 | 3565 | 81.5% | 2099 |
| GC40c-GC80c | 9457 | 9461 | 9559 | 1.1% | | | 10182 | 9364 | 8650 | 8650 | 8650 | 8650 | 10182 | 16.1% | 9486 |
| Zone Conduction (kWh) | | | | | | | | | | | | | | | |
| GC45b-GC40b | | | | | | | 10211 | 9664 | | | | 9664 | 10211 | 5.1% | 10341 |
| GC40b-GC50bc | | | | | | | | 15908 | 14701 | | | 14701 | 15908 | 7.6% | 15916 |
| GC55b-GC40b | | | | | | 12698 | 16728 | 10394 | | | | 10394 | 16728 | 48.8% | 12940 |
| GC40b-GC70b | | | | | | 3906 | 7650 | 4395 | | | | 3906 | 7650 | 79.3% | 4725 |
| GC40b-GC80b | | | | | | 14852 | 17145 | 15482 | | | | 14852 | 17145 | 14.2% | 16030 |
| GC45c-GC40c | | | | | | | 8452 | 7722 | 6640 | 6640 | 6640 | 6640 | 8452 | 21.6% | 8400 |
| GC55c-GC40c | | | | | | | 2315 | 1842 | 3566 | 3566 | 3566 | 1842 | 3566 | 81.6% | 2099 |
| GC40c-GC80c | | | | | | | 10182 | 9366 | 8697 | 8697 | 8697 | 8697 | 10182 | 15.6% | 9486 |

^a "V.M.Mean" is average of verified numerical-model results; for zone load results the average of the floor conduction results is used.

^c GC50b with normalized floor area: GC50b / (80 x 80) x (12 x 12)

**ASHRAE Standard 140-2020 Results Comparison for Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests
 TRNSYS 18.05.0001 (TRNSYS18) vs. Annex B8, Section B8.2 Example Results
 By Thermal Energy System Specialists, LLC (TESS), 15-Apr-2023**

Note: The statistics in the tables below are based on the Standard 140 informative example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8.2-11. Delta Steady-Periodic Last-Year Peak Hour Floor Conduction

| | Verified Numerical Models | | | | VA114/ ESP-r/ GHT SUNREL-GC EnergyPlus ISO-13370 BASESIMP BASECALC | | | | | | Statistics, Other Simulation Models | | | TRNSYS18 TESS |
|-------------------------------------|---------------------------|-----------------|---------------|--------------------|---|------|------|------|-------|-------|-------------------------------------|------|---------------------------------------|------------------|
| | TRNSYS TESS | FLUENT PAAET | MATLAB DIT | (Max-Min) /Mean | NREL | NREL | GARD | VABI | NRCan | NRCan | Min | Max | (Max-Min)/ (V.M.Mean) ^a | |
| Floor Conduction (W or Wh/h) | | | | | | | | | | | | | | |
| GC40a-GC40b | 145 | 128 | 171 | 29.1% | 48 | | | | | | 48 | 48 | 0.0% | 147 |
| GC45b-GC40b | 1503 | 1482 | 1549 | 4.4% | | | 1410 | 1419 | | | 1410 | 1419 | 0.6% | 1458 |
| GC40b-GC50bc | 2164 | 2138 | 2214 | 3.5% | | | 2115 | 2082 | | | 2082 | 2115 | 1.5% | 2174 |
| GC55b-GC40b | 1425 | 1422 | 1425 | 0.2% | | 1391 | 1855 | 1186 | | | 1186 | 1855 | 47.0% | 1421 |
| GC40b-GC70b | 687 | 655 | 726 | 10.2% | | 566 | 1099 | 647 | | | 566 | 1099 | 77.3% | 690 |
| GC40b-GC80b | 2166 | 2151 | 2208 | 2.6% | | 1988 | 2239 | 2146 | | | 1988 | 2239 | 11.5% | 2161 |
| GC45c-GC40c | 1180 | 1173 | 1205 | 2.7% | | | 1176 | 1134 | 961 | 954 | 954 | 1176 | 18.7% | 1188 |
| GC55c-GC40c | 256 | 258 | 258 | 0.9% | | | 275 | 210 | 435 | 435 | 210 | 435 | 87.4% | 255 |
| GC40c-GC80c | 1265 | 1264 | 1279 | 1.2% | | | 1351 | 1285 | 1137 | 1133 | 1133 | 1351 | 17.1% | 1269 |
| Zone Conduction (W or Wh/h) | | | | | | | | | | | | | | |
| GC45b-GC40b | | | | | | | 1410 | 1421 | | | 1410 | 1421 | 0.7% | 1458 |
| GC40b-GC50bc | | | | | | | 2115 | 2097 | | | 2097 | 2115 | 0.8% | 2174 |
| GC55b-GC40b | | | | | | 1391 | 1855 | 1186 | | | 1186 | 1855 | 47.0% | 1421 |
| GC40b-GC70b | | | | | | 566 | 1099 | 648 | | | 566 | 1099 | 77.3% | 690 |
| GC40b-GC80b | | | | | | 1988 | 2239 | 2147 | | | 1988 | 2239 | 11.5% | 2161 |
| GC45c-GC40c | | | | | | | 1176 | 1137 | 973 | 967 | 967 | 1176 | 17.6% | 1187 |
| GC55c-GC40c | | | | | | | 275 | 211 | 435 | 437 | 211 | 437 | 87.8% | 255 |
| GC40c-GC80c | | | | | | | 1351 | 1285 | 1145 | 1139 | 1139 | 1351 | 16.7% | 1269 |

^a "V.M.Mean" is average of verified numerical-model results; for zone load results the average of the floor conduction results is used.

^c GC50b with normalized floor area: GC50b / (80 x 80) x (12 x 12)

**ASHRAE Standard 140-2020 Results Comparison for Section 5.2.4 - Ground Coupled Slab-On-Grade Analytical Verification Tests
 TRNSYS 18.05.0001 (TRNSYS18) vs. Annex B8, Section B8.2 Example Results
 By Thermal Energy System Specialists, LLC (TESS), 15-Apr-2023**

Note: The statistics in the tables below are based on the Standard 140 informative example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.


Table B8.2-12. Delta Steady-Periodic Conduction v Coldest Hour Phase Shift

| | Verified Numerical Models | | | | VA114/ ESP-r/ GHT SUNREL-GC EnergyPlus ISO-13370 BASESIMP BASECALC | | | | | | Statistics, Other Simulation Models | | | TRNSYS18 TESS |
|----------------------|---------------------------|-----------------|---------------|--------------------|---|------|------|------|-------|-------|-------------------------------------|------|---------------------------------------|------------------|
| | TRNSYS TESS | FLUENT PAAET | MATLAB DIT | (Max-Min) /Mean | NREL | NREL | GARD | VABI | NRCan | NRCan | Min | Max | (Max-Min)/ (V.M.Mean) ^a | |
| Floor (Hours) | | | | | | | | | | | | | | |
| GC40a-GC40b | -1 | -49 | -25 | -192.0% | -2 | | | | | | -2 | -2 | 0.0% | -1 |
| GC45b-GC40b | 0 | -24 | 0 | -300.0% | | | | -6 | | | -6 | -6 | 0.0% | 0 |
| GC40b-GC50bc | -72 | 0 | -24 | -225.0% | | | | 19 | | | 19 | 19 | 0.0% | -72 |
| GC55b-GC40b | -240 | -312 | -288 | -25.7% | | -311 | | -2 | | | -311 | -2 | -110.4% | -240 |
| GC40b-GC70b | -243 | -194 | -219 | -22.4% | | -173 | | -72 | | | -173 | -72 | -46.2% | -241 |
| GC40b-GC80b | -151 | -126 | -126 | -18.6% | | -129 | | -288 | | | -288 | -129 | -118.4% | -150 |
| GC45c-GC40c | -72 | -24 | 0 | -225.0% | | | | 20 | -2 | | -2 | 20 | -68.8% | -72 |
| GC55c-GC40c | -72 | -24 | 0 | -225.0% | | | | 17 | -33 | | -33 | 17 | -156.3% | -72 |
| GC40c-GC80c | -51 | -51 | -51 | 0.0% | | | | -139 | -45 | | -139 | -45 | -184.3% | -51 |
| Zone (Hours) | | | | | | | | | | | | | | |
| GC45b-GC40b | | | | | | | | 0 | | | 0 | 0 | 0.0% | 0 |
| GC40b-GC50bc | | | | | | | | 25 | | | 25 | 25 | 0.0% | -72 |
| GC55b-GC40b | | | | | | -311 | | -1 | | | -311 | -1 | -110.7% | -240 |
| GC40b-GC70b | | | | | | -173 | | -119 | | | -173 | -119 | -24.7% | -243 |
| GC40b-GC80b | | | | | | -129 | | -336 | | | -336 | -129 | -154.1% | -150 |
| GC45c-GC40c | | | | | | | | 0 | -40 | | -40 | 0 | -125.0% | -72 |
| GC55c-GC40c | | | | | | | | -23 | -112 | | -112 | -23 | -278.1% | -72 |
| GC40c-GC80c | | | | | | | | -144 | 40 | | -144 | 40 | -360.8% | -51 |

^a "V.M.Mean" is average of verified numerical-model results; for zone load results the average of the floor conduction results is used.

^c GC50b with normalized floor area: GC50b / (80 x 80) x (12 x 12)

Figure B8.2-1. IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-State Floor Conduction

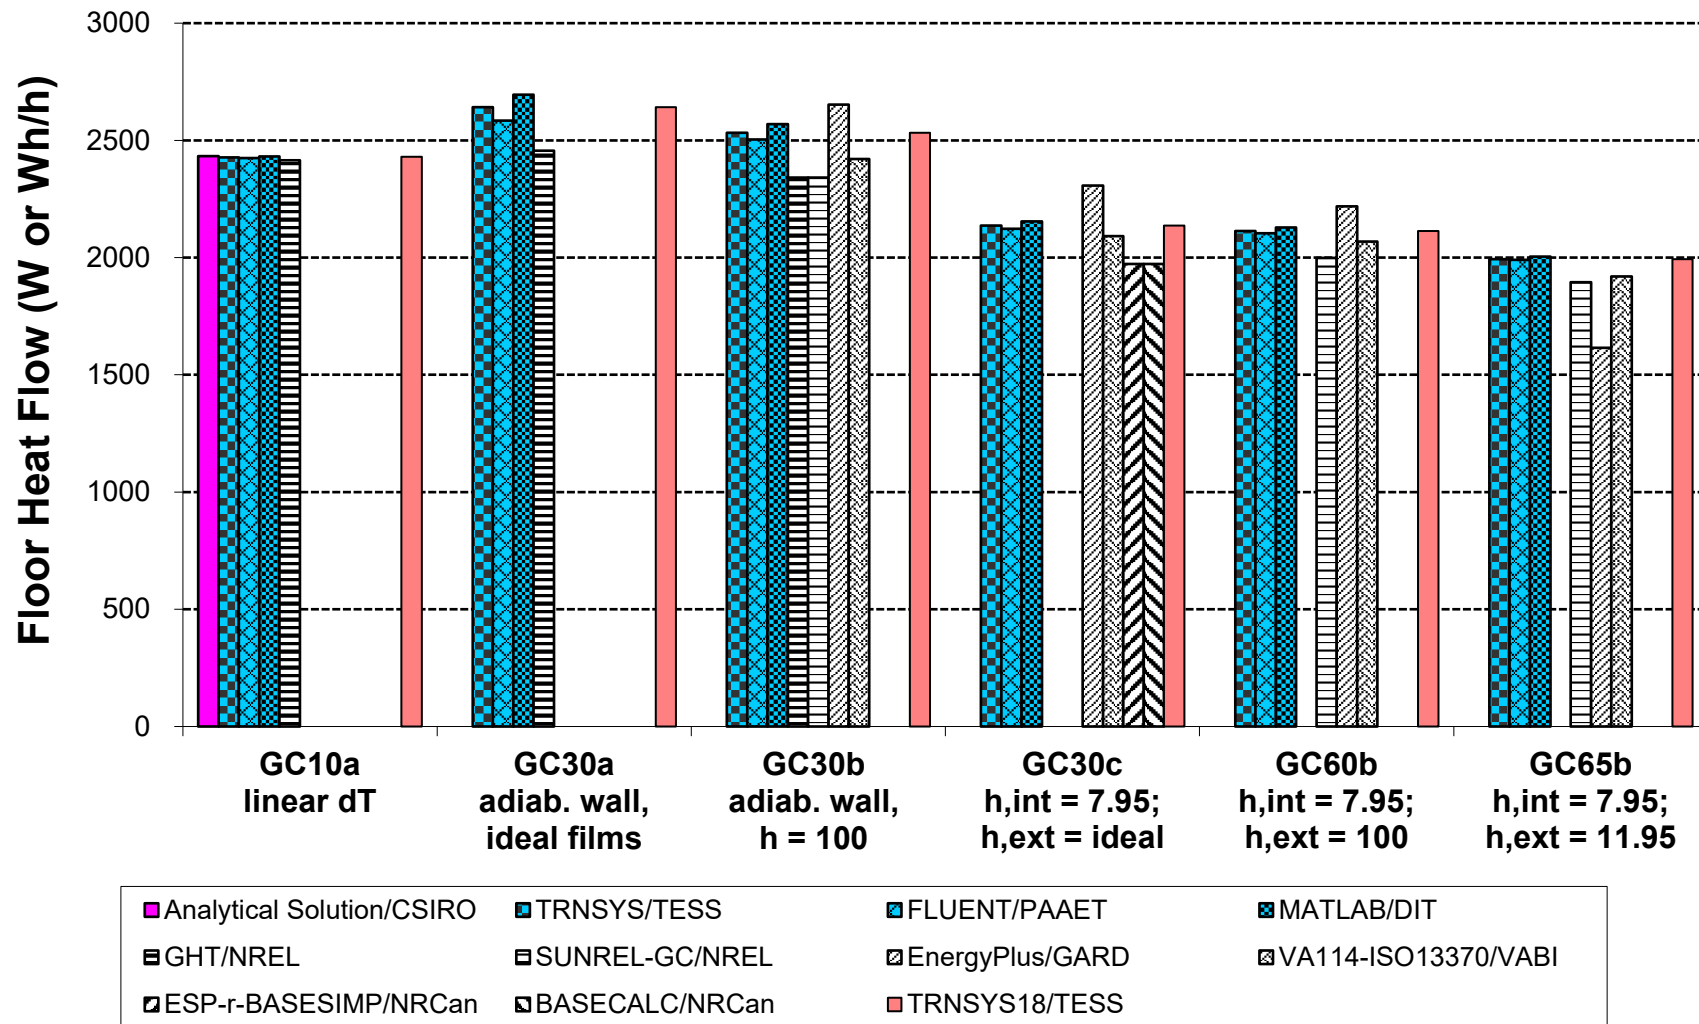

**Figure B8.2-3. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Steady-State Zone Heating Load**



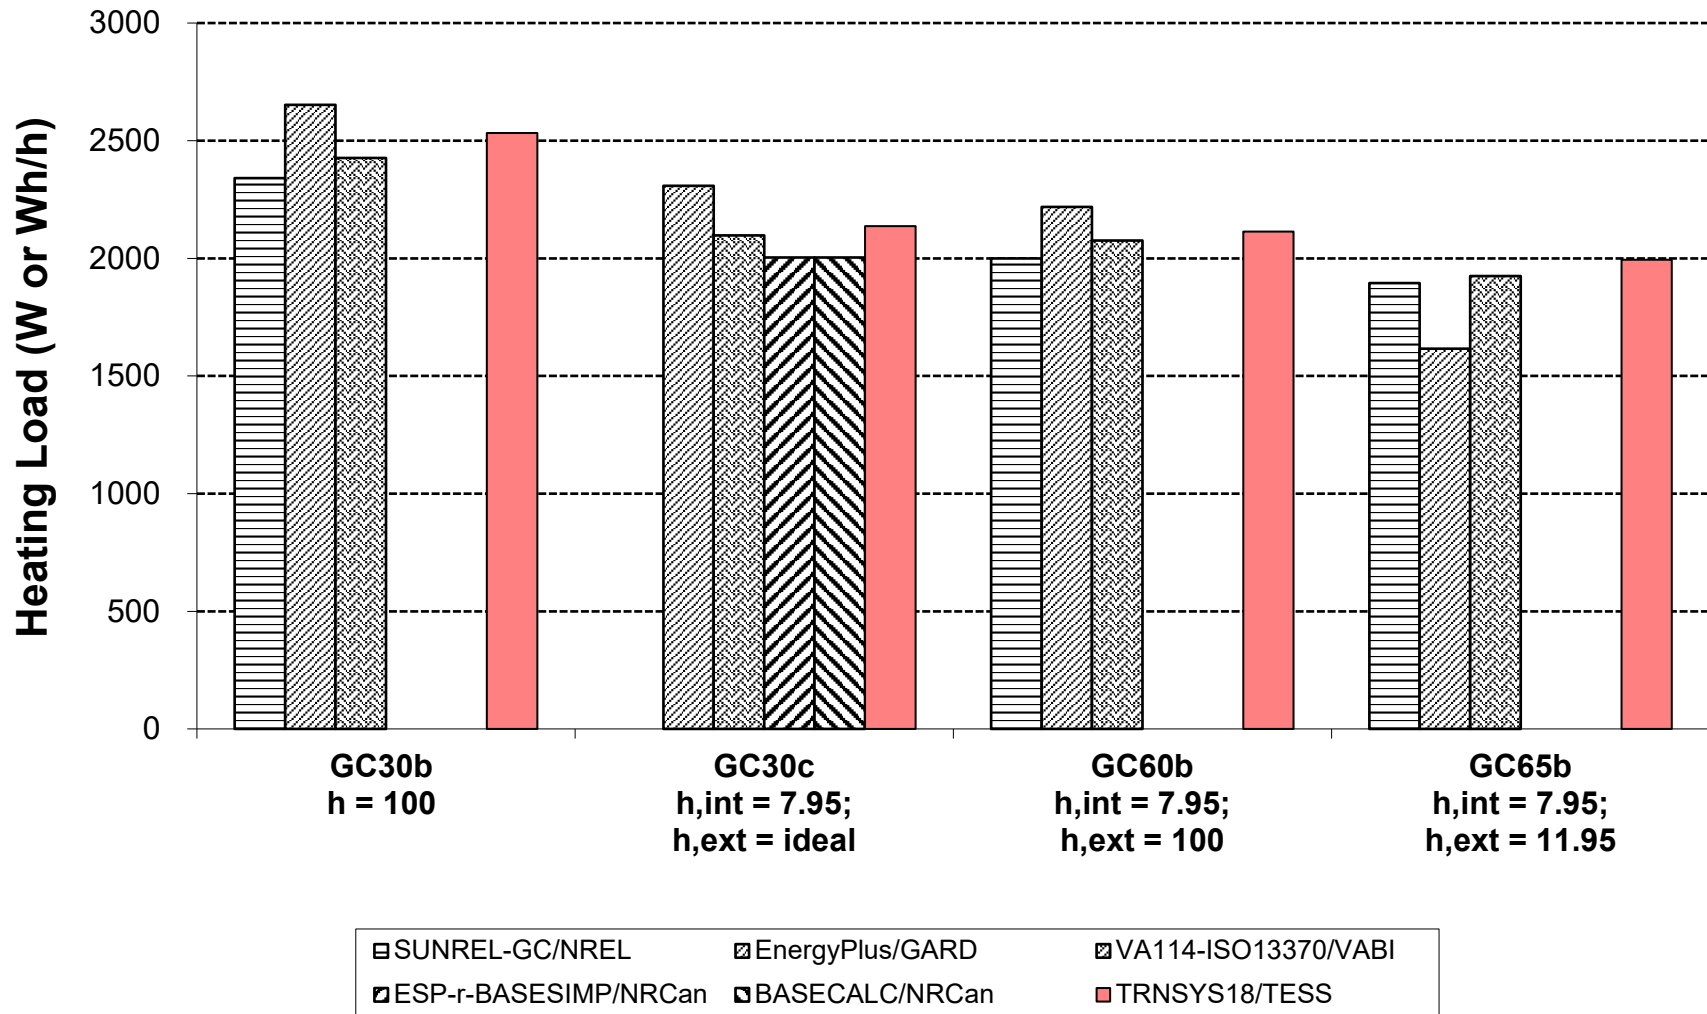


Figure B8.2-4. IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-State Zone Heating Load Sensitivity

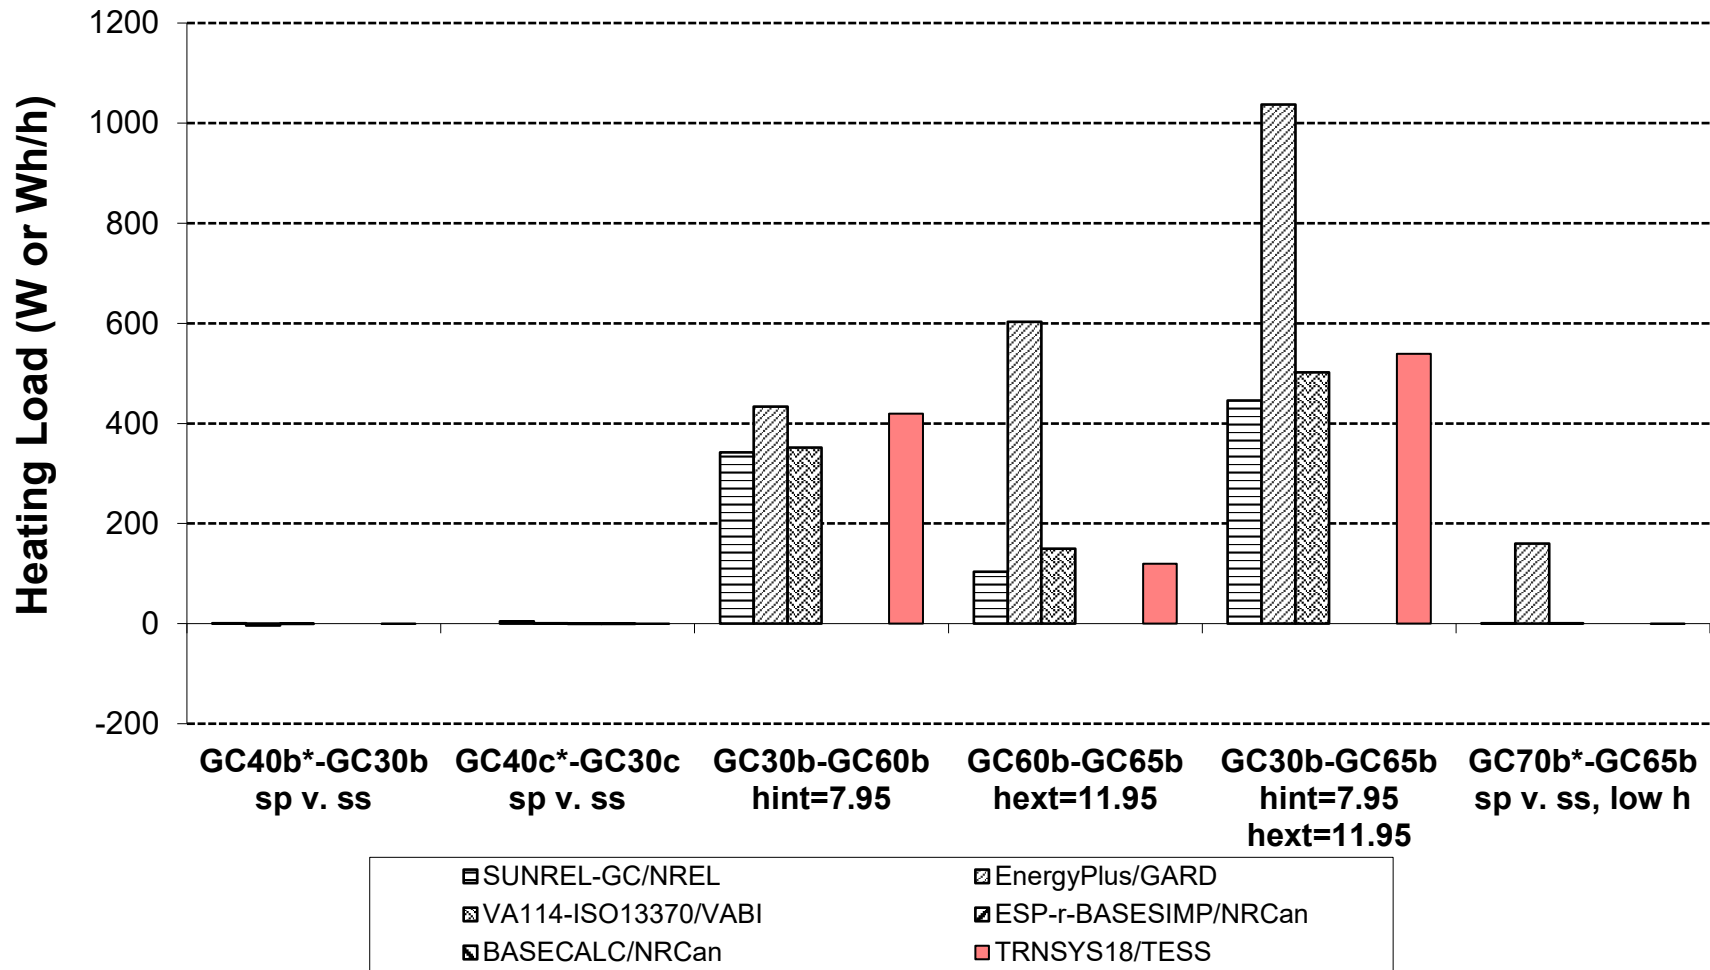

**Figure B8.2-5. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Steady-State (Zone Heating Load) - (Floor Conduction)**

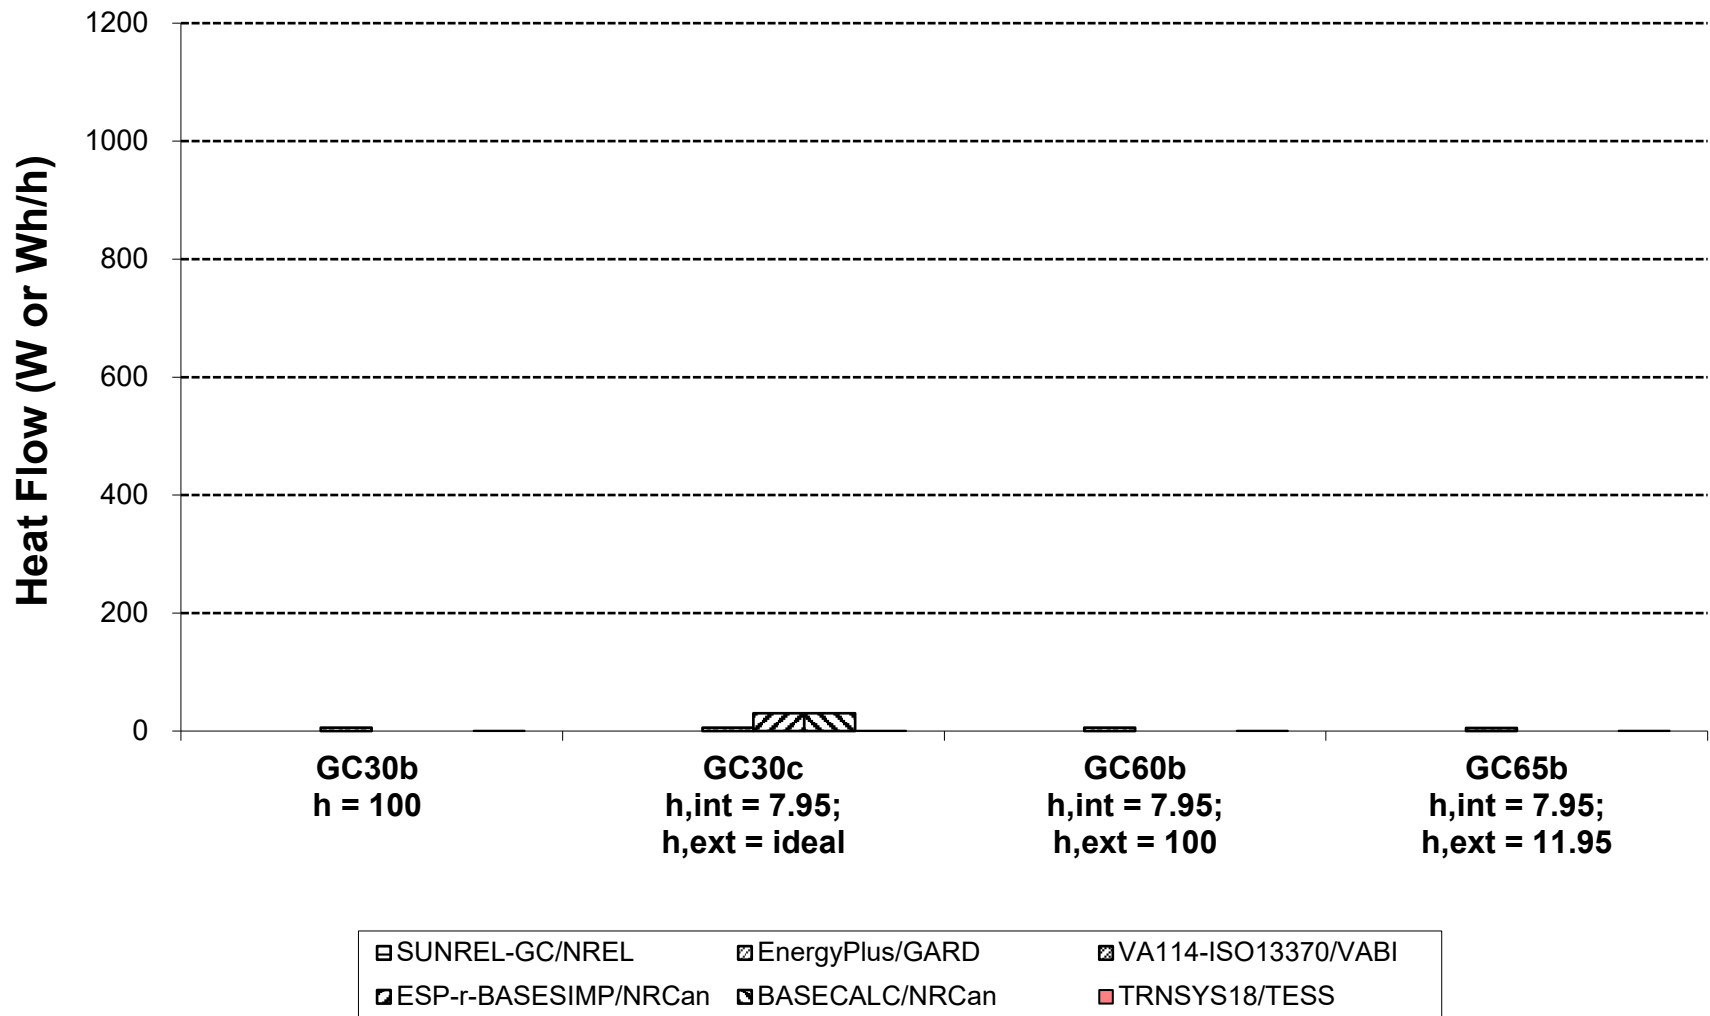

**Figure B8.2-6. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Case GC10a Modeling Parameters**



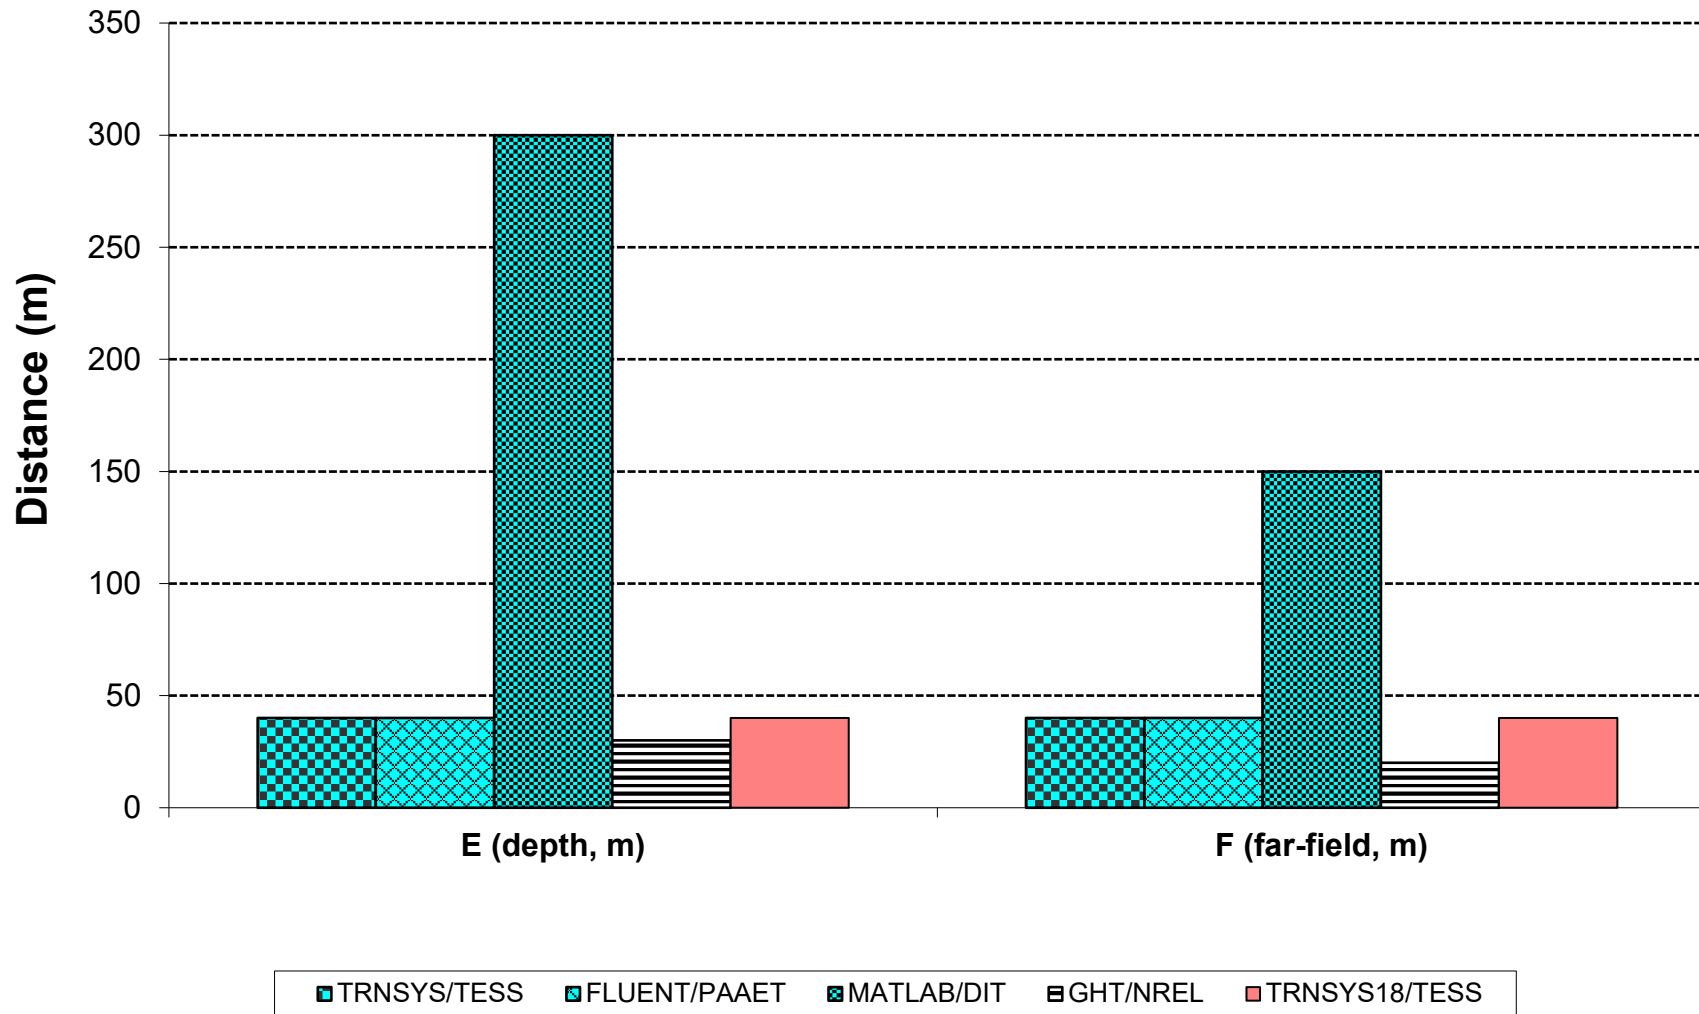


Figure B8.2-8.
IEA BESTEST Ground Coupling: In-Depth Floor Slab, GC10a
Steady-State Surface Temperatures (Y=0, thru edge center)

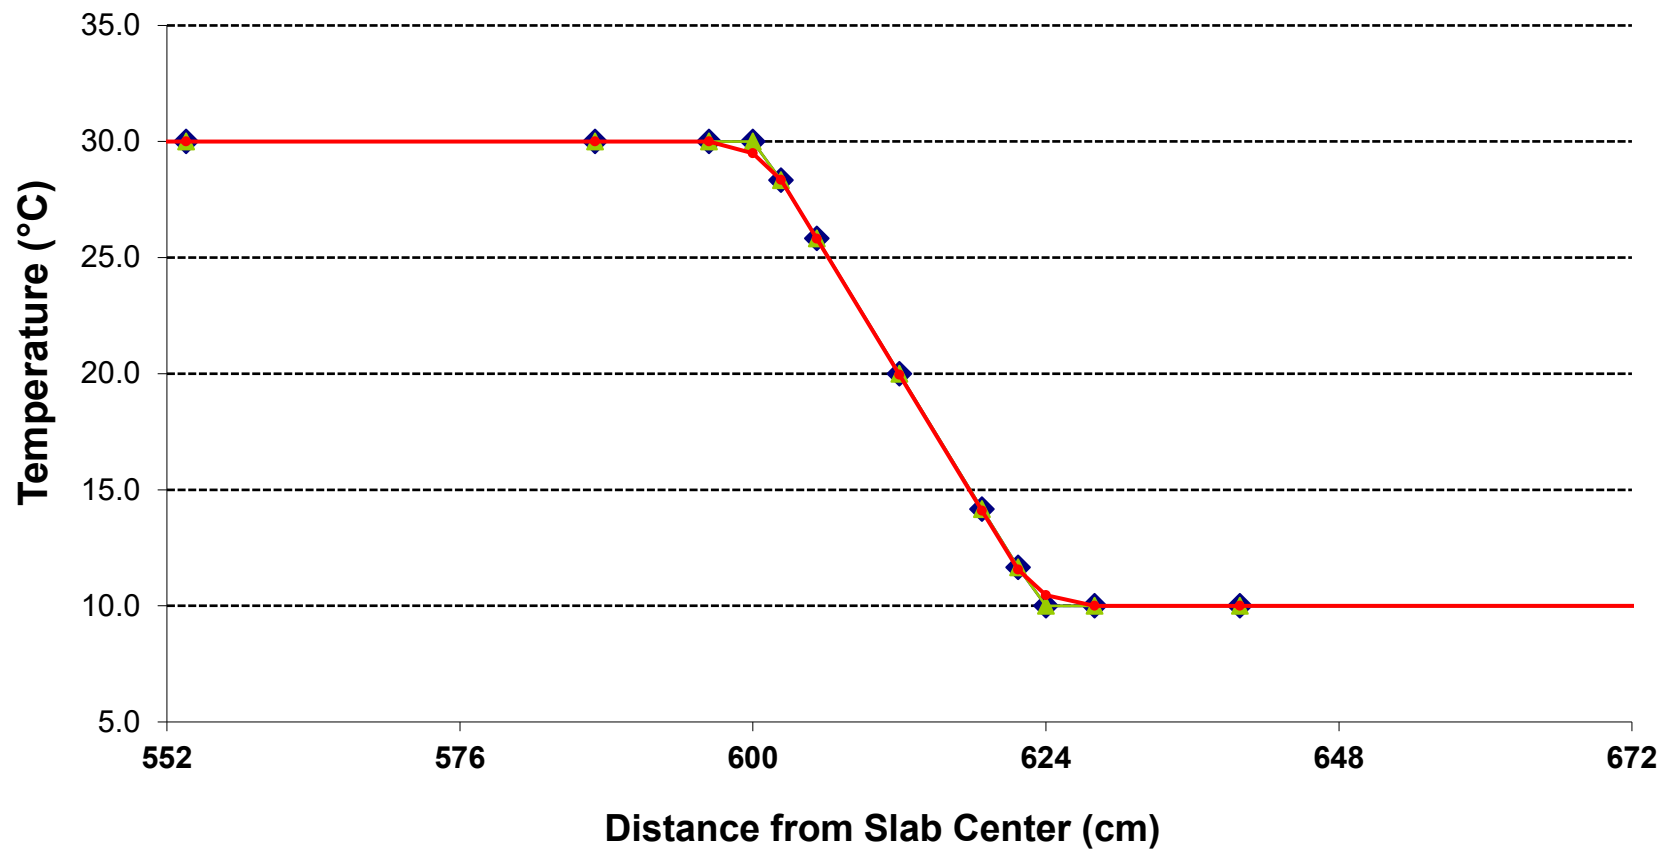


◆ TRNSYS/TESS-GC10a ▲ MATLAB/DIT-GC10a ● TRNSYS18/TESS-GC10a

Figure B8.2-9.
IEA BESTEST Ground Coupling: In-Depth Floor Slab, GC10a
Steady-State Surface Temperatures (Y=X, thru corner)

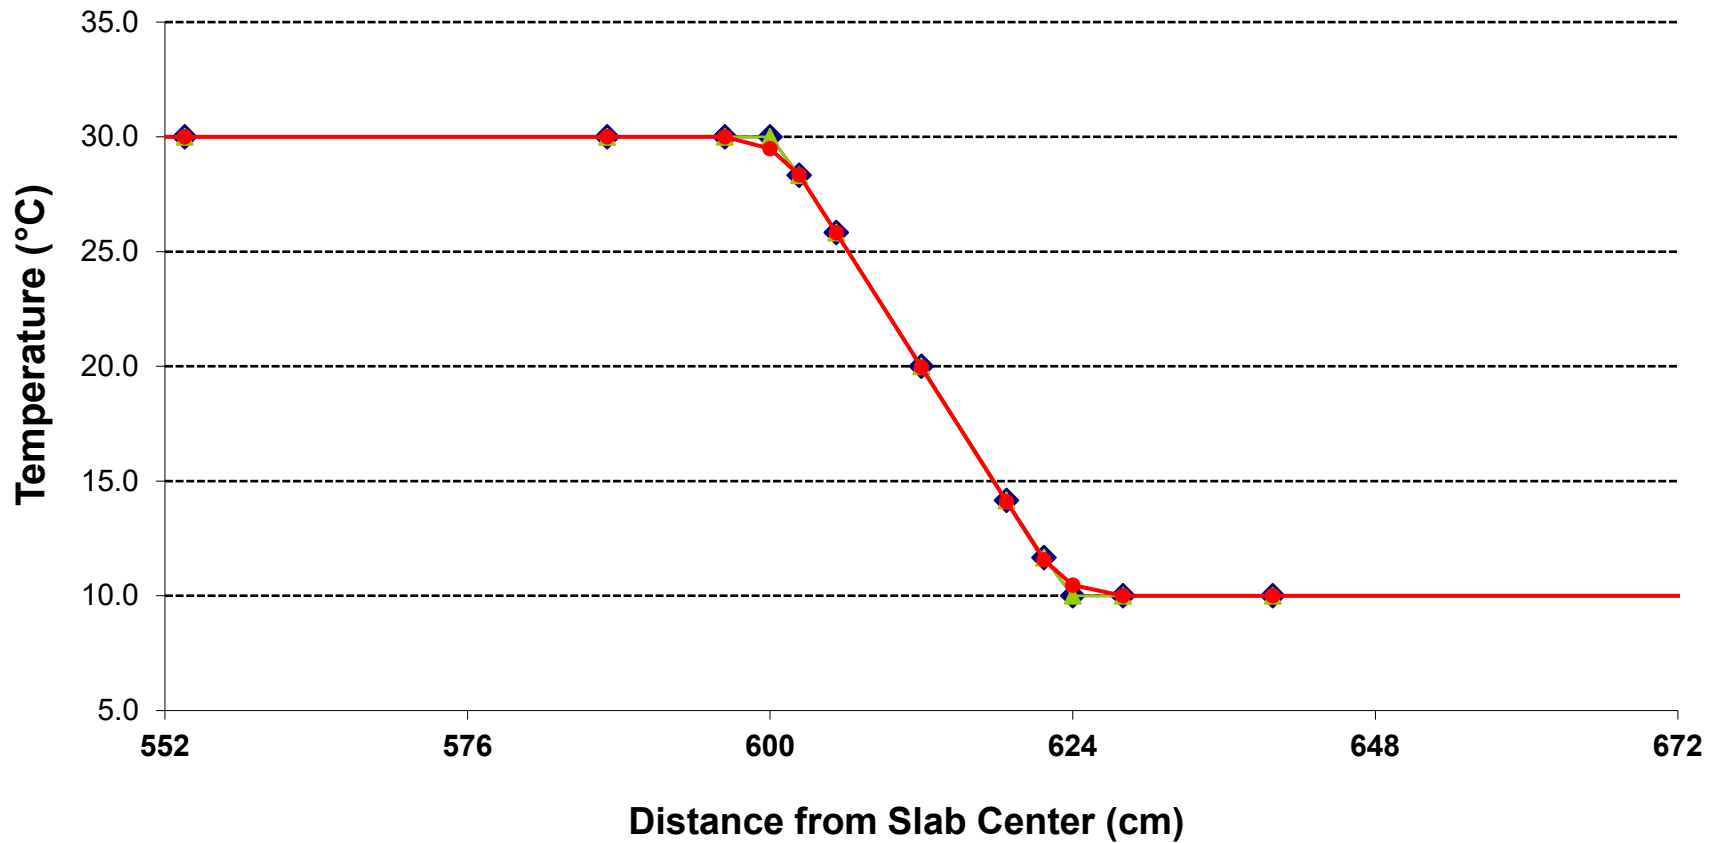


—◆— TRNSYS/TESS-GC10a —▲— MATLAB/DIT-GC10a —●— TRNSYS18/TESS-GC10a

Figure B8.2-10.
IEA BESTEST Ground Coupling: In-Depth Floor Slab, GC10a, GC30a
Steady-State Near-Surface Temperatures (Y=0, thru center of edge)

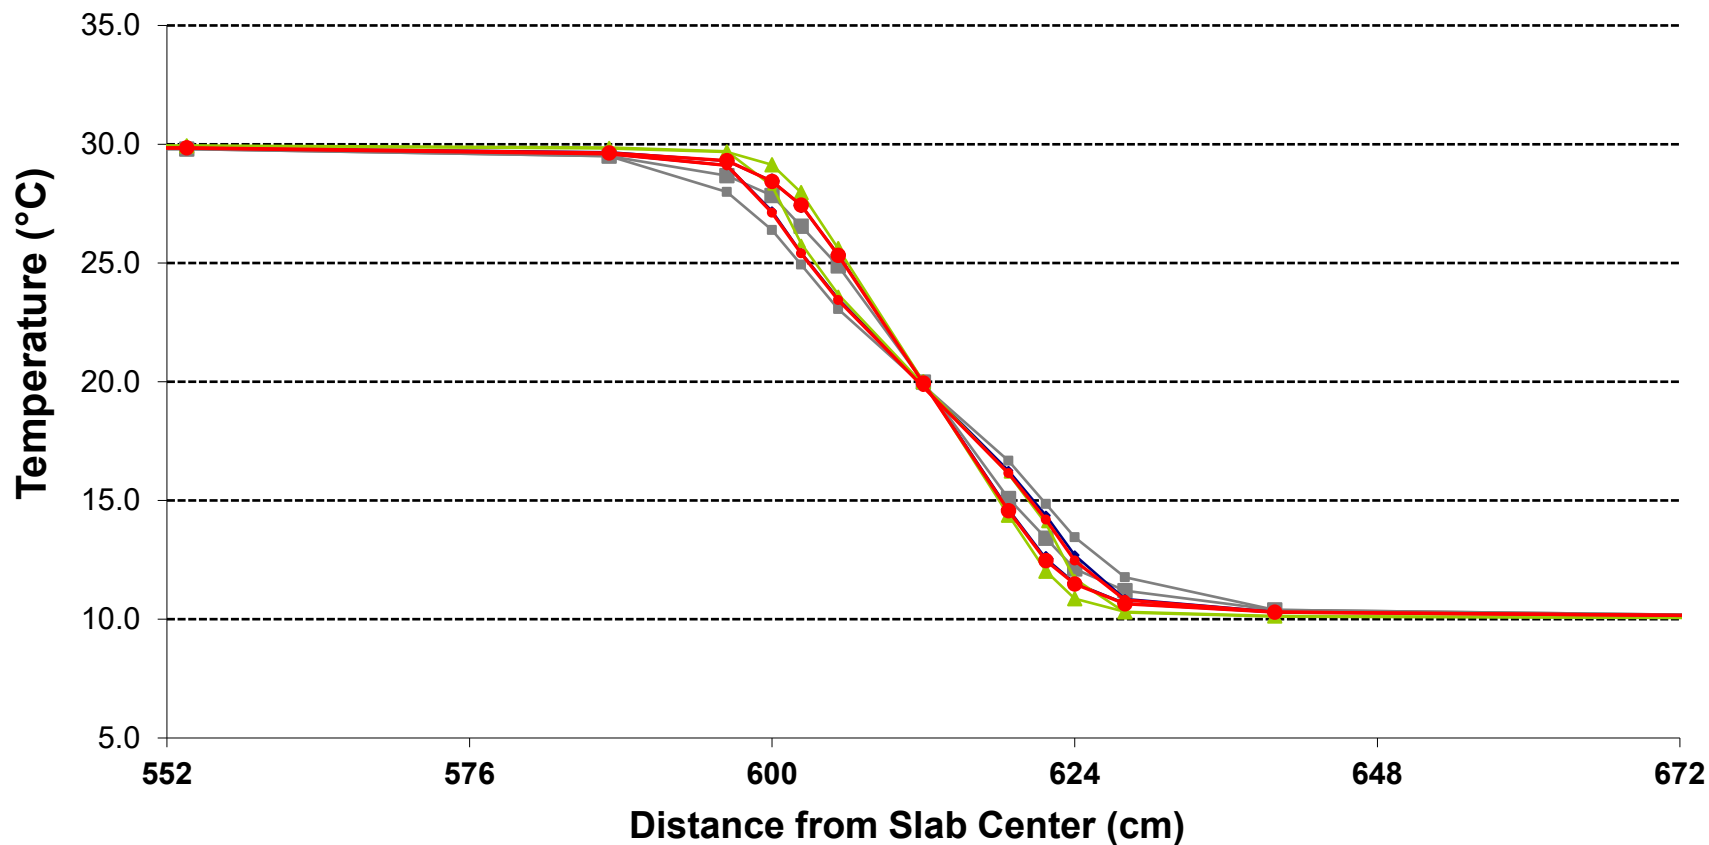


◆ TRNSYS/TESS-GC10a
 ■ FLUENT/PAAET-GC10a
 ▲ MATLAB/DIT-GC10a
 ◆ TRNSYS/TESS-GC30a
■ FLUENT/PAAET-GC30a
 ▲ MATLAB/DIT-GC30a
 ● TRNSYS18/TESS-GC10a
 ● TRNSYS18/TESS-GC30a

Figure B8.2-11.
IEA BESTEST Ground Coupling: In-Depth Floor Slab, GC10a, GC30a
Steady-State Near-Surface Temperatures (Y=X, thru corner)

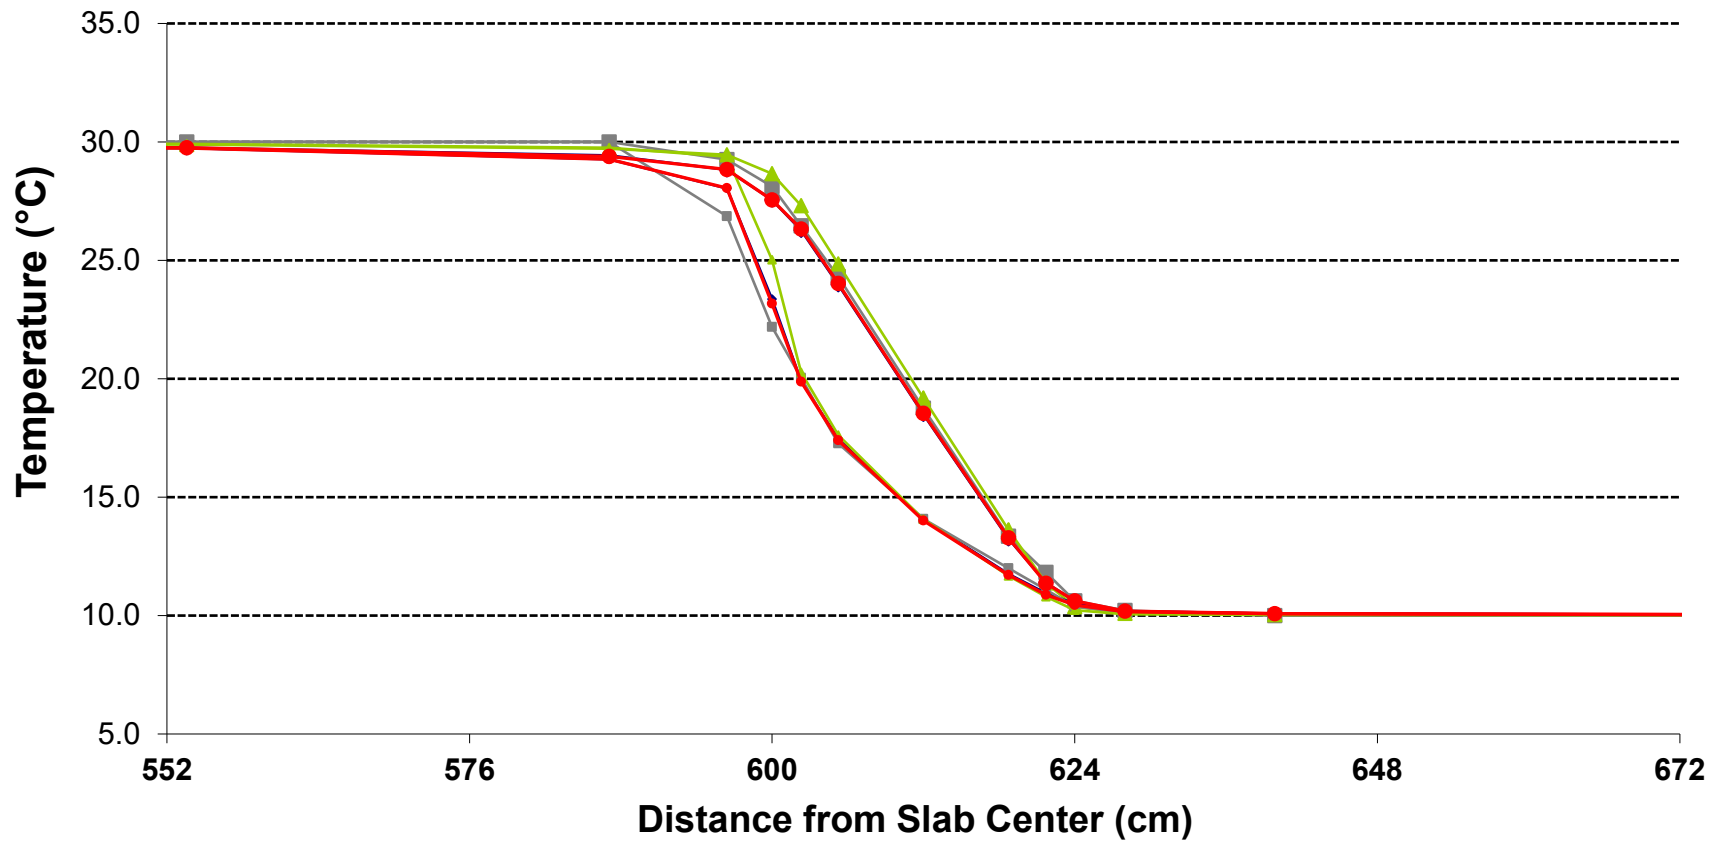


- ◆ TRNSYS/TESS-GC10a ■ FLUENT/PAAET-GC10a ▲ MATLAB/DIT-GC10a ◆ TRNSYS/TESS-GC30a
- FLUENT/PAAET-GC30a ▲ MATLAB/DIT-GC30a ● TRNSYS18/TESS-GC10a ● TRNSYS18/TESS-GC30a


Figure B8.2-12.
IEA BESTEST: In-Depth Floor Slab, GC30b, GC60b, GC65b
Steady-State Near-Surface Temperatures (Y=0, thru center of edge)

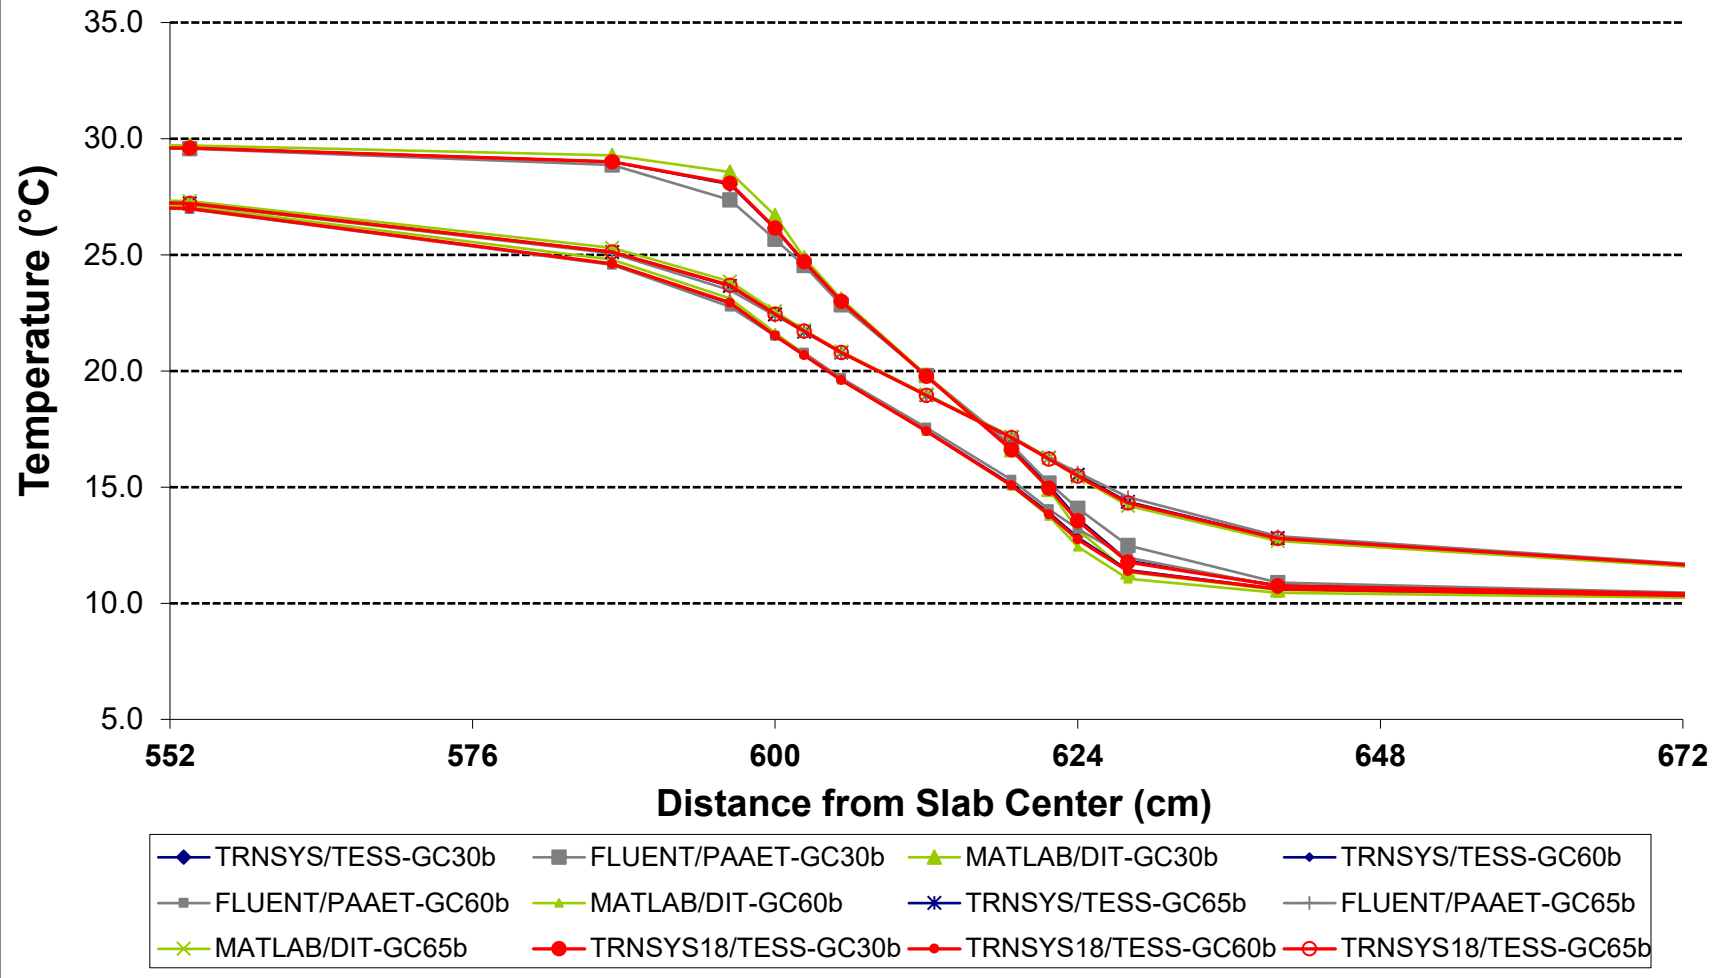

**Figure B8.2-15. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Steady-Periodic Annual Floor Conduction Sensitivity**

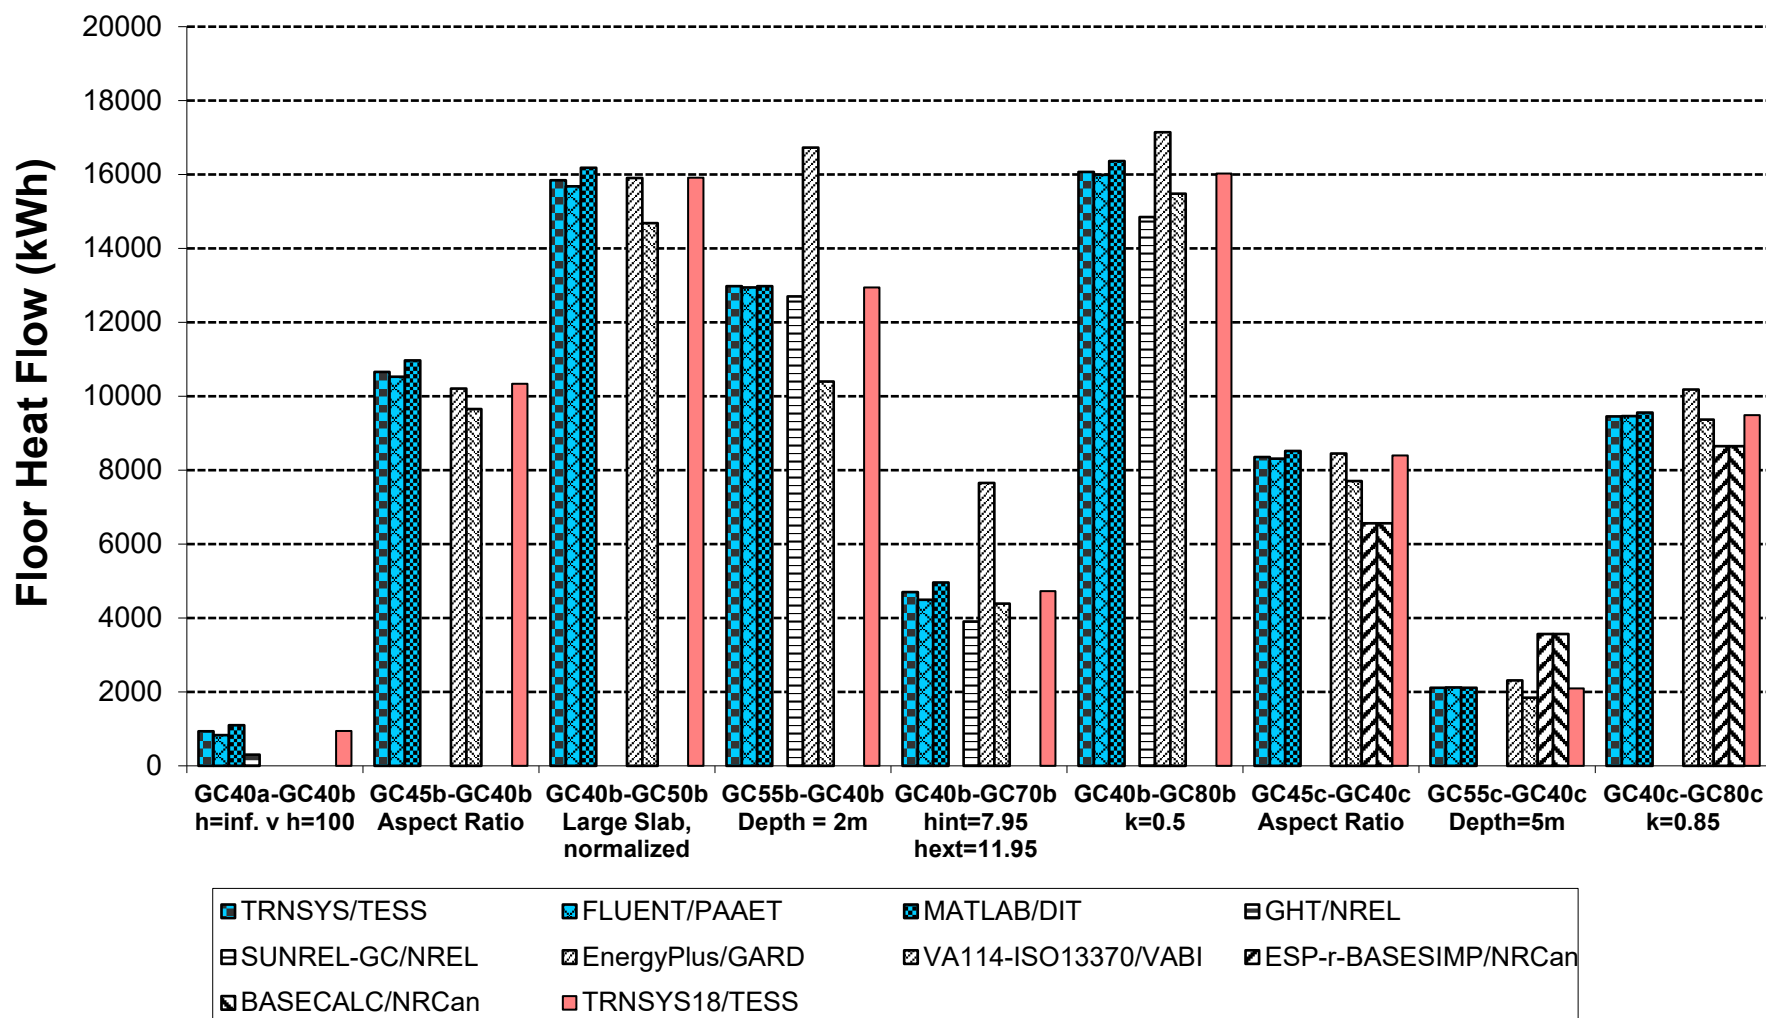

**Figure B8.2-16. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Steady-Periodic Annual Zone Heating Load**

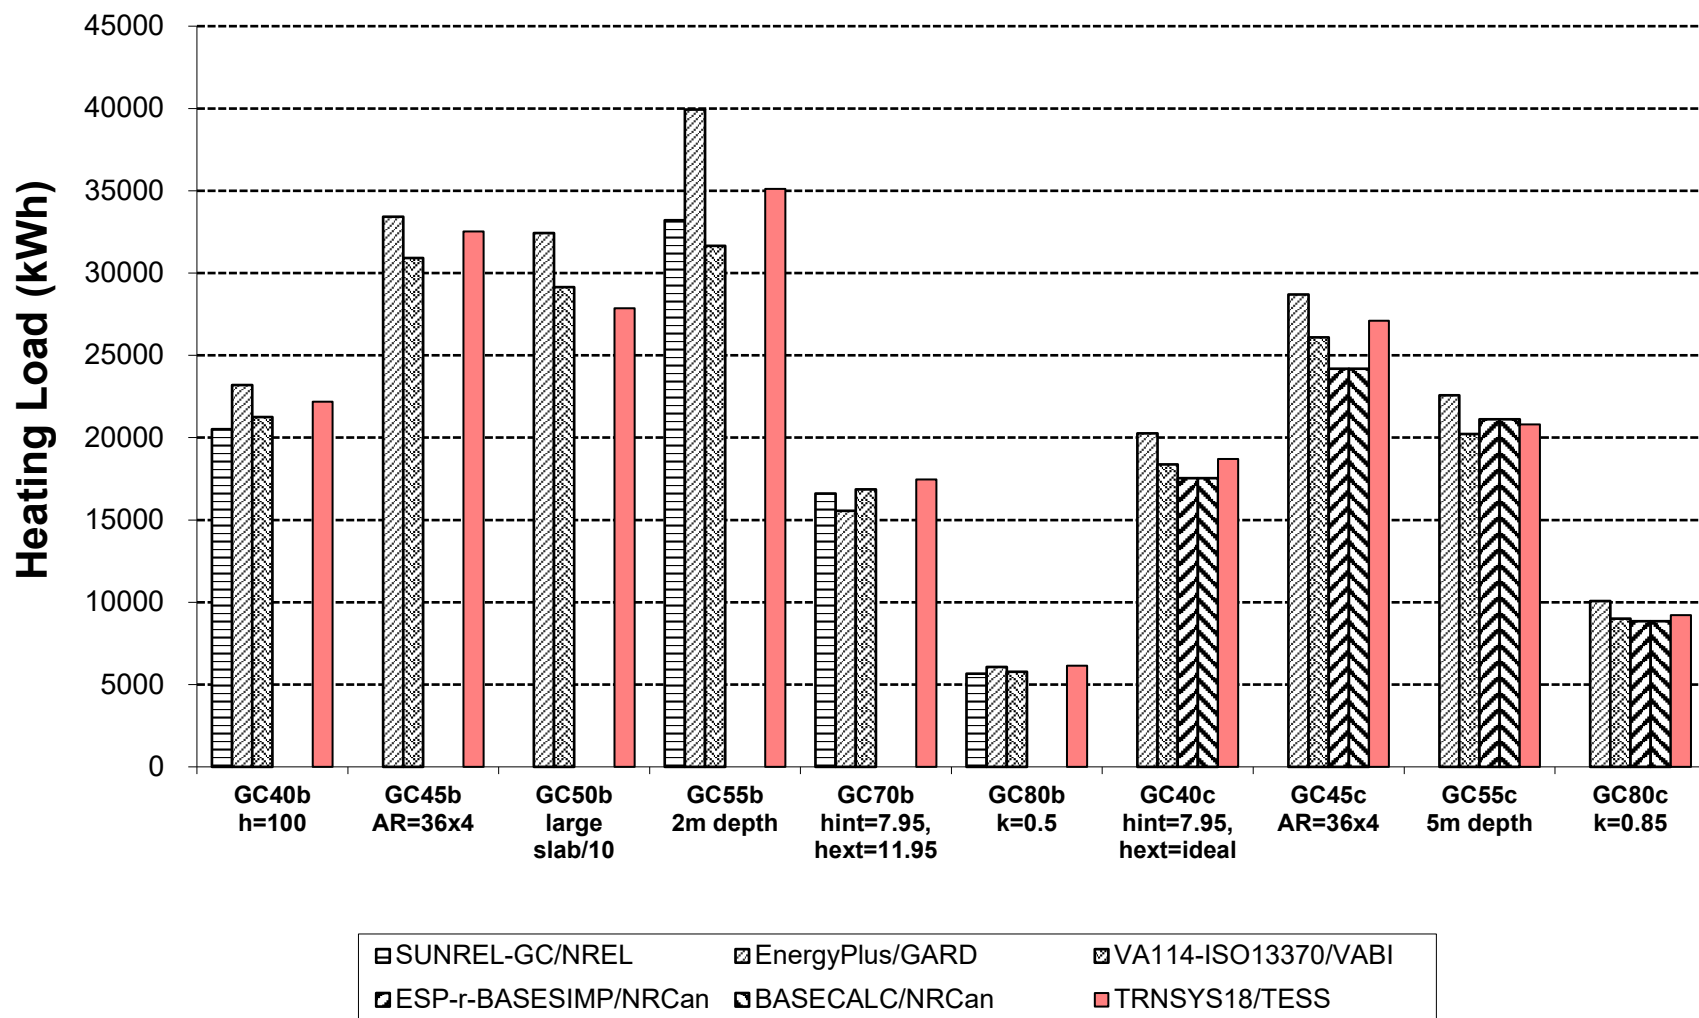

**Figure B8.2-17. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Steady-Periodic Annual Zone Heating Load Sensitivity**



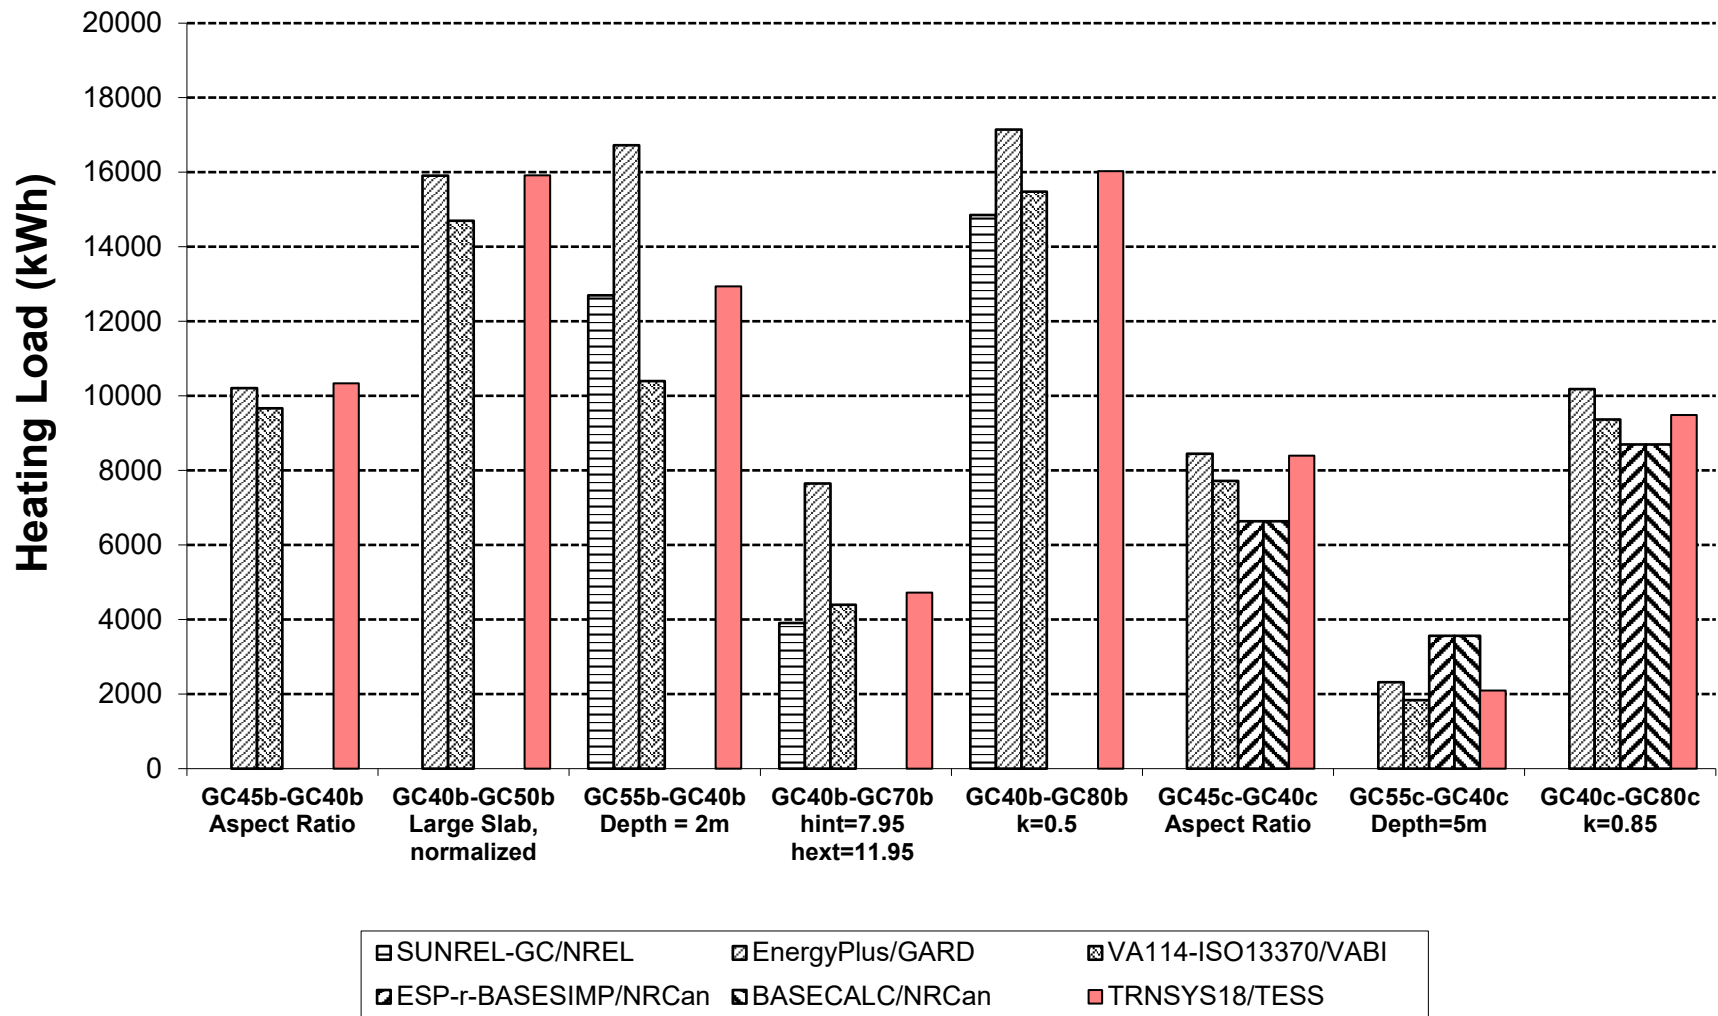



Figure B8.2-18. IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic (Zone Heating Load) - (Floor Conduction)

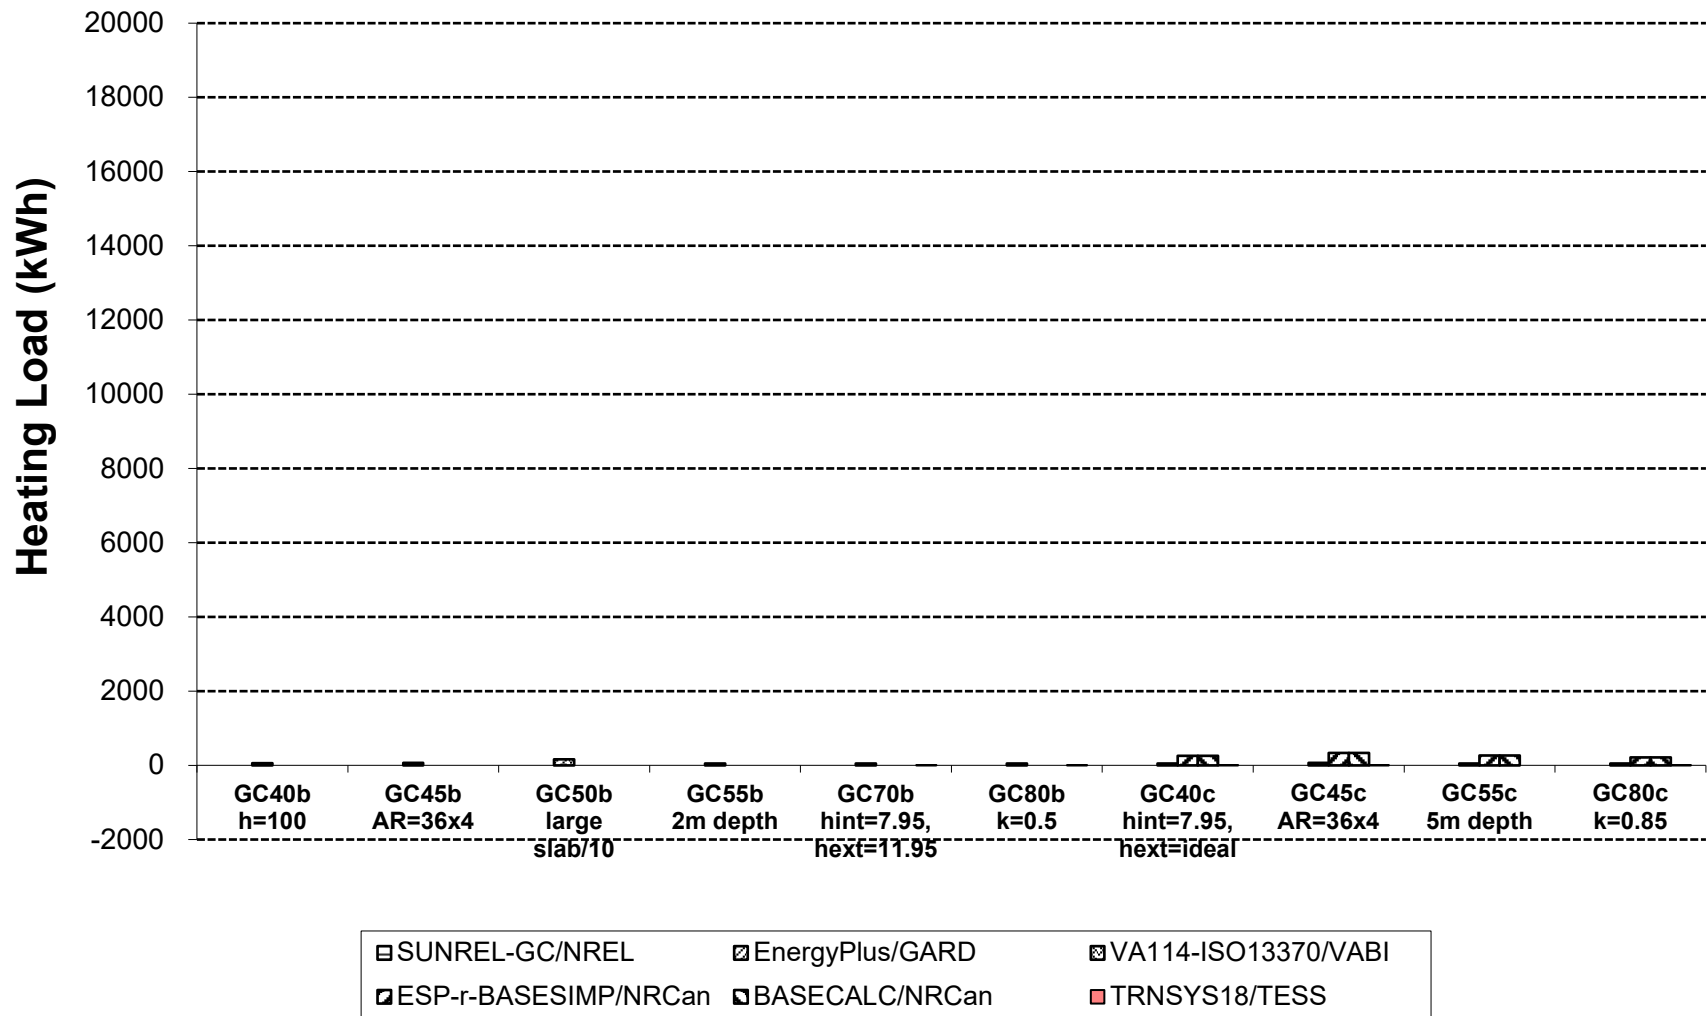

**Figure B8.2-19. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Hourly Floor Conduction, GC40a**

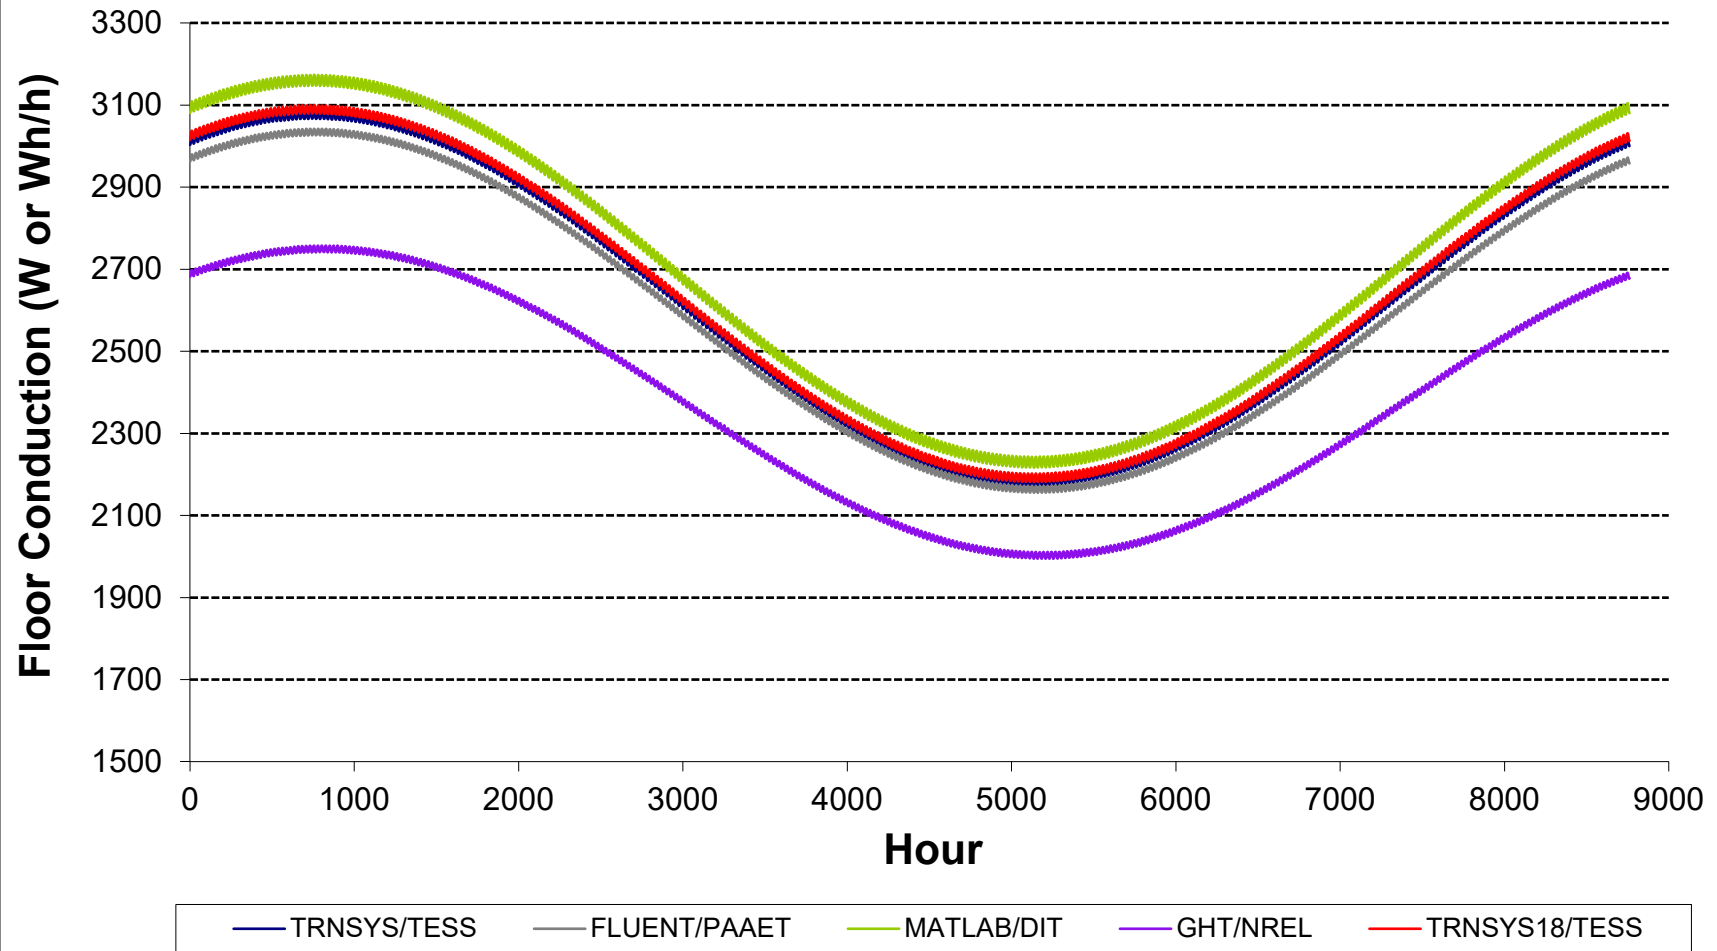

**Figure B8.2-20. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Hourly Floor Conduction, GC40b**

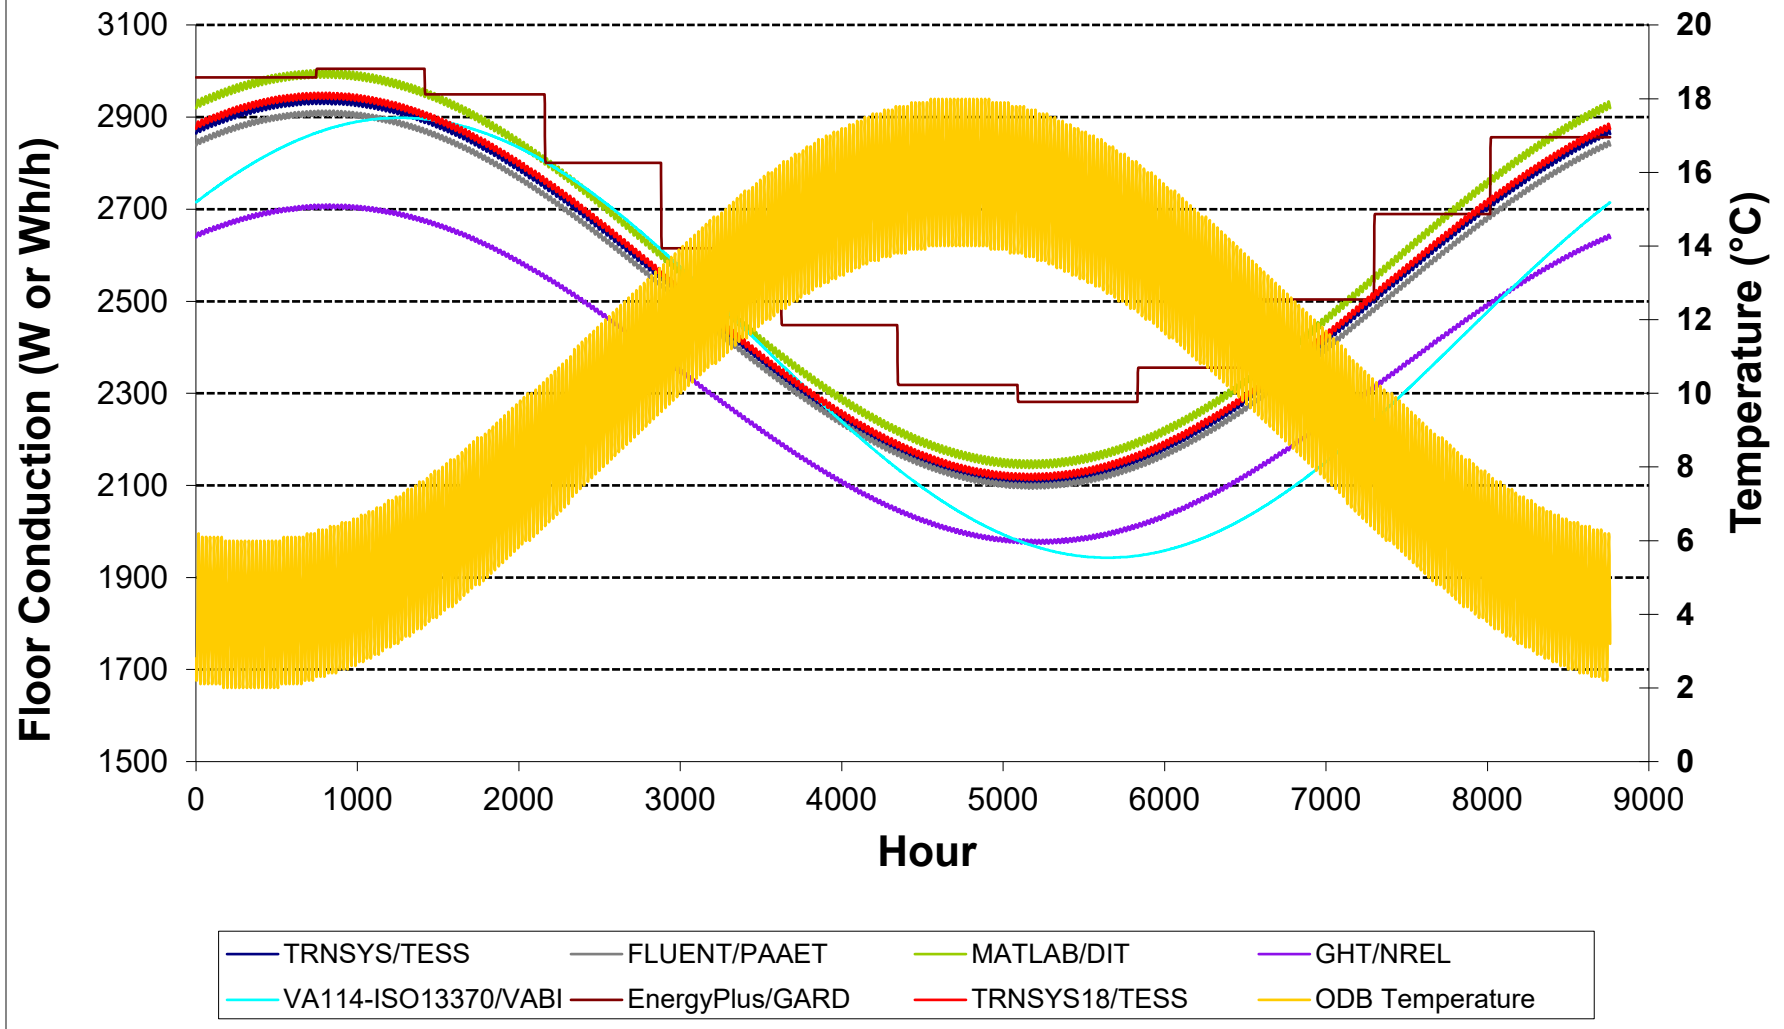

**Figure B8.2-21. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Hourly Floor Conduction, GC40c**


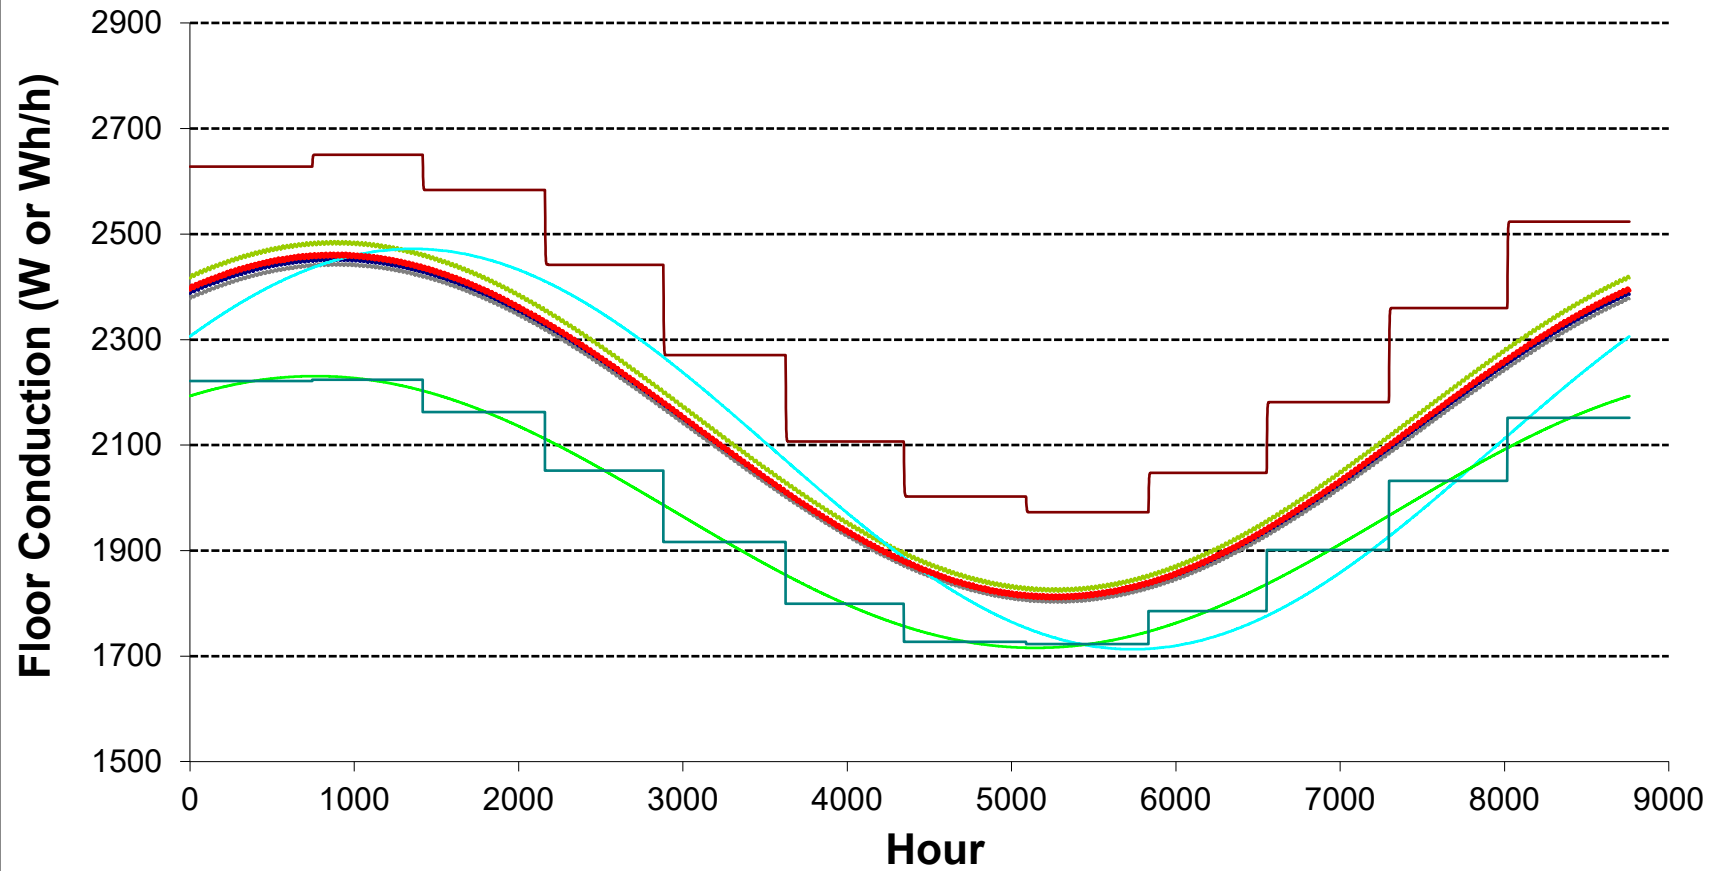


Figure B8.2-22. IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Phase Shift, Time From Coldest ODB to Peak Floor Conduction



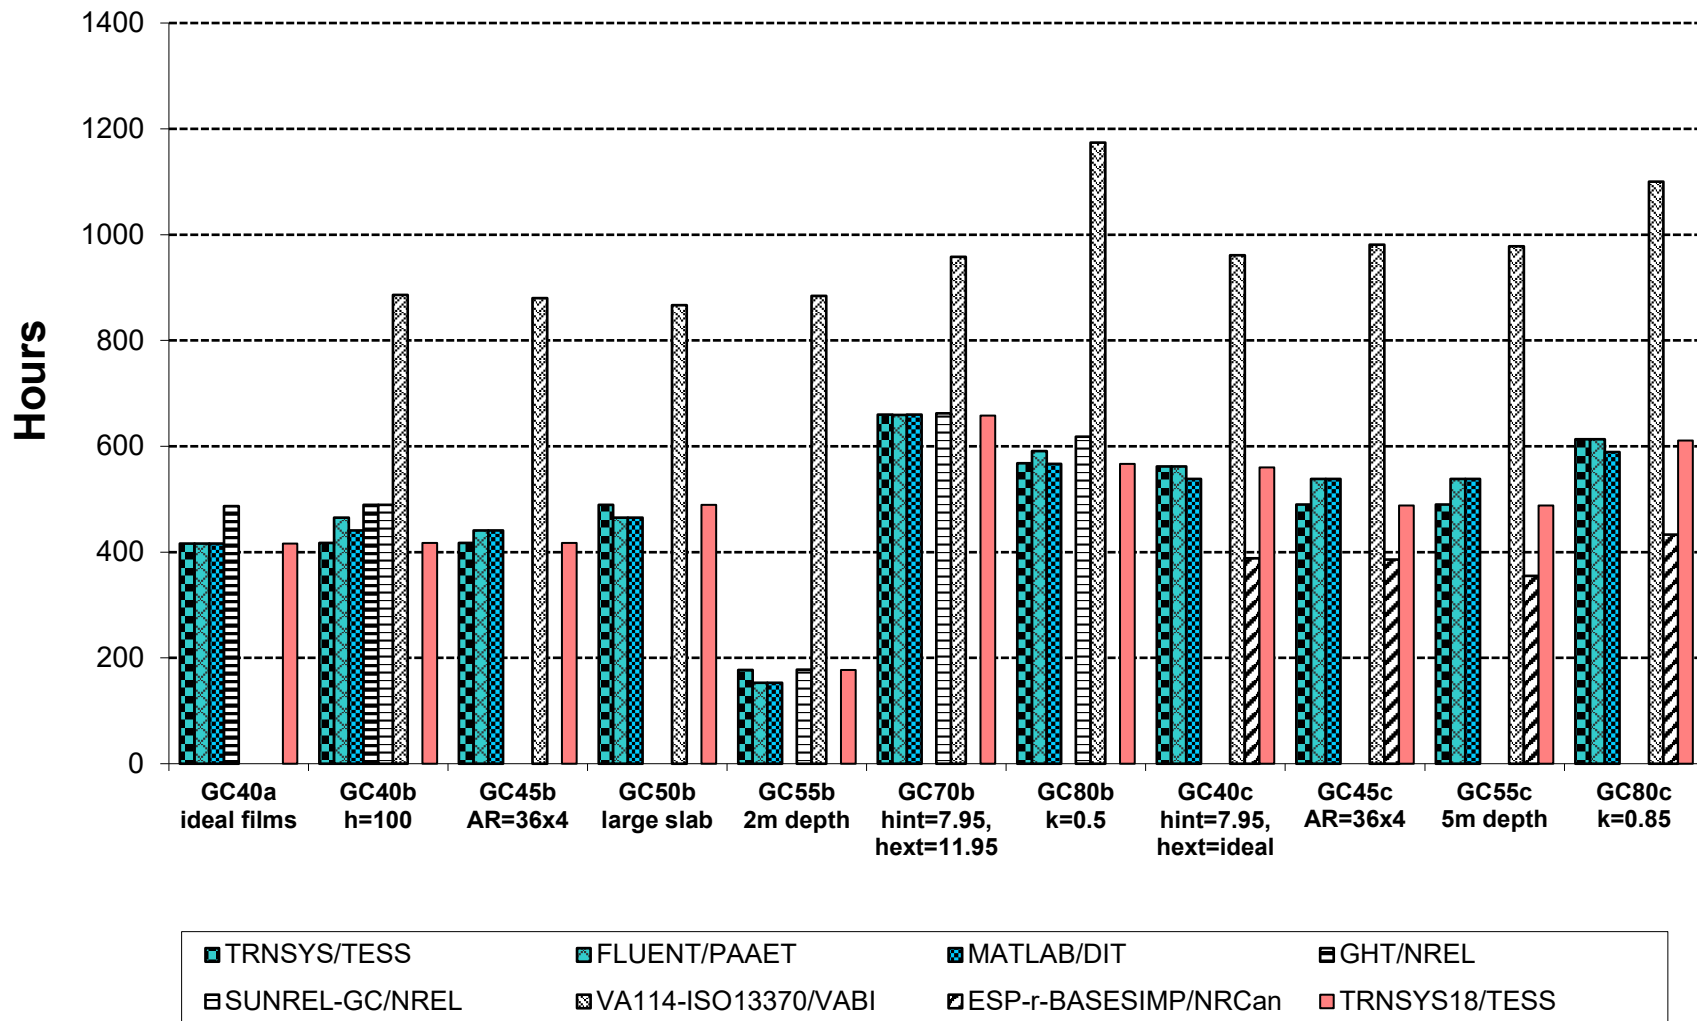



Figure B8.2-23. IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Phase Shift Sensitivity, Floor Conduction v. ODB

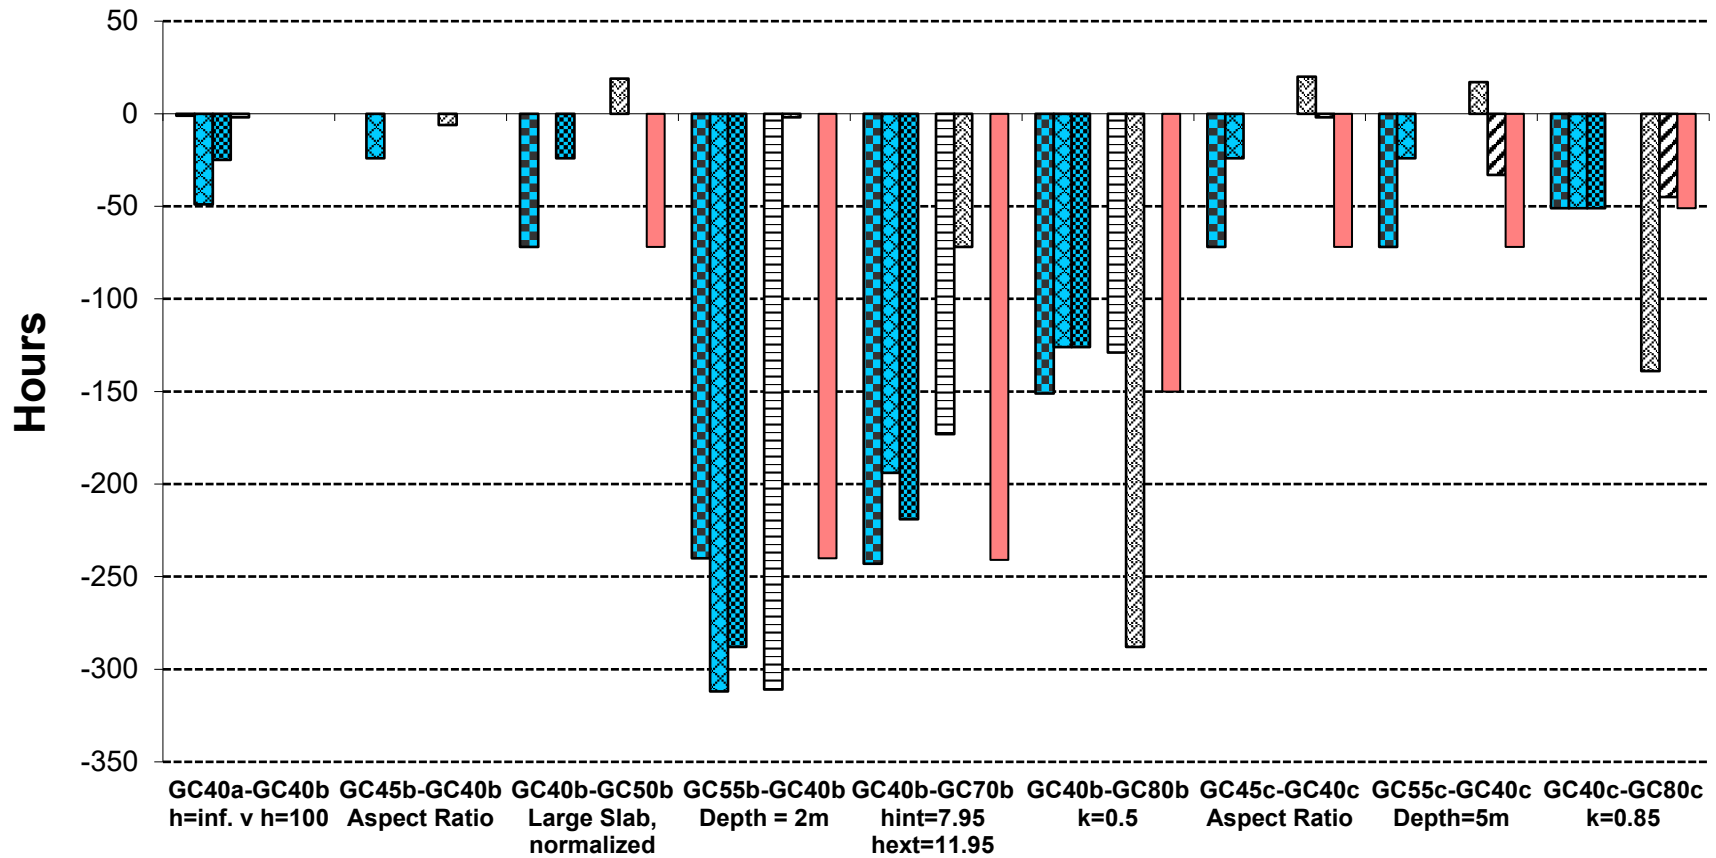

**Figure B8.2-24. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Steady-Periodic Phase Shift, Time from Coldest ODB to Peak Zone Load**

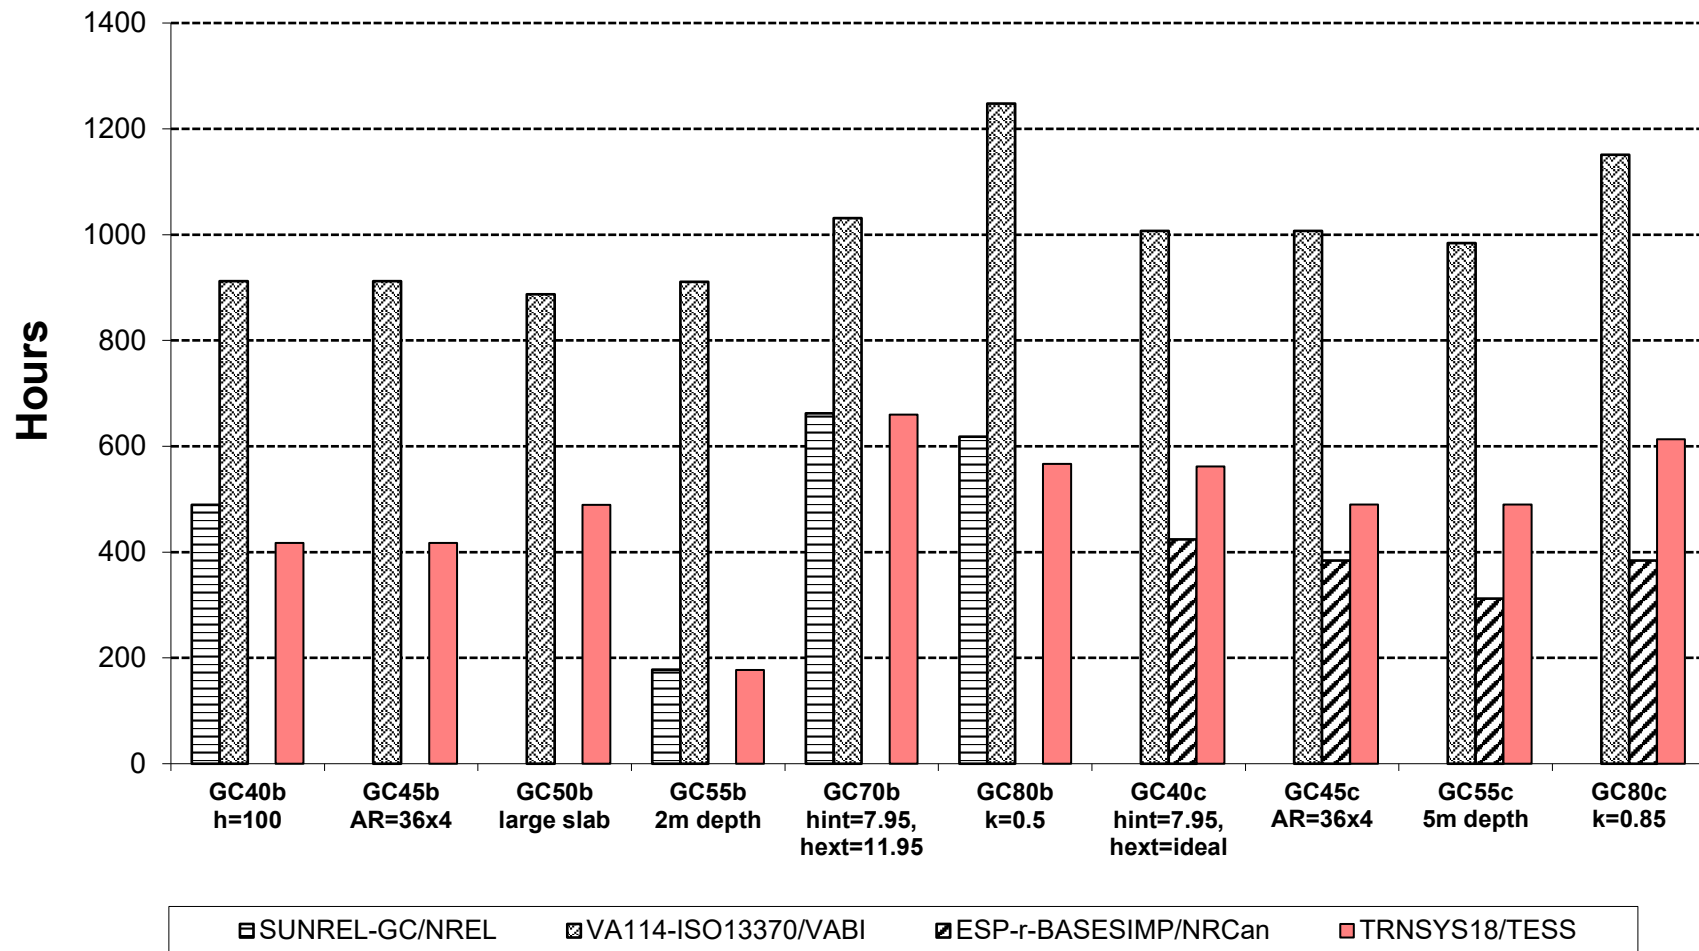

**Figure B8.2-25. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Delta Steady-Periodic Phase Shift Sensitivity, Zone Load v. ODB**

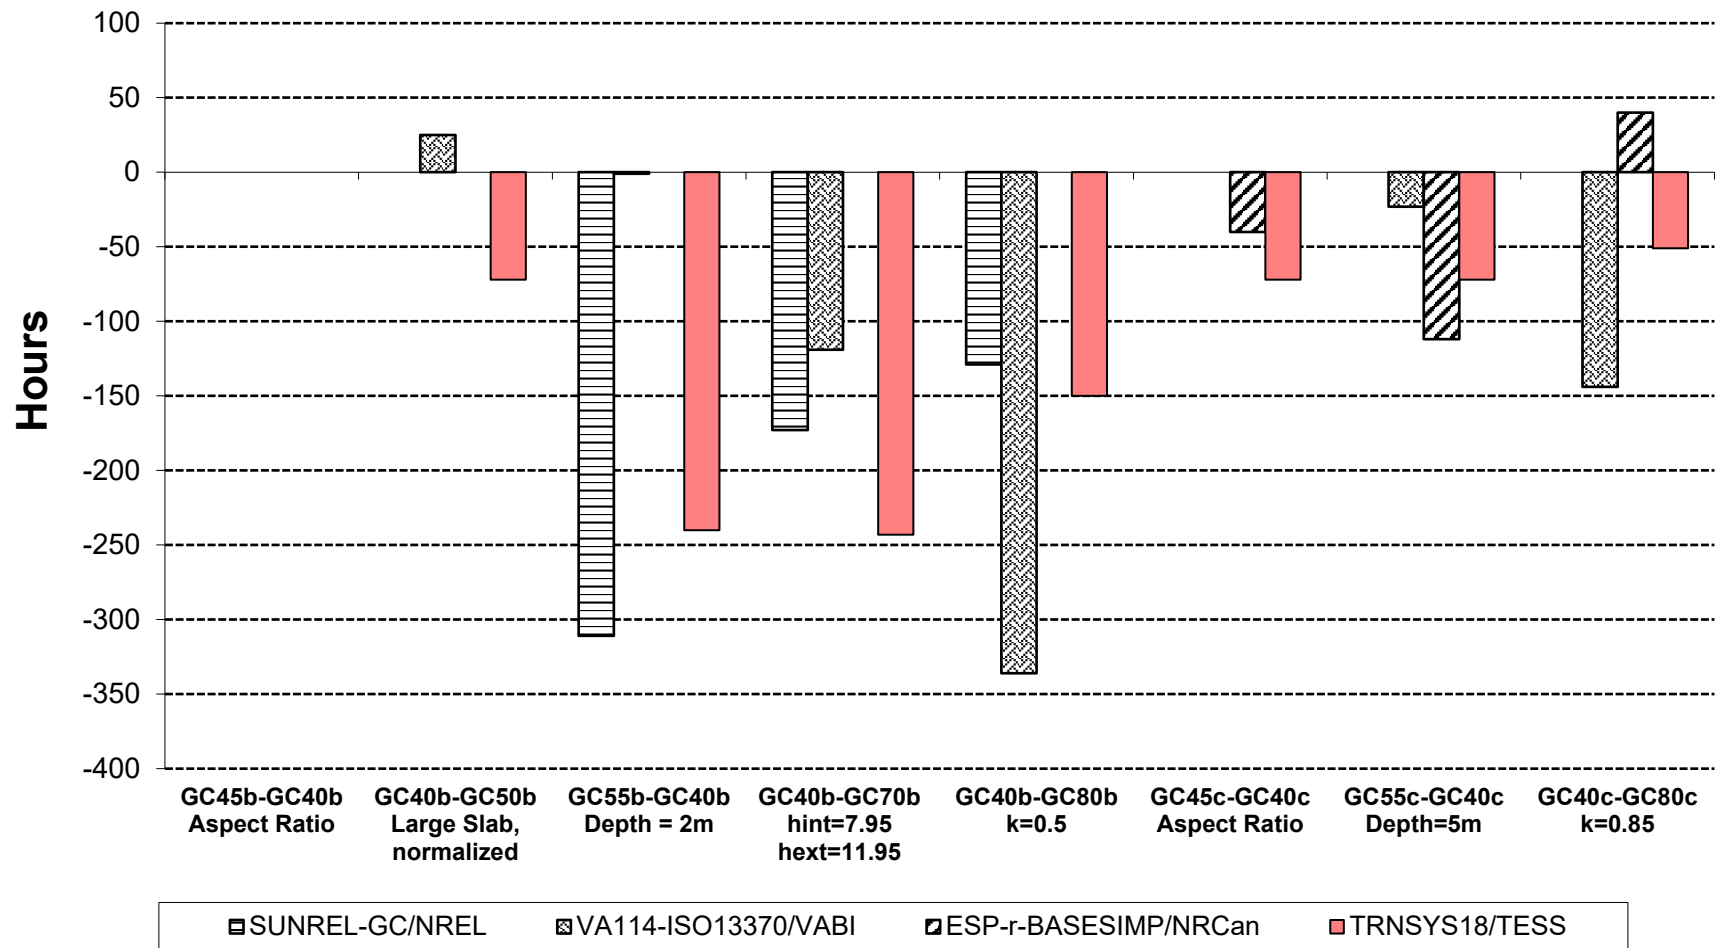

**Figure B8.2-26. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Steady-Periodic Annual Peak-Hour Floor Conduction**

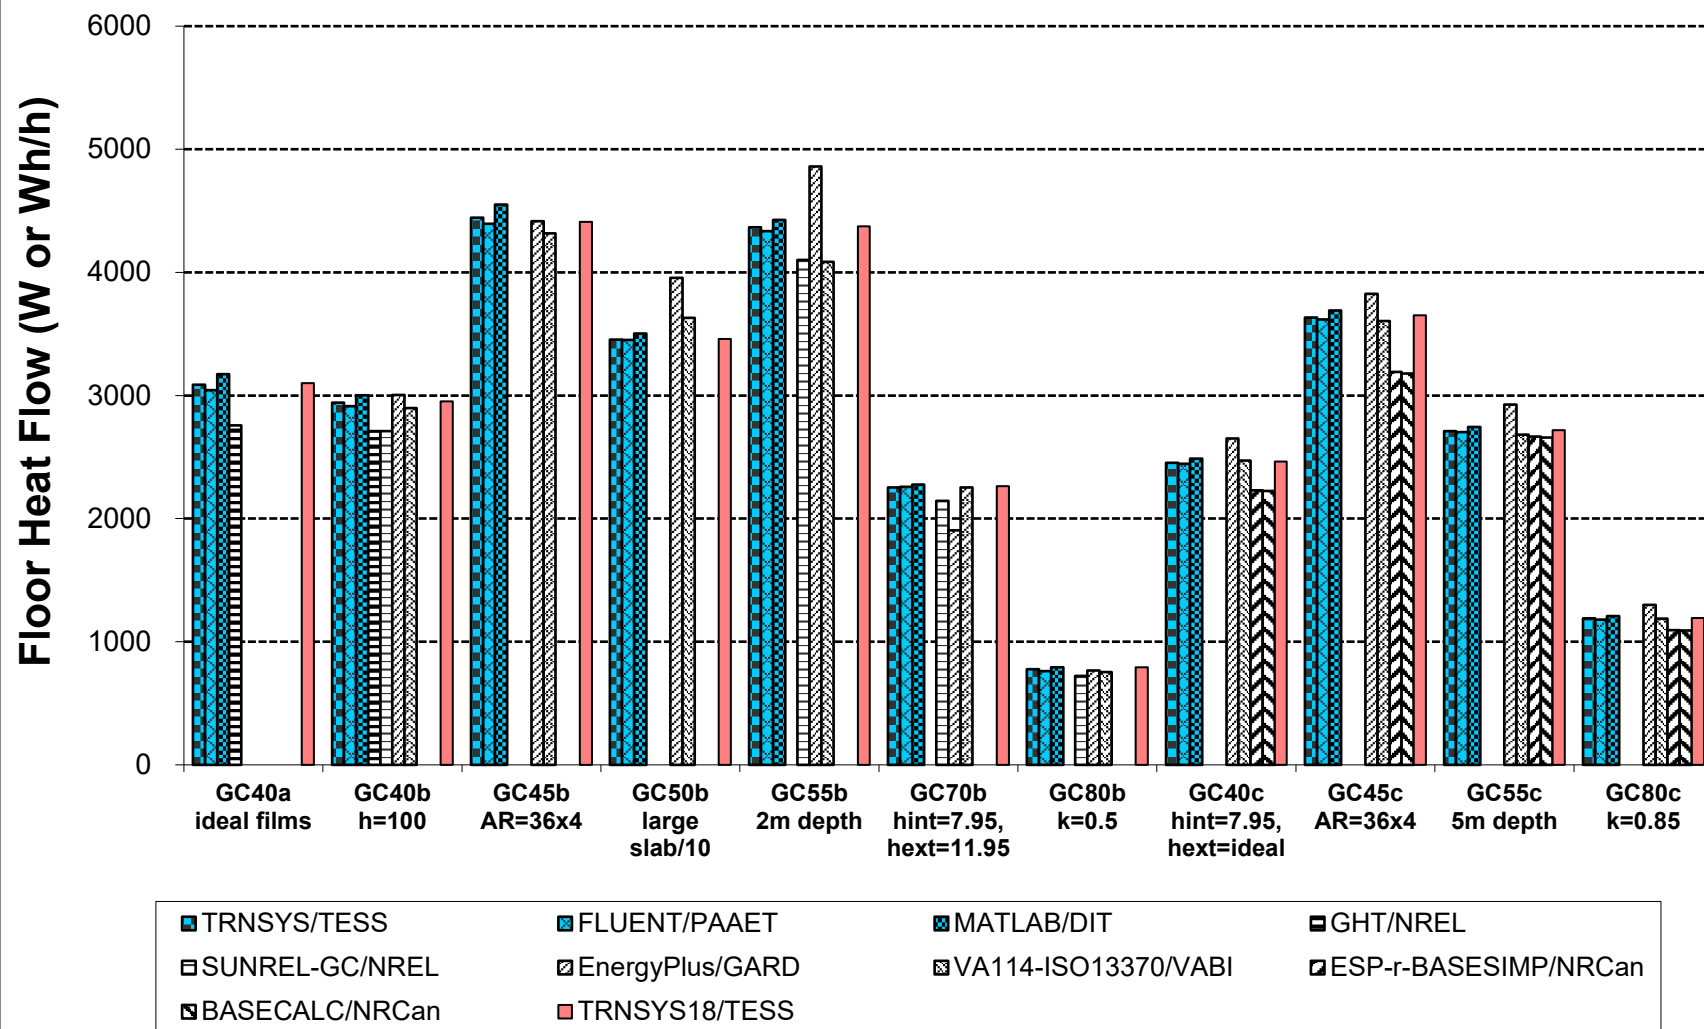


Figure B8.2-27. IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Annual Peak-Hour Floor Conduction Sensitivity


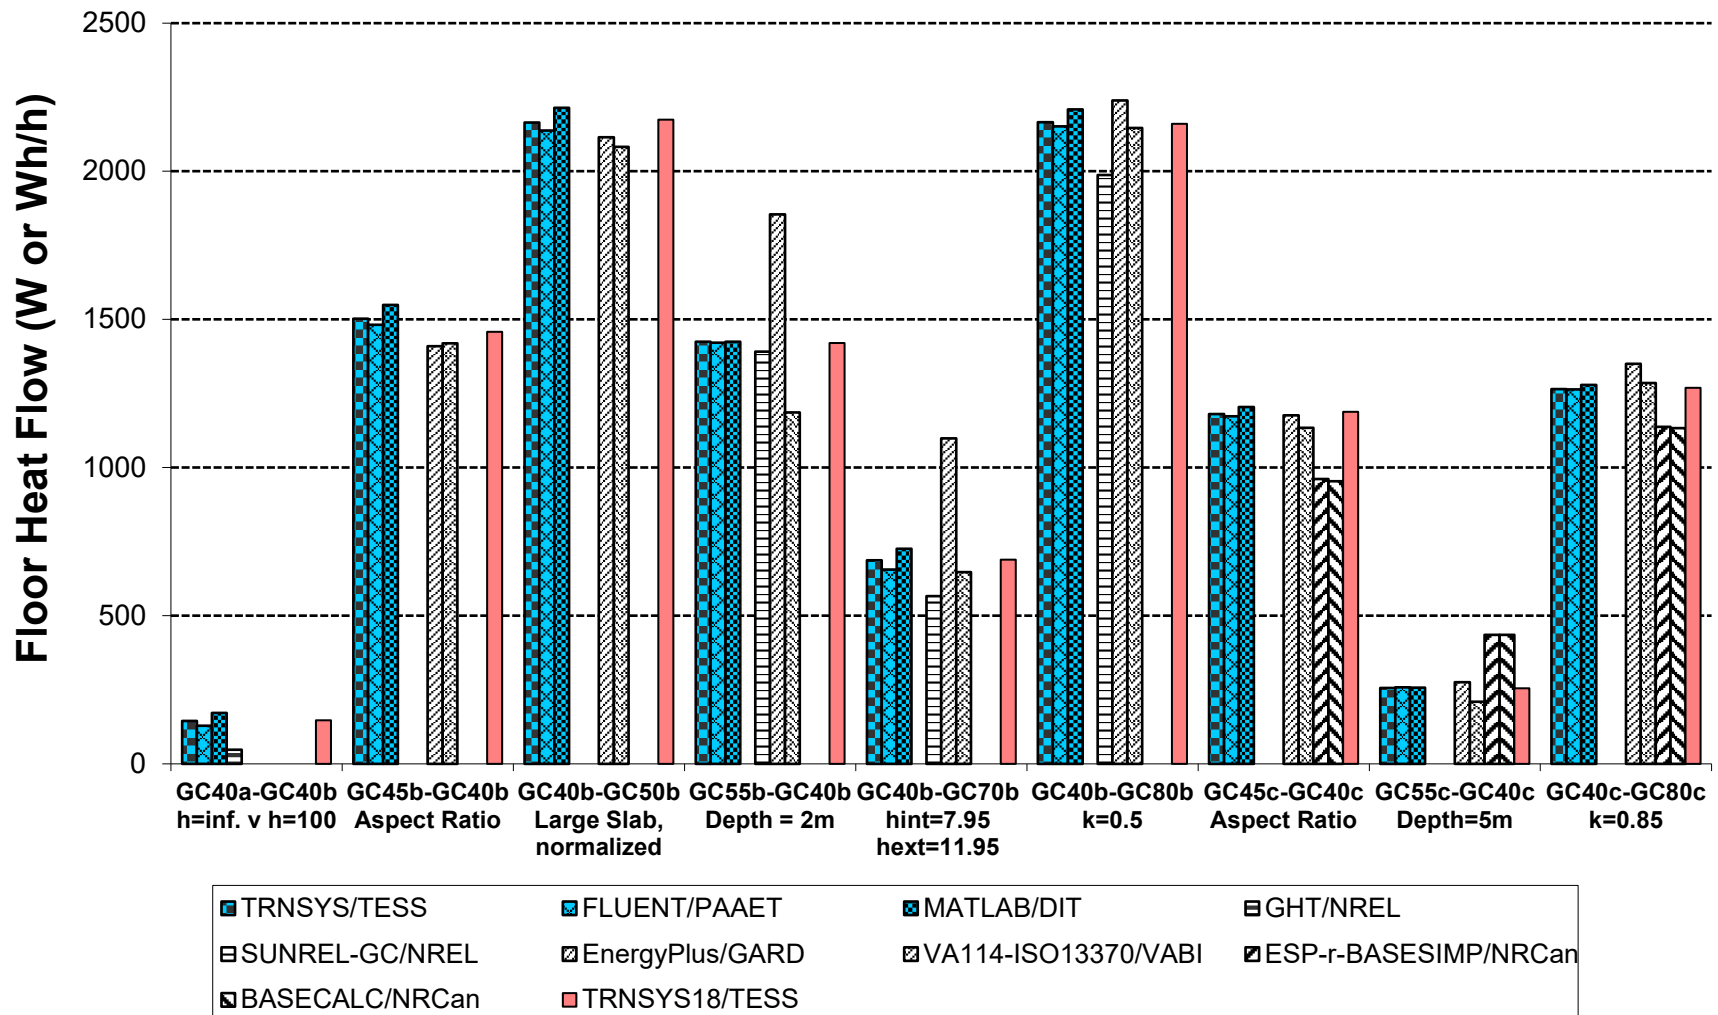


Figure B8.2-28. IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic Annual Peak-Hour Zone Heating Load

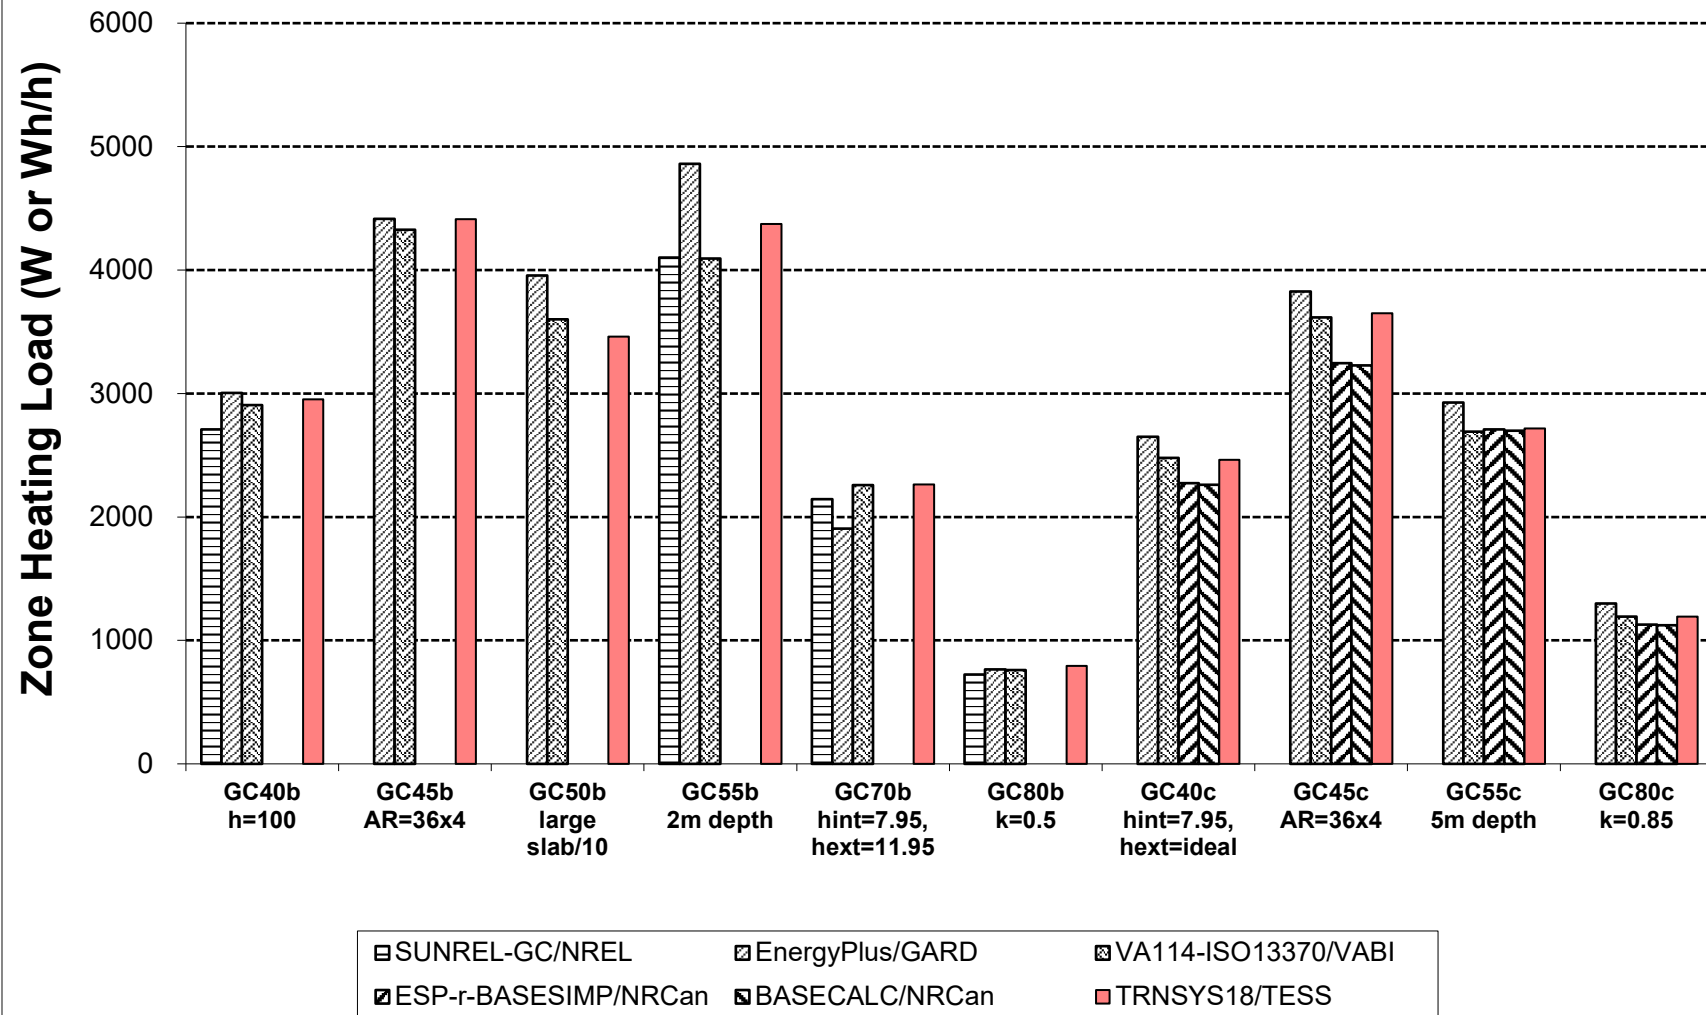

**Figure B8.2-29. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Steady-Periodic Annual Peak-Hour Zone Heating Load Sensitivity**


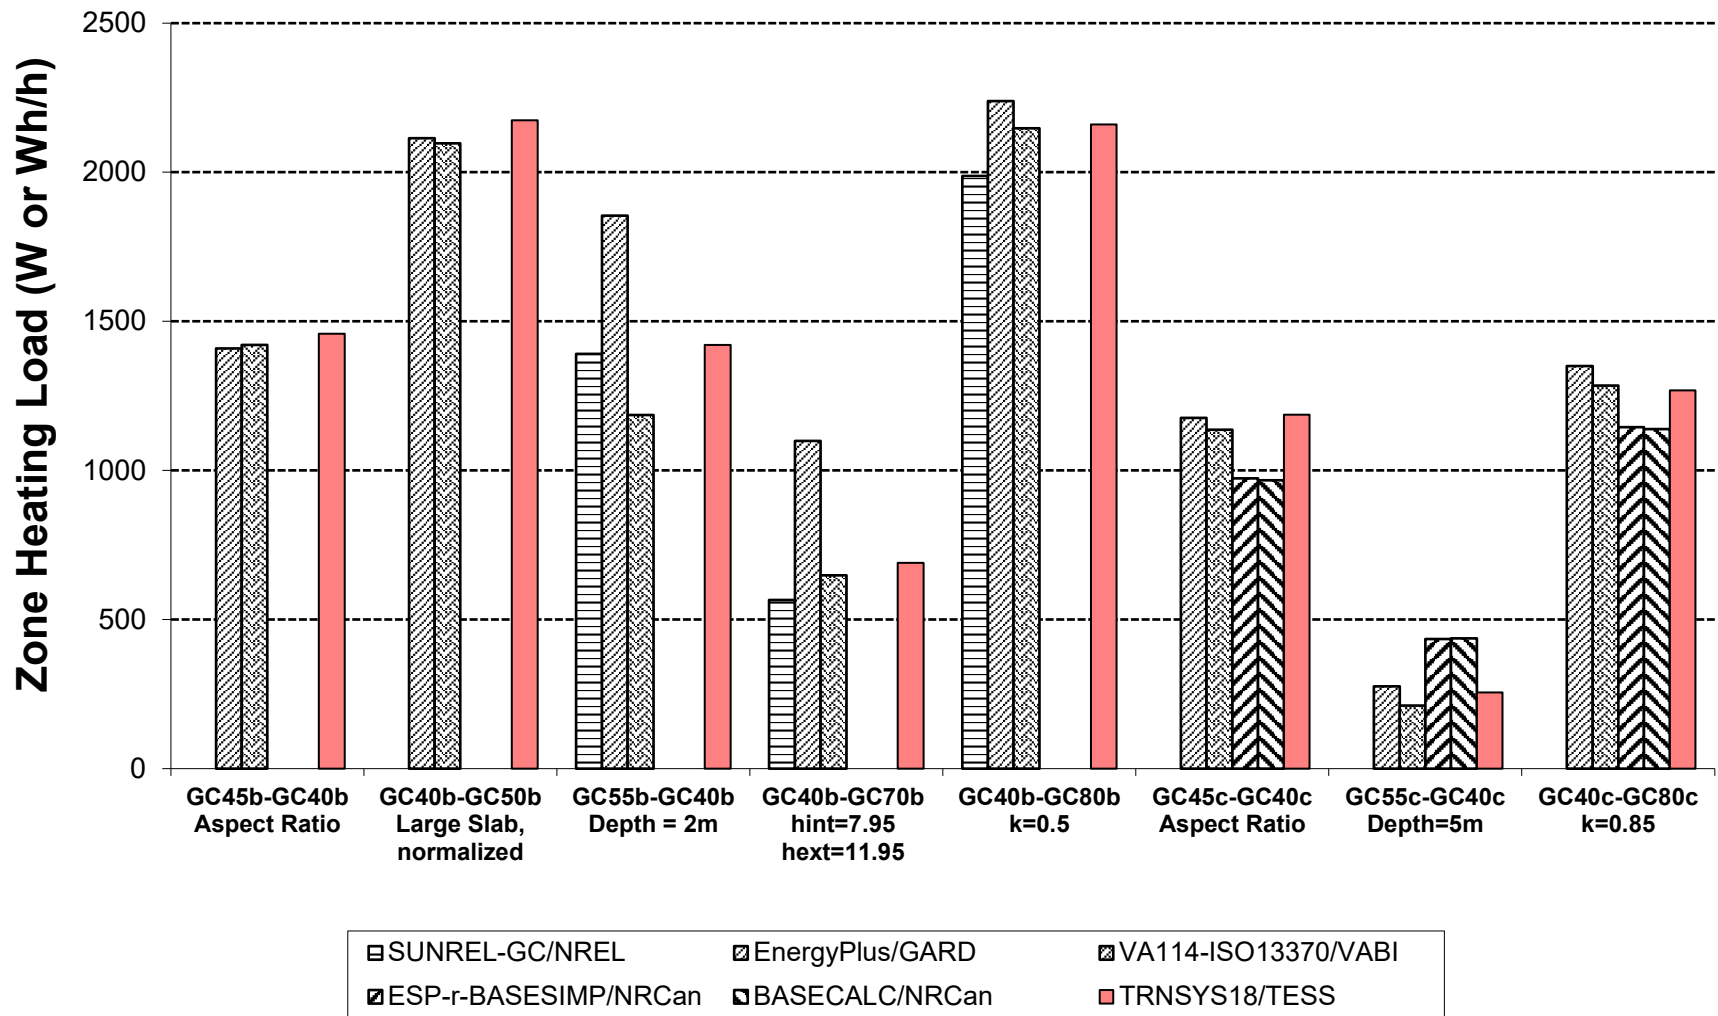


Figure B8.2-30. IEA BESTEST Ground Coupling: In-Depth Floor Slab Steady-Periodic (Peak Zone Heating Load) - (Peak Floor Conduction)



**Figure B8.2-31. IEA BESTEST Ground Coupling: In-Depth Floor Slab
Steady-Periodic Zone Temperature**

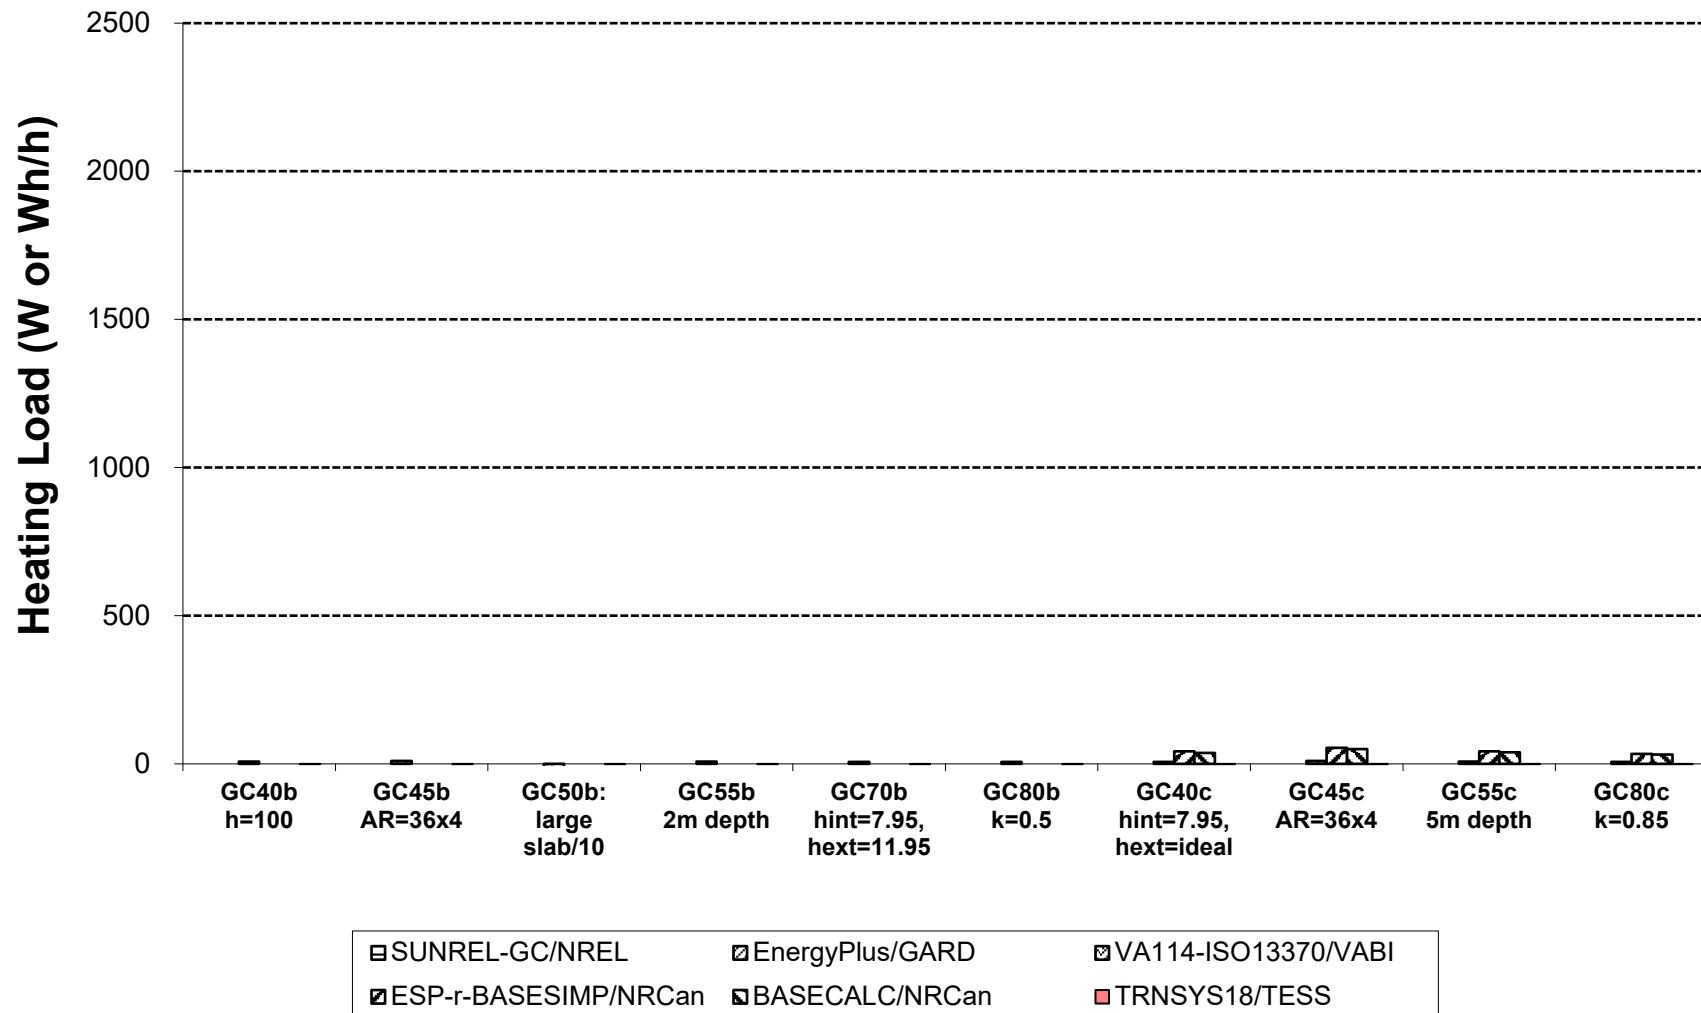