

ASHRAE Standard 140-2023

Test Results Comparison for

Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF

Results for TRNSYS18.06.0002
(TRNSYS18)

vs.

Example Results

Prepared By
Thermal Energy System Specialists, LLC
(TESS)

Results Developed
19-Aug-2024

ASHRAE Standard 140-2023

Computer Programs, Program Authors, and Producers of Example Results for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF

The programs used to generate the example results for Section 7 are described in Table B11-1. Under the "Computer Program" column, the first entry in each cell is the proper program name and version number. The entries in parentheses are the abbreviations for the programs used in the tables and charts of this workbook.

The second column ("Authoring Organization") indicates the national research facility, university, or industry organization with expertise in building science that wrote the simulation software.

The third column ("Example Results Produced By") indicates the national research facility, university, or industry organization with expertise in building science that performed the simulations. Most of the organizations that performed simulations are members of the development team for the simulation model that they ran.

See Standard 140, Annex B11 for further details.

TABLE B11-1

Computer Programs, Program Authors, and Producers of Example Results

Computer Program (Abbrev.)	Authoring Organization	Example Results Produced by
BSIMAC 9, Version 9.0.74 (BSIMAC)	Alec Johannsen Consulting Engineers, South Africa	Alec Johannsen Consulting Engineers, South Africa
California Simulation Engine, Version 0.861.1 (CSE)	J.R. Barnaby/C.S. Barnaby/Big Ladder Software LLC/Wrightsoft Corp., United States	Big Ladder Software LLC, United States
DeST 2.0, Version 20190401 (DeST)	Tsinghua University, China	Southeast University, China Tsinghua University, China
EnergyPlus, Version 9.0.1 (EnergyPlus)	U.S. Department of Energy, Building Technologies Office, United States	GARD Analytics, Inc., United States
ESP-r, Version 13.3 (ESP-r)	University of Strathclyde, United Kingdom	University of Strathclyde, United Kingdom
TRNSYS, Version 18.01.0001 (TRNSYS)	Transsolar Energietechnik GmbH, Germany; Thermal Energy System Specialists, United States	Transsolar Energietechnik GmbH, Germany
TRNSYS, Versions 17.02.0005 and 18.00.0017 (N/A)	Transsolar Energietechnik GmbH, Germany; Thermal Energy System Specialists, United States	Ecole Polytechnique Montréal, Canada ^{a,b}

^a Ecole Polytechnique and GARD also worked on simulations for developing alternative constant interior and exterior surface coefficients, applying TRNSYS and EnergyPlus, respectively.

^b Also checking input files versus the Transsolar participant's files and vice versa.

Note: Results for "TestSpec-Alt" are shown in Table B8-16 and in Figures B8-6, B8-H10, and B8-H11; contents of tables and figures are further described in sheet tabs labeled "Table List" and "Figure List". "TestSpec-Alt" results are alternative values resulting from optional alternative inputs for sky temperature provided in the test specification (see Section 7.2.1.1.1.2 and Annex A1, Section A1.1.1.2).

**ASHRAE Standard 140-2023 Section 7 - Building Thermal Envelope and Fabric Load Tests
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024**

List of Tables

<i>Table</i>	<i>Description</i>	<i>Sheet Tab</i>	<i>Cell Range</i>
B8-1	Annual Heating Loads	Tables 1	B7 - N57
B8-2	Annual Sensible Cooling Loads		B59 - N109
B8-3	Annual Hourly Integrated Peak Heating Loads	Tables 2	B7 - AI57
B8-4	Annual Hourly Integrated Peak Sensible Cooling Loads		B59 - AI109
B8-5	Free-Float Temperature Output		B111 - AI145
B8-6	Low Mass Basic Sensitivity Tests	Tables 3	B7 - N58
B8-7	High Mass Basic Sensitivity Tests		B61 - N112
B8-8	Low Mass In-Depth (Cases 195 thru 320) Sensitivity Tests	Tables 4	B7 - N76
B8-9	Low Mass In-Depth (Cases 395 thru 470) Sensitivity Tests	Tables 5	B7 - N64
B8-10	High Mass Basic and In-Depth Sensitivity Tests		B67 - N122
B8-11	Annual Transmissivity Coefficient of Windows	Tables 6	B7 - N16
B8-12	Annual Shading Coefficient of Window Shading Devices: Overhangs & Fins		B18 - N25
B8-13	Case 600 Annual Incident Solar Radiation (kWh/m ²)		B27 - N36
B8-14	Case 600 Annual Transmitted Solar Radiation – Unshaded (kWh/m ²)		B38 - N46
B8-15	Case 600 Annual Transmitted Solar Radiation – Shaded (kWh/m ²)		B48 - N54
B8-16	Sky Temperature Output, Case 600	Tables 7	B7 - AM15
B8-M1	Monthly Heating Loads	Tables M1	B7 - N36
B8-M2	Monthly Sensible Cooling Loads		B38 - N67
B8-M3	Monthly Hourly Integrated Peak Heating Loads	Tables M2	B7 - AB36
B8-M4	Monthly Hourly Integrated Peak Sensible Cooling Loads		B38 - AB67
B8-M5	Monthly Load 600-900 Sensitivity Tests	Tables M3	B7 - N68

**ASHRAE Standard 140-2023 Section 7 - Building Thermal Envelope and Fabric Load Tests
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024**

List of Figures

Figure	Title	Sheet Tab
B8-1	Annual Incident Solar Radiation	Fig B8-1 Ann Incident Solar
B8-2	Annual Transmitted Solar Radiation Unshaded	Fig B8-2 Ann SolRad Unshaded
B8-3	Annual Transmitted Solar Radiation Shaded	Fig B8-3 Ann SolRad Shaded
B8-4	Annual Transmissivity Coefficient of Windows (Unshaded Transmitted)/(Incident Solar Radiation)	Fig B8-4 Trans Coeff
B8-5	Annual Overhang and Fin Shading Coefficients (1-(Shaded)/(Unshaded)) Transmitted Solar Radiation	Fig B8-5 OH&Fin Shade Coeff
B8-6	Average, Minimum and Maximum Sky Temperature, Case 600	Fig B8-6 Sky Temp
B8-7	Basic: Low Mass Annual Heating	Fig B8-7 Lomass Ann Heat
B8-8	Basic: Low Mass Annual Sensible Cooling	Fig B8-8 Lomass Ann Cool
B8-9	Basic: Low Mass Peak Heating	Fig B8-9 Lomass Peak Heat
B8-10	Basic: Low Mass Peak Sensible Cooling	Fig B8-10 Lomass Peak Cool
B8-11	Basic: High Mass Annual Heating	Fig B8-11 Himass Ann Heat
B8-12	Basic: High Mass Annual Sensible Cooling	Fig B8-12 Himass Ann Cool
B8-13	Basic: High Mass Peak Heating	Fig B8-13 Himass Peak Heat
B8-14	Basic: High Mass Peak Sensible Cooling	Fig B8-14 Himass Peak Cool
B8-15	Basic and In-Depth: South Window (Delta), Annual Heating and Sensible Cooling	Fig B8-15 Delta-S Win-Ann
B8-16	Basic and In-Depth: South Window (Delta), Peak Heating and Sensible Cooling	Fig B8-16 Delta-S Win-Peak
B8-17	Basic: Window Shading and Orientation (Delta), Annual Heating and Sensible Cooling	Fig B8-17 Delta-ShadeOrient-Load
B8-18	Basic: Window Shading and Orientation (Delta), Peak Heating and Sensible Cooling	Fig B8-18 Delta-ShadeOrient-Peak
B8-19	Basic: Thermostat Setback, Vent Cooling, and Sunspace (Delta), Annual Heating and Sensible Cooling	Fig B8-19 Delta-640650960-Load
B8-20	Basic: Thermostat Setback, Vent Cooling, and Sunspace (Delta), Peak Heating and Sensible Cooling	Fig B8-20 Delta-640650960-Peak
B8-21	Basic and In-Depth: Mass Effect (Delta), Annual Heating and Sensible Cooling	Fig B8-21 Delta-Mass Effect-Ann
B8-22	Basic and In-Depth: Mass Effect (Delta), Peak Heating and Sensible Cooling	Fig B8-22 Delta-Mass Effect-Pk
B8-23	Basic: Cases 660 to 695 and 980 to 995 Annual Heating	Fig B8-23 660+ Ann Heat
B8-24	Basic: Cases 660 to 695 and 980 to 995 Annual Cooling	Fig B8-24 660+ Ann Cool
B8-25	Basic: Cases 660 to 695 and 980 to 995 Peak Heating	Fig B8-25 660+ Peak Heat
B8-26	Basic: Cases 660 to 695 and 980 to 995 Peak Cooling	Fig B8-26 660+ Peak Cool
B8-27	Basic: Window Types (Delta), Annual Heating and Sensible Cooling	Fig B8-27 Delta-Windows-Load
B8-28	Basic: Window Types (Delta), Peak Heating and Sensible Cooling	Fig B8-28 Delta-Windows-Peak
B8-29	Basic: Insulation (Delta), Annual Heating and Sensible Cooling	Fig B8-29 Delta-Insul-Load
B8-30	Basic: Insulation (Delta), Peak Heating and Sensible Cooling	Fig B8-30 Delta-Insul-Peak
B8-31	Basic: Insulation, Mass Effect (Delta), Annual Heating and Sensible Cooling	Fig B8-31 Del-Mass-Ins-Load
B8-32	Basic: Insulation, Mass Effect (Delta), Peak Heating and Sensible Cooling	Fig B8-32 Del-Mass-Ins-Peak
B8-33	Basic: Average Hourly Annual Temperature Free-Float Cases	Fig B8-33 FF Average Temp
B8-34	Basic: Maximum Hourly Annual Temperature Free-Float Cases	Fig B8-34 FF Maximum Temp
B8-35	Basic: Minimum Hourly Annual Temperature Free-Float Cases	Fig B8-35 FF Minimum Temp

**ASHRAE Standard 140-2023 Section 7 - Building Thermal Envelope and Fabric Load Tests
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024**

List of Figures

Figure	Title	Sheet Tab
B8-36	In-Depth: Low Mass Cases 195 to 250 Annual Heating	Fig B8-36 195to250 Ann Heat
B8-37	In-Depth: Low Mass Cases 195 to 250 Annual Sensible Cooling	Fig B8-37 195to250 Ann Cool
B8-38	In-Depth: Low Mass Cases 195 to 250 Peak Heating	Fig B8-38 195to250 Peak Heat
B8-39	In-Depth: Low Mass Cases 195 to 250 Peak Sensible Cooling	Fig B8-39 195to250 Peak Cool
B8-40	In-Depth: Low Mass Cases 270 to 320 Annual Heating	Fig B8-40 270to320 Ann Heat
B8-41	In-Depth: Low Mass Cases 270 to 320 Annual Sensible Cooling	Fig B8-41 270to320 Ann Cool
B8-42	In-Depth: Low Mass Cases 270 to 320 Peak Heating	Fig B8-42 270to320 Peak Heat
B8-43	In-Depth: Low Mass Cases 270 to 320 Peak Sensible Cooling	Fig B8-43 270to320 Peak Cool
B8-44	In-Depth: Cases 195 to 220 (Delta) Annual Heating and Sensible Cooling	Fig B8-44 Delta 195to220 Load
B8-45	In-Depth: Cases 195 to 220 (Delta) Peak Heating and Sensible Cooling	Fig B8-45 Delta 195to220 Peak
B8-46	In-Depth: Cases 220 to 270 (Delta) Annual Heating and Sensible Cooling	Fig B8-46 Delta 220to270 Load
B8-47	In-Depth: Cases 220 to 270 (Delta) Peak Heating and Sensible Cooling	Fig B8-47 Delta 220to270 Peak
B8-48	In-Depth: Cases 270 to 320 (Delta) Annual Heating and Sensible Cooling	Fig B8-48 Delta 270to320 Load
B8-49	In-Depth: Cases 270 to 320 (Delta) Peak Sensible Cooling	Fig B8-49 Delta 270to320 Peak
B8-50	In-Depth: Cases 395 to 440, 800, 810 Annual Heating	Fig B8-50 395to440,8n0 Ann Heat
B8-51	In-Depth: Cases 395 to 440, 800, 810 Annual Sensible Cooling	Fig B8-51 395to440,8n0 Ann Cool
B8-52	In-Depth: Cases 395 to 440, 800, 810 Peak Heating	Fig B8-52 395to440,8n0 Pk Heat
B8-53	In-Depth: Cases 395 to 440, 800, 810 Peak Sensible Cooling	Fig B8-53 395to440,8n0 Pk Cool
B8-54	In-Depth: Cases 395 to 600, 810 to 900 (Delta) Annual Heating and Sensible Cooling	Fig B8-54 Del 395-600,810,900 Ld
B8-55	In-Depth: Cases 395 to 600, 810 to 900 (Delta) Peak Heating and Sensible Cooling	Fig B8-55 Del 395-600,810,900 Pk
B8-56	In-Depth: Surface Heat Transfer Cases 600, 450, 460, 470 Annual Heating and Sensible Cooling	Fig B8-56 SurfCoefs-Load
B8-57	In-Depth: Surface Heat Transfer Cases 600, 450, 460, 470 Peak Heating and Sensible Cooling	Fig B8-57 SurfCoefs-Peak
B8-58	In-Depth: Surface Heat Transfer Cases 450 to 600 (Delta) Annual Heating and Sensible Cooling	Fig B8-58 SurfHT Delta-Load
B8-59	In-Depth: Surface Heat Transfer Cases 450 to 600 (Delta) Peak Heating and Sensible Cooling	Fig B8-59 SurfHT Delta-Peak

**ASHRAE Standard 140-2023 Section 7 - Building Thermal Envelope and Fabric Load Tests
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024**

List of Figures

Figure	Title	Sheet Tab
B8-M1	Monthly Heating, Case 600	Fig B8-M1 MthlyHtg-600
B8-M2	Monthly Sensible Cooling, Case 600	Fig B8-M2 MthlyCtg-600
B8-M3	Monthly Peak Heating, Case 600	Fig B8-M3 MthlyPkHtg-600
B8-M4	Monthly Peak Sensible Cooling, Case 600	Fig B8-M4 MthlyPkClg-600
B8-M5	Monthly Heating, Case 900	Fig B8-M5 MthlyHtg-900
B8-M6	Monthly Sensible Cooling, Case 900	Fig B8-M6 MthlyCtg-900
B8-M7	Monthly Peak Heating, Case 900	Fig B8-M7 MthlyPkHtg-900
B8-M8	Monthly Peak Sensible Cooling, Case 900	Fig B8-M8 MthlyPkClg-900
B8-M9	Monthly Heating Sensitivity (Delta), Case 600-900	Fig B8-M9 Del-MthlyHtg 600-900
B8-M10	Monthly Cooling Sensitivity (Delta), Case 600-900	Fig B8-M10 Del-MthlyCtg 600-900
B8-M11	Monthly Peak Heating Sensitivity (Delta), Case 600-900	Fig B8-M11 Del-MthlyPkH 600-900
B8-M12	Monthly Peak Cooling Sensitivity (Delta), Case 600-900	Fig B8-M12 Del-MthlyPkC 600-900
B8-H1	Case 900FF Annual Hourly Temperature Frequency	Fig B8-H1 Hrly-Temp Freq
B8-H2	Case 600 Cloudy & Clear Day Hourly Incident Solar Horizontal (Upward) Facing Surface	Fig B8-H2 Hrly-IncSol-Horz
B8-H3	Case 600 Cloudy & Clear Day Hourly Incident Solar South Facing Surface	Fig B8-H3 Hrly-IncidentSol-S
B8-H4	Case 600 Cloudy & Clear Day Hourly Incident Solar West Facing Surface	Fig B8-H4 Hrly-IncidentSol-W
B8-H5	Cases 600, 660, 670 Hourly Transmitted Solar, Clear/Cold Day (Feb 1) Double-Pane, Low-E, Single-Pane Windows	Fig B8-H5 Hrly-TransSol-Feb1
B8-H6	Case 600 Hourly Transmitted Solar, Cloudy Day (May 4) Double-Pane Windows	Fig B8-H6 Hrly-Trans-May4-600
B8-H7	Cases 660,670 Hourly Transmitted Solar, Cloudy Day (May 4) Low-E and Single-Pane Windows	Fig B8-H7 Hrly-Trans-May4-6670
B8-H8	Case 600 Hourly Transmitted Solar, Clear/Hot Day (Jul 14) Double-Pane Windows	Fig B8-H8 Hrly-Trans-Jul14-600
B8-H9	Cases 660, 670 Hourly Transmitted Solar, Clear/Hot Day (Jul 14) Low-E and Single-Pane Windows	Fig B8-H9 Hrl-Trans-Jul14-6670
B8-H10	Hourly Sky Temperatures, Case 600: Clear/Cold, Cloudy Days	Fig B8-H10 Hrly-Tsky-ClearCloud
B8-H11	Hourly Sky Temperatures, Case 600: Clear/Cold, Clear/Hot Days	Fig B8-H11 Hrly-Tsky-ColdHot
B8-H12	Hourly Free-Float Temperatures, Clear Cold Day (Feb 1), Cases 600FF and 900FF	Fig B8-H12 Hrly-FF Temp-ColdDay
B8-H13	Hourly Free-Float Temperatures, Clear Hot Day (Jul 14), Cases 650FF and 950FF	Fig B8-H13 Hrly-FF Temp-HotDay
B8-H14	Hourly Free-Float Temperatures, Clear Cold Day (Feb 1), Cases 680FF and 980FF	Fig B8-H14 Hr-6980FF T-ColdDay

**ASHRAE Standard 140-2023 Section 7 - Building Thermal Envelope and Fabric Load Tests
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024**

List of Figures

Figure	Title	Sheet Tab
B8-H15	Hourly Loads: Clear Cold Day, Case 600 (Low Mass, Double-Clear Window) Heating (+), Sensible Cooling (-)	Fig B8-H15 Hrly-600Loads-Cold
B8-H16	Hourly Loads: Clear Hot Day, Case 600 (Low Mass, Double-Clear Window) Heating (+), Sensible Cooling (-)	Fig B8-H16 Hrly-600Loads-Hot
B8-H17	Hourly Loads: Clear Cold Day, Case 640 (Low Mass, Night Setback) Heating (+), Sensible Cooling (-)	Fig B8-H17 Hrly-640Loads-Cold
B8-H18	Hourly Conditioned Zone Temperatures, Clear Cold Day, Case 640 Heating (+), Sensible Cooling (-)	Fig B8-H18 Hrly-640Tzone-Cold
B8-H19	Hourly Loads: Clear Cold Day, Case 940 (High Mass, Night Setback) Heating (+), Sensible Cooling (-)	Fig B8-H19 Hrly-940Loads-Cold
B8-H20	Hourly Conditioned Zone Temperatures, Clear Cold Day, Case 940 Heating (+), Sensible Cooling (-)	Fig B8-H20 Hrly-940Tzone-Cold
B8-H21	Hourly Loads: Clear Cold Day, Case 660 (Low-E Window) Heating (+), Sensible Cooling (-)	Fig B8-H21 Hrly-660Loads-Cold
B8-H22	Hourly Loads: Clear Hot Day, Case 660 (Low-E Window) Heating (+), Sensible Cooling (-)	Fig B8-H22 Hrly-660Loads-Hot
B8-H23	Hourly Loads: Clear Cold Day, Case 670 (Single-Pane Window) Heating (+), Sensible Cooling (-)	Fig B8-H23 Hrly-670Loads-Cold
B8-H24	Hourly Loads: Clear Hot Day, Case 670 (Single-Pane Window) Heating (+), Sensible Cooling (-)	Fig B8-H24 Hrly-670Loads-Hot
B8-H25	Hourly Loads: Clear Cold Day, Case 680 (Insulation) Heating (+), Sensible Cooling (-)	Fig B8-H25 Hrly-680Loads-Cold
B8-H26	Hourly Loads: Clear Hot Day, Case 680 (Insulation) Heating (+), Sensible Cooling (-)	Fig B8-H26 Hrly-680Loads-Hot
B8-H27	Hourly Loads: Clear Cold Day, Case 685 (20/20 Tstat) Heating (+), Sensible Cooling (-)	Fig B8-H27 Hrly-685Loads-Cold
B8-H28	Hourly Loads: Clear Hot Day, Case 685 (20/20 Tstat) Heating (+), Sensible Cooling (-)	Fig B8-H28 Hrly-685Loads-Hot
B8-H29	Hourly Loads: Clear Cold Day, Case 695 (20/20, Insulation) Heating (+), Sensible Cooling (-)	Fig B8-H29 Hrly-695Loads-Cold
B8-H30	Hourly Loads: Clear Hot Day, Case 695 (20/20, Insulation) Heating (+), Sensible Cooling (-)	Fig B8-H30 Hrly-695Loads-Hot
B8-H31	Hourly Loads: Clear Cold Day, Case 900 (High Mass) Heating (+), Sensible Cooling (-)	Fig B8-H31 Hrly-900Loads-Cold
B8-H32	Hourly Loads: Clear Hot Day, Case 900 (High Mass) Heating (+), Sensible Cooling (-)	Fig B8-H32 Hrly-900Loads-Hot
B8-H33	Hourly Loads: Clear Cold Day, Case 980 (High Mass, Insulation) Heating (+), Sensible Cooling (-)	Fig B8-H33 Hrly-980Loads-Cold
B8-H34	Hourly Loads: Clear Hot Day, Case 900 (High Mass, Insulation) Heating (+), Sensible Cooling (-)	Fig B8-H34 Hrly-980Loads-Hot
B8-H35	Hourly Loads: Clear Cold Day, Case 985 (High Mass, 20/20 Tstat) Heating (+), Sensible Cooling (-)	Fig B8-H35 Hrly-985Loads-Cold
B8-H36	Hourly Loads: Clear Hot Day, Case 985 (High Mass, 20/20 Tstat) Heating (+), Sensible Cooling (-)	Fig B8-H36 Hrly-985Loads-Hot
B8-H37	Hourly Loads: Clear Cold Day, Case 995 (High Mass, 20/20, Insulation) Heating (+), Sensible Cooling (-)	Fig B8-H37 Hrly-995Loads-Cold
B8-H38	Hourly Loads: Clear Hot Day, Case 995 (High Mass, 20/20, Insulation) Heating (+), Sensible Cooling (-)	Fig B8-H38 Hrly-995Loads-Hot

**ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results**

By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

Note: The statistics in the tables below are based on the listed example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8-1. Annual Heating Loads (MWh)

Simulation Model: Case	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Statistics for Example Results				TRNSYS18
							Min	Max	Mean	(Max-Min)/ Mean** (%)	
600 Base Case, South Windows	4.050	3.993	4.047	4.324	4.362	4.504	3.993	4.504	4.213	12.1%	4.500
610 S. Windows + Overhang	4.163	4.066	4.144	4.375	4.527	4.592	4.066	4.592	4.311	12.2%	4.589
620 East & West Windows	4.370	4.094	4.297	4.485	4.514	4.719	4.094	4.719	4.413	14.2%	4.715
630 E&W Windows + Overhang & Fins	4.923	4.356	4.677	4.784	5.051	5.139	4.356	5.139	4.821	16.2%	5.137
640 Case 600 with Htg Temp. Setback	2.682	2.403	2.619	2.662	2.654	2.653	2.403	2.682	2.612	10.7%	2.648
650 Case 600 with Night Ventilation	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	----	0.000
660 Low-E Windows	3.574	3.602	3.821	3.707	3.787	3.790	3.574	3.821	3.713	6.7%	3.786
670 Single-Pane Windows	5.484	5.300	5.573	5.616	5.975	6.140	5.300	6.140	5.681	14.8%	6.136
680 Case 600 with Increased Insulation	2.219	1.786	1.732	2.180	2.132	2.286	1.732	2.286	2.056	27.0%	2.284
685 Case 600 with "20/20" Thermostat	4.532	4.574	4.646	4.877	4.904	5.042	4.532	5.042	4.763	10.7%	5.038
695 Case 685 with Increased Insulation	2.709	2.415	2.385	2.802	2.732	2.892	2.385	2.892	2.656	19.1%	2.889
900 South Windows	1.726	1.379	1.591	1.664	1.585	1.814	1.379	1.814	1.626	26.8%	1.803
910 S. Windows + Overhang	2.163	1.648	1.860	1.956	2.067	2.132	1.648	2.163	1.971	26.1%	2.127
920 East & West Windows	3.500	2.956	3.259	3.337	3.300	3.607	2.956	3.607	3.326	19.6%	3.589
930 E&W Windows + Overhang & Fins	4.270	3.524	3.933	3.994	4.278	4.384	3.524	4.384	4.064	21.2%	4.369
940 Case 900 with Htg Temp. Setback	1.389	0.863	1.149	1.067	1.015	1.169	0.863	1.389	1.109	47.4%	1.157
950 Case 900 with Night Ventilation	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	----	0.000
960 Sunspace		2.522	2.771	2.689	2.624	2.860	2.522	2.860	2.693	12.5%	2.850
980 Case 900 with Increased Insulation	0.720	0.246	0.266	0.411	0.351	0.450	0.246	0.720	0.407	116.4%	0.450
985 Case 900 with "20/20" Thermostat	2.801	2.120	2.279	2.369	2.283	2.536	2.120	2.801	2.398	28.4%	2.526
995 Case 985 with Increased Insulation	1.330	0.755	0.770	1.006	0.905	1.077	0.755	1.330	0.974	59.0%	1.076
195 Solid Conduction	4.217	3.990	4.157	4.070	3.951	4.094	3.951	4.217	4.080	6.5%	4.091
200 Surface Convection (Int & Ext IR="off")	5.041	4.813	5.226	5.105	4.920	5.143	4.813	5.226	5.042	8.2%	5.156
210 Infrared Radiation (Int IR="off", Ext IR="on")	5.627	5.966	6.531	6.047	6.317	6.429	5.627	6.531	6.153	14.7%	6.449
215 Infrared Radiation (Int IR="on", Ext IR="off")	5.652	5.307	5.697	5.405	5.181	5.443	5.181	5.697	5.448	9.5%	5.463
220 In-Depth Base Case	6.377	6.666	7.178	6.455	6.726	6.868	6.377	7.178	6.712	11.9%	6.899
230 Infiltration	9.851	9.812	10.417	9.930	9.939	10.234	9.812	10.417	10.031	6.0%	10.265
240 Internal Gains	5.116	5.443	5.944	5.279	5.539	5.657	5.116	5.944	5.496	15.1%	5.688
250 Exterior Shortwave Absorptance	4.733	5.044	5.373	4.899	4.935	5.105	4.733	5.373	5.015	12.8%	5.126
270 South Solar Windows		4.346	4.273	4.385	4.576	4.631	4.273	4.631	4.442	8.1%	4.627
280 Cavity Albedo		4.525	4.619	4.570	4.738	4.870	4.525	4.870	4.664	7.4%	4.866
290 South Shading		4.424	4.381	4.424	4.745	4.725	4.381	4.745	4.540	8.0%	4.722
300 East/West Window		4.318	4.460	4.425	4.668	4.726	4.318	4.726	4.519	9.0%	4.722
310 East/West Shading		4.580	4.846	4.691	5.240	5.163	4.580	5.240	4.904	13.4%	5.161
320 Thermostat		3.677	3.599	3.771	3.970	4.031	3.599	4.031	3.810	11.3%	4.027
395 Low Mass Solid Conduction	4.565	4.855	5.145	4.641	4.866	4.908	4.565	5.145	4.830	12.0%	4.904
400 Low Mass High Cond. Wall Elements	5.906	6.536	7.047	6.348	6.610	6.769	5.906	7.047	6.536	17.5%	6.800
410 Low Mass Infiltration	7.630	8.045	8.661	8.080	8.212	8.445	7.630	8.661	8.179	12.6%	8.476
420 Low Mass Internal Gains	6.399	6.834	7.433	6.906	7.027	7.236	6.399	7.433	6.973	14.8%	7.268
430 Low Mass Ext. Shortwave Absorptance	5.171	5.454	5.954	5.620	5.545	5.851	5.171	5.954	5.599	14.0%	5.872
440 Low Mass Cavity Albedo		4.156	4.330	4.500	4.504	4.721	4.156	4.721	4.442	12.7%	4.717
450 Constant Interior and Exterior Surf Coeffs	3.743	3.990	3.375	3.962	3.850	3.871	3.375	3.990	3.799	16.2%	3.869
460 Constant Interior Surface Coefficients	3.828	4.056	3.873	4.194	4.263	4.290	3.828	4.290	4.084	11.3%	4.287
470 Constant Exterior Surface Coefficients	4.042	3.899	3.540	4.094	3.960	4.075	3.540	4.094	3.935	14.1%	4.072
800 High Mass High Cond. Wall Elements	5.141	4.906	5.403	5.116	4.980	5.369	4.906	5.403	5.152	9.7%	5.370
810 High Mass Cavity Albedo		2.038	2.454	2.342	2.185	2.610	2.038	2.610	2.326	24.6%	2.595

** ABS[(Max-Min) / (Mean of Example Simulation Results)]

**ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results**

By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

Note: The statistics in the tables below are based on the listed example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8-2. Annual Sensible Cooling Loads (MWh)

Simulation Model: Case	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Statistics for Example Results				TRNSYS18
							Min	Max	Mean	(Max-Min)/ Mean** (%)	
600 Base Case, South Windows	5.822	5.913	5.432	6.027	6.162	5.780	5.432	6.162	5.856	12.5%	5.779
610 S. Windows + Overhang	4.299	4.382	4.173	4.333	4.233	4.117	4.117	4.382	4.256	6.2%	4.105
620 East & West Windows	4.404	4.079	3.909	4.060	4.246	3.841	3.841	4.404	4.090	13.8%	3.839
630 E&W Windows + Overhang & Fins	3.074	3.020	2.787	2.836	2.595	2.573	2.573	3.074	2.814	17.8%	2.568
640 Case 600 with Htg Temp. Setback	5.804	5.644	5.237	5.763	5.893	5.477	5.237	5.893	5.636	11.6%	5.477
650 Case 600 with Night Ventilation	4.629	4.654	4.186	4.817	4.945	4.632	4.186	4.945	4.644	16.3%	4.632
660 Low-E Windows	3.014	3.340	3.260	3.232	3.219	2.966	2.966	3.340	3.172	11.8%	2.966
670 Single-Pane Windows	6.539	6.578	5.954	6.623	6.520	6.198	5.954	6.623	6.402	10.4%	6.198
680 Case 600 with Increased Insulation	5.938	6.430	5.932	6.444	6.529	6.310	5.932	6.529	6.264	9.5%	6.310
685 Case 600 with "20/20" Thermostat	9.130	8.859	8.238	9.119	9.121	8.851	8.238	9.130	8.886	10.0%	8.851
695 Case 685 with Increased Insulation	8.755	8.974	8.386	9.172	9.149	9.039	8.386	9.172	8.912	8.8%	9.039
900 South Windows	2.714	2.464	2.383	2.489	2.488	2.267	2.267	2.714	2.467	18.1%	2.267
910 S. Windows + Overhang	1.484	1.415	1.490	1.383	1.283	1.191	1.191	1.490	1.374	21.8%	1.187
920 East & West Windows	3.128	2.789	2.706	2.731	2.814	2.549	2.549	3.128	2.786	20.8%	2.547
930 E&W Windows + Overhang & Fins	2.161	2.075	1.908	1.919	1.654	1.672	1.654	2.161	1.898	26.7%	1.668
940 Case 900 with Htg. Temp. Setback	2.613	2.397	2.343	2.424	2.428	2.203	2.203	2.613	2.401	17.1%	2.203
950 Case 900 with Night Ventilation	0.586	0.598	0.618	0.707	0.656	0.642	0.586	0.707	0.634	19.1%	0.642
960 Sunspace		0.926	0.909	0.907	0.950	0.789	0.789	0.950	0.896	17.9%	0.789
980 Case 900 with Increased Insulation	3.501	3.995	3.758	3.712	3.775	3.519	3.501	3.995	3.710	13.3%	3.518
985 Case 900 with "20/20" Thermostat	7.273	6.234	5.880	6.359	6.249	6.113	5.880	7.273	6.351	21.9%	6.115
995 Case 985 with Increased Insulation	7.482	7.202	6.771	7.203	7.149	7.064	6.771	7.482	7.145	10.0%	7.064
195 Solid Conduction	0.712	0.606	0.628	0.612	0.611	0.592	0.592	0.712	0.627	19.2%	0.592
200 Surface Convection (Int & Ext IR="off")	0.839	0.800	0.835	0.814	0.800	0.788	0.788	0.839	0.813	6.2%	0.791
210 Infrared Radiation (Int IR="off", Ext IR="on")	0.688	0.503	0.496	0.560	0.519	0.459	0.459	0.688	0.537	42.6%	0.461
215 Infrared Radiation (Int IR="on", Ext IR="off")	0.952	0.946	0.922	0.877	0.895	0.850	0.850	0.952	0.907	11.2%	0.855
220 In-Depth Base Case	0.803	0.611	0.550	0.610	0.576	0.498	0.498	0.803	0.608	50.2%	0.500
230 Infiltration	1.184	0.991	0.929	0.991	0.955	0.897	0.897	1.184	0.991	29.0%	0.900
240 Internal Gains	1.287	0.982	0.876	0.979	0.922	0.834	0.834	1.287	0.980	46.2%	0.836
250 Exterior Shortwave Absorptance	3.612	3.429	3.471	3.182	3.467	2.904	2.904	3.612	3.344	21.2%	2.930
270 South Solar Windows		7.271	6.698	7.522	7.309	7.289	6.698	7.522	7.217	11.4%	7.288
280 Cavity Albedo		4.996	4.215	5.183	5.206	4.808	4.215	5.206	4.882	20.3%	4.808
290 South Shading		5.610	5.310	5.743	5.321	5.461	5.310	5.743	5.489	7.9%	5.447
300 East/West Window		5.055	4.805	5.152	5.038	4.913	4.805	5.152	4.993	7.0%	4.911
310 East/West Shading		3.752	3.402	3.669	3.128	3.324	3.128	3.752	3.455	18.1%	3.317
320 Thermostat		4.859	4.420	4.986	4.913	4.788	4.420	4.986	4.793	11.8%	4.787
395 Low Mass Solid Conduction	0.021	0.008	0.006	0.010	0.006	0.004	0.004	0.021	0.009	193.7%	0.004
400 Low Mass High Cond. Wall Elements	0.063	0.023	0.017	0.031	0.024	0.013	0.013	0.063	0.028	176.6%	0.013
410 Low Mass Infiltration	0.096	0.048	0.041	0.057	0.052	0.035	0.035	0.096	0.055	110.6%	0.036
420 Low Mass Internal Gains	0.228	0.141	0.119	0.153	0.142	0.109	0.109	0.228	0.149	79.8%	0.110
430 Low Mass Ext. Shortwave Absorptance	1.084	0.906	0.944	0.856	0.953	0.739	0.739	1.084	0.914	37.8%	0.744
440 Low Mass Cavity Albedo		3.985	3.458	4.085	4.414	3.741	3.458	4.414	3.937	24.3%	3.741
450 Constant Interior and Exterior Surf Coeffs	6.172	5.689	6.161	6.507	6.613	6.531	5.689	6.613	6.279	14.7%	6.529
460 Constant Interior Surface Coefficients	6.260	5.940	5.929	6.475	6.729	6.243	5.929	6.729	6.263	12.8%	6.242
470 Constant Exterior Surface Coefficients	5.987	5.644	5.649	6.029	6.005	6.056	5.644	6.056	5.895	7.0%	6.056
800 High Mass High Cond. Wall Elements	0.473	0.380	0.362	0.374	0.391	0.282	0.282	0.473	0.377	50.6%	0.284
810 High Mass Cavity Albedo		1.481	1.357	1.508	1.606	1.295	1.295	1.606	1.449	21.5%	1.294

** ABS[(Max-Min) / (Mean of Example Simulation Results)]

**ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024**

Note: The statistics in the tables below are based on the listed example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8-5. Free-Float Temperature Output

MAXIMUM ANNUAL HOURLY INTEGRATED ZONE TEMPERATURE																																
Simulation Model:		BSIMAC			CSE			DeST			EnergyPlus			ESP-r			TRNSYS			Example Result Statistics				TRNSYS18								
Case	T (°C)	Mo.	Day	Hr	T (°C)	Mo.	Day	Hr	T (°C)	Mo.	Day	Hr	T (°C)	Mo.	Day	Hr	T (°C)	Mo.	Day	Hr	Min T (°C)	Max T (°C)	Mean T (°C)	(Max-Min)/Mean** (%)	T (°C)	Mo.	Day	Hr				
600FF - Low Mass with S. Windows	63.4	Oct	18	17	68.4	Oct	1	16	65.0	Oct	11	15	63.8	Oct	18	16	64.6	Oct	1	16	62.4	Oct	1	15	62.4	68.4	64.6	9.3%	62.4	Oct	1	15
900FF - High Mass with S. Windows	46.0	Oct	1	17	45.1	Sep	4	15	44.5	Sep	11	15	44.3	Sep	12	15	44.3	Sep	12	15	43.3	Sep	12	15	43.3	46.0	44.6	6.2%	43.3	Sep	12	15
650FF Case 600FF with Night Ventilation	62.1	Oct	18	17	66.8	Oct	1	16	62.6	Oct	11	15	62.5	Oct	18	16	63.3	Oct	1	16	61.1	Oct	1	15	61.1	66.8	63.1	9.1%	61.1	Oct	1	15
950FF Case 900FF with Night Ventilation	37.1	Oct	1	17	36.8	Sep	11	15	36.4	Sep	11	15	36.7	Sep	11	16	36.4	Aug	5	16	36.1	Sep	11	16	36.1	37.1	36.6	2.7%	36.1	Sep	11	16
680FF Case 600FF with Increased Insulation	72.5	Jan	22	17	78.5	Jan	22	16	75.0	Oct	12	15	70.1	Jan	22	16	72.2	Oct	12	16	69.8	Jan	22	16	69.8	78.5	73.0	12.0%	69.8	Jan	22	16
980FF Case 900FF with Increased Insulation	49.7	Oct	1	17	52.2	Sep	12	15	52.8	Oct	21	14	49.6	Sep	12	16	50.2	Sep	12	15	48.5	Sep	12	15	48.5	52.8	50.5	8.5%	48.5	Sep	12	15
960 Sunspace					48.9	Oct	2	16	53.2	Oct	20	14	49.9	Oct	12	15	49.5	Oct	12	15	48.1	Oct	12	15	48.1	53.2	49.9	10.2%	48.1	Oct	12	15

MINIMUM ANNUAL HOURLY INTEGRATED ZONE TEMPERATURE																																
Simulation Model:		BSIMAC			CSE			DeST			EnergyPlus			ESP-r			TRNSYS			Example Result Statistics				TRNSYS18								
Case	T (°C)	Mo.	Day	Hr	T (°C)	Mo.	Day	Hr	T (°C)	Mo.	Day	Hr	T (°C)	Mo.	Day	Hr	T (°C)	Mo.	Day	Hr	Min T (°C)	Max T (°C)	Mean T (°C)	(Max-Min)/Mean** (%)	T (°C)	Mo.	Day	Hr				
600FF - Low Mass with S. Windows	-9.9	Nov	26	8	-12.9	Feb	9	7	-13.5	Feb	9	6	-12.6	Feb	9	7	-13.5	Feb	9	7	-13.8	Feb	9	7	-13.8	-9.9	-12.7	31.1%	-13.8	Feb	9	7
900FF - High Mass with S. Windows	0.6	Feb	8	11	2.2	Feb	9	7	1.3	Feb	9	7	1.2	Feb	9	7	1.6	Feb	9	7	0.6	Feb	9	7	0.6	2.2	1.3	124.2%	0.6	Feb	9	7
650FF Case 600FF with Night Ventilation	-16.7	Dec	31	24	-17.8	Jan	1	1	-17.4	Dec	30	23	-17.1	Dec	31	24	-17.5	Jan	1	1	-17.5	Dec	31	24	-17.8	-16.7	-17.3	6.1%	-17.5	Dec	31	24
950FF Case 900FF with Night Ventilation	-13.2	Dec	31	24	-13.2	Jan	1	1	-13.4	Dec	30	23	-12.8	Feb	9	7	-12.5	Feb	9	6	-12.8	Feb	9	6	-13.4	-12.5	-13.0	6.6%	-12.8	Feb	9	6
680FF Case 600FF with Increased Insulation	-5.7	Feb	8	11	-6.2	Feb	9	7	-6.9	Feb	9	7	-7.1	Feb	9	7	-7.2	Feb	9	7	-8.1	Feb	9	7	-8.1	-5.7	-6.9	34.6%	-8.1	Feb	9	7
980FF Case 900FF with Increased Insulation	7.3	Feb	8	11	12.5	Nov	4	7	12.4	Nov	5	6	9.9	Nov	4	7	10.5	Nov	4	8	9.5	Nov	4	7	7.3	12.5	10.4	50.6%	9.5	Nov	4	7
960 Sunspace					8.0	Feb	9	8	6.7	Feb	9	6	5.1	Feb	9	7	5.0	Feb	9	7	4.2	Feb	9	7	4.2	8.0	5.8	65.0%	4.2	Feb	9	7

AVERAGE ANNUAL HOURLY INTEGRATED ZONE TEMPERATURE																																
Simulation Model:		BSIMAC			CSE			DeST			EnergyPlus			ESP-r			TRNSYS			Example Result Statistics				TRNSYS18								
Case	T (°C)				T (°C)				T (°C)				T (°C)				T (°C)				Min T (°C)	Max T (°C)	Mean T (°C)	(Max-Min)/Mean** (%)	T (°C)							
600FF - Low Mass with S. Windows	26.1				25.6				25.3				24.9				25.3				24.3				24.3	26.1	25.2	7.3%	24.3			
900FF - High Mass with S. Windows	25.5				25.7				25.3				25.1				25.3				24.5				24.5	25.7	25.2	4.9%	24.5			
650FF Case 600FF with Night Ventilation	17.6				18.5				18.0				18.4				18.9				18.4				17.6	18.9	18.3	7.3%	18.4			
950FF Case 900FF with Night Ventilation	15.0				14.7				14.4				14.8				14.8				14.7				14.4	15.0	14.7	4.4%	14.7			
680FF Case 600FF with Increased Insulation	31.8				33.1				33.3				31.0				31.7				30.2				30.2	33.3	31.8	9.8%	30.2			
980FF Case 900FF with Increased Insulation	30.7				33.3				33.3				31.2				31.8				30.5				30.5	33.3	31.8	8.8%	30.5			
960 Sunspace					28.6				29.5				27.7				27.7				26.8				26.8	29.5	28.1	9.5%	26.8			

** ABS[(Max-Min) / (Mean of Example Simulation Results)]

**ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024**

Note: The statistics in the tables below are based on the listed example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8-6. Low Mass Basic Sensitivity Tests

ANNUAL HEATING [MWh]							Statistics for Example Results				TRNSYS18
Case	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
610-600 Heat, S. Shade	0.113	0.074	0.097	0.050	0.165	0.089	0.050	0.165	0.098	117.0%	0.090
620-600 Heat, E&W Orient.	0.320	0.101	0.250	0.161	0.152	0.215	0.101	0.320	0.200	109.6%	0.215
630-620 Heat, E&W Shade	0.553	0.262	0.380	0.298	0.536	0.420	0.262	0.553	0.408	71.2%	0.422
640-600 Heat, Htg. Setback	-1.368	-1.590	-1.428	-1.663	-1.708	-1.851	-1.851	-1.368	-1.601	30.2%	-1.852
660-600 Heat, Low-E Win.	-0.476	-0.391	-0.226	-0.618	-0.575	-0.714	-0.714	-0.226	-0.500	97.6%	-0.714
670-600 Heat, 1-Pane Win.	1.434	1.307	1.526	1.292	1.613	1.636	1.292	1.636	1.468	23.5%	1.636
680-600 Heat, > Ins. 20/27	-1.831	-2.207	-2.315	-2.145	-2.230	-2.217	-2.315	-1.831	-2.157	22.4%	-2.216
685-600 Heat, 20/20 tstat	0.482	0.582	0.599	0.553	0.542	0.539	0.482	0.599	0.549	21.3%	0.539
695-685 Heat, > Ins. 20/20	-1.823	-2.159	-2.261	-2.075	-2.171	-2.150	-2.261	-1.823	-2.107	20.8%	-2.149
ANNUAL SENSIBLE COOLING [MWh]							Statistics for Example Results				TRNSYS18
Case	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
610-600 Cool, S. Shade	-1.523	-1.531	-1.259	-1.694	-1.929	-1.663	-1.929	-1.259	-1.600	41.9%	-1.675
620-600 Cool, E&W Orient.	-1.418	-1.834	-1.523	-1.968	-1.916	-1.939	-1.968	-1.418	-1.766	31.1%	-1.940
630-620 Cool, E&W Shade	-1.330	-1.059	-1.122	-1.223	-1.650	-1.268	-1.650	-1.059	-1.275	46.4%	-1.271
640-600 Cool, Htg. Setback	-0.018	-0.269	-0.195	-0.264	-0.269	-0.302	-0.302	-0.018	-0.220	129.5%	-0.302
650-600 Cool, Night Vent	-1.193	-1.259	-1.246	-1.210	-1.217	-1.147	-1.259	-1.147	-1.212	9.2%	-1.147
660-600 Heat, Low-E Win.	-2.808	-2.573	-2.172	-2.796	-2.943	-2.813	-2.943	-2.172	-2.684	28.7%	-2.813
670-600 Heat, 1-Pane Win.	0.717	0.665	0.522	0.596	0.358	0.418	0.358	0.717	0.546	65.7%	0.418
680-600 Heat, > Ins. 20/27	0.116	0.517	0.500	0.417	0.368	0.530	0.116	0.530	0.408	101.6%	0.530
685-600 Heat, 20/20 tstat	3.308	2.946	2.806	3.092	2.960	3.072	2.806	3.308	3.031	16.6%	3.072
695-685 Heat, > Ins. 20/20	-0.375	0.115	0.148	0.053	0.028	0.188	-0.375	0.188	0.026	2164.0%	0.188
PEAK HEATING [kW]							Statistics for Example Results				TRNSYS18
Case	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
610-600 Heat, S. Shade	-0.089	0.001	0.004	-0.013	0.005	0.001	-0.089	0.005	-0.015	616.7%	0.001
620-600 Heat, E&W Orient.	-0.110	0.018	0.033	0.025	0.025	0.026	-0.110	0.033	0.003	5355.3%	0.048
630-620 Heat, E&W Shade	0.107	0.002	0.004	-0.023	0.006	0.003	-0.023	0.107	0.016	786.0%	0.005
640-600 Heat, Htg. Setback	1.378	1.202	1.623	1.354	0.873	0.680	0.680	1.623	1.185	79.6%	0.760
660-600 Heat, Low-E Win.	-0.635	-0.262	-0.237	-0.373	-0.382	-0.404	-0.635	-0.237	-0.382	104.1%	-0.409
670-600 Heat, 1-Pane Win.	0.867	0.635	0.777	0.649	0.764	0.862	0.635	0.867	0.759	30.5%	0.943
680-600 Heat, > Ins. 20/27	-1.129	-1.243	-1.224	-1.152	-1.206	-1.244	-1.244	-1.129	-1.200	9.6%	-1.163
685-600 Heat, 20/20 tstat	-0.086	0.012	0.019	0.019	0.019	0.016	-0.086	0.019	0.000	29982.6%	0.028
695-685 Heat, > Ins. 20/20	-1.031	-1.237	-1.199	-1.151	-1.222	-1.257	-1.257	-1.031	-1.183	19.1%	-1.188
PEAK SENSIBLE COOLING [kW]							Statistics for Example Results				TRNSYS18
Case	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
610-600 Cool, S. Shade	-0.184	-0.049	-0.091	-0.217	-0.259	-0.178	-0.259	-0.049	-0.163	129.0%	-0.233
620-600 Cool, E&W Orient.	-0.946	-1.988	-1.467	-1.554	-1.571	-1.457	-1.988	-0.946	-1.497	69.6%	-1.457
630-620 Cool, E&W Shade	-0.583	-0.495	-0.429	-0.585	-0.651	-0.639	-0.651	-0.429	-0.564	39.4%	-0.644
640-600 Cool, Htg. Setback	0.000	-0.052	-0.057	-0.054	-0.066	-0.079	-0.079	0.000	-0.051	153.3%	-0.079
650-600 Cool, Night Vent	-0.002	-0.191	-0.377	-0.213	-0.232	-0.248	-0.377	-0.002	-0.211	178.0%	-0.248
660-600 Heat, Low-E Win.	-2.307	-2.548	-2.067	-2.581	-2.663	-2.588	-2.663	-2.067	-2.459	24.2%	-2.588
670-600 Heat, 1-Pane Win.	0.567	0.444	0.417	0.455	0.289	0.356	0.289	0.567	0.421	66.0%	0.356
680-600 Heat, > Ins. 20/27	0.111	0.570	0.439	0.419	0.483	0.511	0.111	0.570	0.422	108.8%	0.511
685-600 Heat, 20/20 tstat	0.668	0.678	0.649	0.755	0.741	0.822	0.649	0.822	0.719	24.0%	0.822
695-685 Heat, > Ins. 20/20	-0.086	0.381	0.284	0.228	0.305	0.308	-0.086	0.381	0.237	197.5%	0.308

** ABS[(Max-Min) / (Mean of Example Simulation Results)]

**ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024**

Note: The statistics in the tables below are based on the listed example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8-7. High Mass Basic Sensitivity Tests

ANNUAL HEATING [MWh]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
900-600 Mass, Heat	-2.324	-2.614	-2.456	-2.661	-2.777	-2.690	-2.777	-2.324	-2.587	17.5%	-2.697
910-900 Heat, S. Shade	0.437	0.269	0.269	0.292	0.483	0.318	0.269	0.483	0.345	62.0%	0.325
920-900 Heat, E&W Orient.	1.774	1.577	1.668	1.673	1.715	1.793	1.577	1.793	1.700	12.7%	1.787
930-920 Heat, E&W Shade	0.770	0.568	0.674	0.657	0.978	0.777	0.568	0.978	0.737	55.6%	0.780
940-900 Heat, Htg. Setback	-0.337	-0.516	-0.442	-0.596	-0.570	-0.645	-0.645	-0.337	-0.518	59.5%	-0.646
960-900 Heat, Sunspace		1.143	1.180	1.025	1.039	1.046	1.025	1.180	1.087	14.2%	1.047
980-900 Heat, > Ins. 20/27	-1.006	-1.133	-1.325	-1.253	-1.234	-1.364	-1.364	-1.006	-1.219	29.3%	-1.352
985-900 Heat, 20/20 tstat	1.075	0.741	0.688	0.706	0.699	0.722	0.688	1.075	0.772	50.1%	0.724
995-985 Heat, > Ins. 20/20	-1.471	-1.365	-1.509	-1.363	-1.379	-1.459	-1.509	-1.363	-1.424	10.3%	-1.450
ANNUAL SENSIBLE COOLING [MWh]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
900-600 Mass, Cool	-3.108	-3.449	-3.049	-3.538	-3.674	-3.512	-3.674	-3.049	-3.389	18.4%	-3.513
910-900 Cool, S. Shade	-1.230	-1.049	-0.893	-1.105	-1.205	-1.076	-1.230	-0.893	-1.093	30.8%	-1.079
920-900 Cool, E&W Orient.	0.414	0.325	0.323	0.242	0.327	0.282	0.242	0.414	0.319	53.9%	0.281
930-920 Cool, E&W Shade	-0.967	-0.714	-0.798	-0.812	-1.161	-0.877	-1.161	-0.714	-0.888	50.3%	-0.879
940-900 Cool, Htg. Setback	-0.101	-0.067	-0.040	-0.064	-0.060	-0.064	-0.101	-0.040	-0.066	92.3%	-0.064
950-900 Cool, Night Vent	-2.128	-1.866	-1.765	-1.782	-1.832	-1.626	-2.128	-1.626	-1.833	27.4%	-1.625
960-900 Cool, Sunspace		-1.538	-1.474	-1.582	-1.538	-1.478	-1.582	-1.474	-1.522	7.1%	-1.478
980-900 Heat, > Ins. 20/27	0.787	1.531	1.375	1.223	1.287	1.251	0.787	1.531	1.242	59.9%	1.251
985-900 Heat, 20/20 tstat	4.559	3.770	3.497	3.870	3.762	3.846	3.497	4.559	3.884	27.3%	3.848
995-985 Heat, > Ins. 20/20	0.209	0.969	0.891	0.844	0.900	0.950	0.209	0.969	0.794	95.7%	0.949
PEAK HEATING [kW]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
900-600 Mass, Heat	-0.704	-0.577	-0.582	-0.517	-0.595	-0.580	-0.704	-0.517	-0.593	31.6%	-0.499
910-900 Heat, S. Shade	0.210	0.026	0.021	0.011	0.051	0.021	0.011	0.210	0.057	350.6%	0.021
920-900 Heat, E&W Orient.	0.344	0.069	0.060	0.083	0.073	0.086	0.060	0.344	0.119	238.5%	0.086
930-920 Heat, E&W Shade	0.073	0.025	0.036	0.015	0.059	0.036	0.015	0.073	0.041	143.7%	0.036
940-900 Heat, Htg. Setback	1.331	0.609	1.206	0.455	0.489	0.626	0.455	1.331	0.786	111.4%	0.417
960-900 Heat, Sunspace		-0.311	-0.368	-0.428	-0.432	-0.478	-0.478	-0.311	-0.404	41.3%	-0.478
980-900 Heat, > Ins. 20/27	-0.858	-1.190	-1.071	-1.150	-1.160	-1.186	-1.190	-0.858	-1.102	30.1%	-1.186
985-900 Heat, 20/20 tstat	0.203	0.009	0.005	0.008	0.009	0.007	0.005	0.203	0.040	493.6%	0.007
995-985 Heat, > Ins. 20/20	-1.043	-1.083	-0.996	-1.073	-1.082	-1.123	-1.123	-0.996	-1.067	11.9%	-1.123
PEAK SENSIBLE COOLING [kW]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
900-600 Mass, Cool	-2.611	-3.105	-2.866	-3.311	-3.297	-3.106	-3.311	-2.611	-3.049	23.0%	-3.106
910-900 Cool, S. Shade	-0.546	-0.654	-0.453	-0.818	-0.684	-0.859	-0.859	-0.453	-0.669	60.7%	-0.865
920-900 Cool, E&W Orient.	0.442	-0.320	0.154	0.220	0.203	0.214	-0.320	0.442	0.152	500.5%	0.214
930-920 Cool, E&W Shade	-0.429	-0.395	-0.375	-0.479	-0.605	-0.541	-0.605	-0.375	-0.471	48.9%	-0.542
940-900 Cool, Htg. Setback	0.119	0.000	0.000	0.000	-0.005	-0.002	-0.005	0.119	0.019	669.9%	-0.002
950-900 Cool, Night Vent	-0.673	-1.013	-0.502	-0.653	-0.694	-0.704	-1.013	-0.502	-0.706	72.3%	-0.704
960-900 Cool, Sunspace		-1.999	-1.189	-1.561	-1.493	-1.602	-1.999	-1.189	-1.569	51.7%	-1.601
980-900 Heat, > Ins. 20/27	0.345	0.292	0.374	0.410	0.445	0.372	0.292	0.445	0.373	41.1%	0.373
985-900 Heat, 20/20 tstat	0.938	0.849	0.652	0.874	0.840	0.945	0.652	0.945	0.850	34.4%	0.945

**ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024**

Note: The statistics in the tables below are based on the listed example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

995-985 Heat, > Ins. 20/20	0.152	-0.001	0.107	0.263	0.218	0.230	-0.001	0.263	0.161	163.7%	0.230
----------------------------	-------	--------	-------	-------	-------	-------	--------	-------	-------	--------	-------

** ABS[(Max-Min) / (Mean of Example Simulation Results)]

**ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024**

Note: The statistics in the tables below are based on the listed example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8-8. Low Mass In-Depth (Cases 195 thru 320) Sensitivity Tests

ANNUAL HEATING [MWh]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
200-195 Surface Convection	0.824	0.823	1.069	1.036	0.970	1.049	0.823	1.069	0.962	25.5%	1.065
210-200 Ext IR (Int IR "off")	0.586	1.153	1.305	0.941	1.397	1.287	0.586	1.397	1.111	72.9%	1.294
220-215 Ext IR (Int IR "on")	0.725	1.360	1.481	1.050	1.545	1.424	0.725	1.545	1.264	64.8%	1.436
215-200 Int IR (Ext IR "off")	0.611	0.493	0.471	0.300	0.261	0.301	0.261	0.611	0.406	86.3%	0.307
220-210 Int IR (Ext IR "on")	0.750	0.700	0.647	0.409	0.409	0.438	0.409	0.750	0.559	61.1%	0.449
230-220 Infiltration	3.474	3.146	3.239	3.475	3.213	3.366	3.146	3.475	3.319	9.9%	3.366
240-220 Internal Gains	-1.261	-1.224	-1.234	-1.176	-1.186	-1.211	-1.261	-1.176	-1.215	7.0%	-1.210
250-220 Ext Solar Abs.	-1.644	-1.622	-1.805	-1.556	-1.791	-1.763	-1.805	-1.556	-1.697	14.7%	-1.772
270-220 South Windows		-2.320	-2.905	-2.070	-2.149	-2.237	-2.905	-2.070	-2.336	35.8%	-2.271
280-270 Cavity Albedo		0.178	0.346	0.185	0.162	0.239	0.162	0.346	0.222	83.0%	0.239
320-270 Thermostat		-0.669	-0.674	-0.614	-0.607	-0.600	-0.674	-0.600	-0.633	11.7%	-0.600
290-270 South Shading		0.078	0.108	0.039	0.168	0.094	0.039	0.168	0.097	132.8%	0.095
300-270 E&W Windows		-0.028	0.187	0.039	0.092	0.094	-0.028	0.187	0.077	280.1%	0.094
310-300 E&W Shading		0.262	0.386	0.267	0.572	0.437	0.262	0.572	0.385	80.5%	0.439
ANNUAL SENSIBLE COOLING [MWh]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
200-195 Surface Convection	0.127	0.195	0.207	0.203	0.189	0.197	0.127	0.207	0.186	42.9%	0.200
210-200 Ext IR (Int IR "off")	-0.151	-0.297	-0.339	-0.254	-0.282	-0.329	-0.339	-0.151	-0.275	68.3%	-0.330
220-215 Ext IR (Int IR "on")	-0.149	-0.335	-0.372	-0.268	-0.319	-0.353	-0.372	-0.149	-0.299	74.5%	-0.354
215-200 Int IR (Ext IR "off")	0.113	0.146	0.087	0.063	0.094	0.062	0.062	0.146	0.094	88.6%	0.064
220-210 Int IR (Ext IR "on")	0.115	0.108	0.054	0.050	0.058	0.038	0.038	0.115	0.070	108.6%	0.040
230-220 Infiltration	0.381	0.381	0.379	0.381	0.379	0.399	0.379	0.399	0.383	5.3%	0.399
240-220 Internal Gains	0.484	0.372	0.326	0.369	0.346	0.336	0.326	0.484	0.372	42.5%	0.336
250-220 Ext Solar Abs.	2.809	2.818	2.921	2.572	2.891	2.406	2.406	2.921	2.736	18.8%	2.429
270-220 South Windows		6.660	6.148	6.912	6.732	6.791	6.148	6.912	6.649	11.5%	6.787
280-270 Cavity Albedo		-2.274	-2.483	-2.339	-2.103	-2.480	-2.483	-2.103	-2.336	16.3%	-2.480
320-270 Thermostat		-2.412	-2.278	-2.536	-2.396	-2.501	-2.536	-2.278	-2.424	10.6%	-2.501
290-270 South Shading		-1.661	-1.388	-1.779	-1.988	-1.827	-1.988	-1.388	-1.729	34.7%	-1.840
300-270 E&W Windows		-2.216	-1.893	-2.370	-2.271	-2.376	-2.376	-1.893	-2.225	21.7%	-2.377
310-300 E&W Shading		-1.303	-1.403	-1.483	-1.910	-1.589	-1.910	-1.303	-1.538	39.5%	-1.594
PEAK HEATING [kW]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
200-195 Surface Convection	0.470	0.435	0.509	0.547	0.473	0.557	0.435	0.557	0.499	24.4%	0.570
210-200 Ext IR (Int IR "off")	0.102	0.403	0.297	0.223	0.396	0.397	0.102	0.403	0.303	99.3%	0.343
220-215 Ext IR (Int IR "on")	0.110	0.419	0.343	0.214	0.398	0.389	0.110	0.419	0.312	99.1%	0.333
215-200 Int IR (Ext IR "off")	0.249	0.194	0.212	0.136	0.115	0.137	0.115	0.249	0.174	77.1%	0.140
220-210 Int IR (Ext IR "on")	0.257	0.210	0.258	0.127	0.117	0.129	0.117	0.258	0.183	77.0%	0.130
230-220 Infiltration	1.588	1.294	1.360	1.624	1.372	1.437	1.294	1.624	1.446	22.9%	1.442
240-220 Internal Gains	-0.200	-0.188	-0.178	-0.185	-0.183	-0.185	-0.200	-0.178	-0.187	11.8%	-0.185
250-220 Ext Solar Abs.	0.000	-0.002	-0.008	-0.005	-0.008	-0.004	-0.008	0.000	-0.005	176.8%	-0.007
270-220 South Windows		-0.228	-0.303	-0.095	-0.040	-0.035	-0.303	-0.035	-0.140	190.7%	-0.063
280-270 Cavity Albedo		0.001	0.008	0.005	0.004	0.005	0.001	0.008	0.005	150.6%	0.010
320-270 Thermostat		-0.002	-0.014	-0.023	-0.015	-0.010	-0.023	-0.002	-0.013	161.1%	-0.023
290-270 South Shading		0.000	0.001	-0.013	0.002	0.000	-0.013	0.002	-0.002	763.1%	0.001
300-270 E&W Windows		0.003	0.029	0.007	0.018	0.010	0.003	0.029	0.013	197.7%	0.022
310-300 E&W Shading		0.001	0.003	-0.023	0.005	0.003	-0.023	0.005	-0.002	1211.6%	0.005
PEAK SENSIBLE COOLING [kW]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
200-195 Surface Convection	0.153	0.221	0.266	0.266	0.254	0.265	0.153	0.266	0.238	47.8%	0.269
210-200 Ext IR (Int IR "off")	-0.078	-0.270	-0.302	-0.223	-0.321	-0.375	-0.375	-0.078	-0.261	113.5%	-0.376
220-215 Ext IR (Int IR "on")	-0.057	-0.261	-0.346	-0.216	-0.354	-0.384	-0.384	-0.057	-0.270	121.3%	-0.385
215-200 Int IR (Ext IR "off")	0.122	0.154	0.147	0.093	0.168	0.093	0.093	0.168	0.130	58.0%	0.095
220-210 Int IR (Ext IR "on")	0.143	0.163	0.103	0.100	0.135	0.084	0.084	0.163	0.121	65.1%	0.086
230-220 Infiltration	0.658	0.620	0.694	0.656	0.689	0.726	0.620	0.726	0.674	15.7%	0.726
240-220 Internal Gains	0.198	0.186	0.178	0.181	0.180	0.182	0.178	0.198	0.184	10.9%	0.181
250-220 Ext Solar Abs.	1.577	1.682	1.711	1.682	2.022	1.720	1.577	2.022	1.732	25.7%	1.738
270-220 South Windows		5.903	4.792	5.654	5.601	5.669	4.792	5.903	5.524	20.1%	5.664
280-270 Cavity Albedo		-2.246	-2.064	-2.112	-1.937	-2.238	-2.246	-1.937	-2.119	14.6%	-2.237
320-270 Thermostat		-0.538	-0.528	-0.630	-0.620	-0.688	-0.688	-0.528	-0.601	26.6%	-0.688
290-270 South Shading		-0.139	-0.093	-0.244	-0.202	-0.236	-0.244	-0.093	-0.183	82.8%	-0.261
300-270 E&W Windows		-2.848	-2.137	-2.363	-2.392	-2.359	-2.848	-2.137	-2.420	29.4%	-2.359

**ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results**

By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

Note: The statistics in the tables below are based on the listed example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

310-300 E&W Shading		-0.367	-0.443	-0.506	-0.603	-0.577	-0.603	-0.367	-0.499	47.2%	-0.579
---------------------	--	--------	--------	--------	--------	--------	--------	--------	--------	-------	--------

** ABS[(Max-Min) / (Mean of Example Simulation Results)]

ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF

(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

Note: The statistics in the tables below are based on the listed example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8-9. Low Mass In-Depth (Cases 395 thru 440) Sensitivity Tests

ANNUAL HEATING [MWh]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
400-395 Surf. Conv. & IR	1.341	1.681	1.902	1.707	1.744	1.861	1.341	1.902	1.706	32.9%	1.896
410-400 Infiltration	1.724	1.509	1.614	1.733	1.602	1.676	1.509	1.733	1.643	13.6%	1.676
420-410 Internal Gains	-1.231	-1.211	-1.228	-1.175	-1.185	-1.209	-1.231	-1.175	-1.206	4.7%	-1.208
430-420 Ext Solar Abs.	-1.228	-1.380	-1.479	-1.286	-1.482	-1.386	-1.482	-1.228	-1.374	18.5%	-1.395
600-430 South Windows	-1.121	-1.461	-1.907	-1.296	-1.183	-1.347	-1.907	-1.121	-1.386	56.7%	-1.372
440-600 Cavity Albedo		0.163	0.283	0.176	0.142	0.217	0.142	0.283	0.196	71.9%	0.217
450-600 Const Int&Ext Surf Coefs	-0.307	-0.002	-0.672	-0.362	-0.512	-0.633	-0.672	-0.002	-0.415	161.5%	-0.631
460-600 Const Int Surf Coefs	-0.222	0.063	-0.174	-0.131	-0.099	-0.214	-0.222	0.063	-0.130	219.8%	-0.213
460-450 Auto Ext Surf Heat Transf	0.085	0.065	0.498	0.231	0.412	0.419	0.065	0.498	0.285	151.9%	0.418
470-600 Const Ext Surf Coefs	-0.008	-0.093	-0.507	-0.231	-0.402	-0.429	-0.507	-0.008	-0.278	179.3%	-0.428
470-450 Auto Int Surf Heat Transf	0.299	-0.091	0.165	0.131	0.109	0.204	-0.091	0.299	0.136	286.2%	0.203
ANNUAL SENSIBLE COOLING [MWh]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
400-395 Surf. Conv. & IR	0.042	0.016	0.011	0.020	0.019	0.009	0.009	0.042	0.019	168.7%	0.009
410-400 Infiltration	0.033	0.025	0.024	0.027	0.028	0.022	0.022	0.033	0.027	39.8%	0.023
420-410 Internal Gains	0.132	0.092	0.078	0.095	0.090	0.074	0.074	0.132	0.094	61.7%	0.074
430-420 Ext Solar Abs.	0.856	0.766	0.825	0.703	0.811	0.630	0.630	0.856	0.765	29.6%	0.635
600-430 South Windows	4.738	5.007	4.488	5.171	5.209	5.040	4.488	5.209	4.942	14.6%	5.035
440-600 Cavity Albedo		-1.928	-1.974	-1.942	-1.748	-2.038	-2.038	-1.748	-1.926	15.1%	-2.038
450-600 Const Int&Ext Surf Coefs	0.350	-0.224	0.729	0.480	0.451	0.751	-0.224	0.751	0.423	230.6%	0.750
460-600 Const Int Surf Coefs	0.438	0.027	0.497	0.448	0.567	0.464	0.027	0.567	0.407	132.9%	0.463
460-450 Auto Ext Surf Heat Transf	0.088	0.251	-0.232	-0.033	0.116	-0.287	-0.287	0.251	-0.016	3319.8%	-0.287
470-600 Const Ext Surf Coefs	0.165	-0.269	0.217	0.002	-0.156	0.276	-0.269	0.276	0.039	1392.5%	0.276
470-450 Auto Int Surf Heat Transf	-0.185	-0.045	-0.512	-0.478	-0.608	-0.475	-0.608	-0.045	-0.384	146.6%	-0.474
PEAK HEATING [kW]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
400-395 Surf. Conv. & IR	0.611	0.682	0.778	0.740	0.698	0.717	0.611	0.778	0.704	23.7%	0.794
410-400 Infiltration	0.779	0.601	0.680	0.812	0.685	0.718	0.601	0.812	0.713	29.6%	0.721
420-410 Internal Gains	-0.200	-0.184	-0.178	-0.185	-0.183	-0.185	-0.200	-0.178	-0.186	11.8%	-0.185
430-420 Ext Solar Abs.	0.162	-0.002	-0.005	-0.003	-0.005	-0.003	-0.005	0.162	0.024	695.2%	-0.005
600-430 South Windows	-0.045	-0.234	-0.325	-0.112	-0.057	-0.050	-0.325	-0.045	-0.137	204.3%	-0.088
440-600 Cavity Albedo		0.007	0.025	0.014	0.009	0.015	0.007	0.025	0.014	127.7%	0.027
450-600 Const Int&Ext Surf Coefs	-0.266	-0.042	-0.282	-0.105	-0.186	-0.322	-0.322	-0.042	-0.200	139.6%	-0.300
460-600 Const Int Surf Coefs	-0.200	-0.049	-0.055	-0.113	-0.127	-0.199	-0.200	-0.049	-0.124	122.0%	-0.186
460-450 Auto Ext Surf Heat Transf	0.066	-0.007	0.227	-0.009	0.059	0.122	-0.009	0.227	0.076	308.4%	0.113
470-600 Const Ext Surf Coefs	-0.137	-0.020	-0.228	0.002	-0.059	-0.127	-0.228	0.002	-0.095	243.0%	-0.115
470-450 Auto Int Surf Heat Transf	0.129	0.022	0.054	0.107	0.127	0.194	0.022	0.194	0.106	162.7%	0.185
PEAK SENSIBLE COOLING [kW]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
400-395 Surf. Conv. & IR	0.251	0.136	0.149	0.229	0.162	0.107	0.107	0.251	0.172	83.7%	0.109
410-400 Infiltration	0.213	0.206	0.252	0.221	0.168	0.232	0.168	0.252	0.215	39.0%	0.233
420-410 Internal Gains	0.197	0.209	0.208	0.205	0.212	0.210	0.197	0.212	0.207	7.3%	0.210
430-420 Ext Solar Abs.	0.959	0.931	0.923	0.897	1.038	0.890	0.890	1.038	0.940	15.7%	0.896
600-430 South Windows	3.483	4.641	3.582	4.422	4.319	4.342	3.483	4.641	4.132	28.0%	4.333
440-600 Cavity Albedo		-1.815	-1.656	-1.666	-1.514	-1.738	-1.815	-1.514	-1.678	18.0%	-1.738
450-600 Const Int&Ext Surf Coefs	0.162	-0.301	0.641	0.115	0.308	0.268	-0.301	0.641	0.199	474.2%	0.267
460-600 Const Int Surf Coefs	0.154	-0.238	0.480	0.023	0.111	0.023	-0.238	0.480	0.092	779.6%	0.022
460-450 Auto Ext Surf Heat Transf	-0.008	0.063	-0.161	-0.092	-0.197	-0.244	-0.244	0.063	-0.107	288.5%	-0.244
470-600 Const Ext Surf Coefs	0.045	-0.093	0.148	0.092	0.214	0.274	-0.093	0.274	0.113	324.3%	0.274
470-450 Auto Int Surf Heat Transf	-0.117	0.208	-0.493	-0.023	-0.094	0.007	-0.493	0.208	-0.085	821.0%	0.008

** ABS[(Max-Min) / (Mean of Example Simulation Results)]

**ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024**

Note: The statistics in the tables below are based on the listed example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF

(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

Note: The statistics in the tables below are based on the listed example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8-10. High Mass Basic and In-Depth Sensitivity Tests

ANNUAL HEATING [MWh]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
800-430 Mass, w/ High Cond. Wall	-0.030	-0.548	-0.551	-0.505	-0.565	-0.481	-0.565	-0.030	-0.447	119.8%	-0.502
900-800 Himass, S. Win.	-3.415	-3.527	-3.812	-3.452	-3.395	-3.555	-3.812	-3.395	-3.526	11.8%	-3.567
900-810 Himass, Int. Sol. Abs.		-0.659	-0.863	-0.678	-0.600	-0.796	-0.863	-0.600	-0.719	36.5%	-0.793
910-610 Mass, w/ S. Shade	-2.000	-2.419	-2.284	-2.419	-2.460	-2.460	-2.460	-2.000	-2.340	19.7%	-2.462
920-620 Mass, w/ E&W Win.	-0.870	-1.138	-1.038	-1.149	-1.215	-1.112	-1.215	-0.870	-1.087	31.7%	-1.126
930-630 Mass w/ E&W Shade	-0.653	-0.832	-0.744	-0.790	-0.773	-0.754	-0.832	-0.653	-0.758	23.7%	-0.768
940-640 Mass, w/ Htg. Setback	-1.293	-1.540	-1.470	-1.594	-1.640	-1.484	-1.640	-1.293	-1.503	23.1%	-1.492
980-680 Mass, w/ Insulation 20/27	-1.499	-1.540	-1.466	-1.769	-1.781	-1.836	-1.836	-1.466	-1.648	22.4%	-1.833
985-685 Mass, w/ 20/20 Tstat	-1.731	-2.454	-2.367	-2.508	-2.620	-2.506	-2.620	-1.731	-2.364	37.6%	-2.512
995-695 Mass, w/ Insulation 20/20	-1.379	-1.660	-1.615	-1.795	-1.827	-1.815	-1.827	-1.379	-1.682	26.7%	-1.813
ANNUAL SENSIBLE COOLING [MWh]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
800-430 Mass, w/ High Cond. Wall	-0.611	-0.526	-0.582	-0.482	-0.561	-0.457	-0.611	-0.457	-0.537	28.7%	-0.461
900-800 Himass, S. Win.	2.241	2.084	2.021	2.115	2.096	1.985	1.985	2.241	2.090	12.2%	1.983
900-810 Himass, Int. Sol. Abs.		0.983	1.026	0.981	0.882	0.973	0.882	1.026	0.969	14.9%	0.972
910-610 Mass, w/ S. Shade	-2.815	-2.967	-2.683	-2.949	-2.950	-2.926	-2.967	-2.683	-2.882	9.9%	-2.917
920-620 Mass, w/ E&W Win.	-1.276	-1.290	-1.203	-1.329	-1.431	-1.292	-1.431	-1.203	-1.303	17.5%	-1.292
930-630 Mass w/ E&W Shade	-0.913	-0.945	-0.879	-0.917	-0.942	-0.901	-0.945	-0.879	-0.916	7.2%	-0.900
940-640 Mass, w/ Htg. Setback	-3.191	-3.247	-2.894	-3.339	-3.465	-3.274	-3.465	-2.894	-3.235	17.7%	-3.274
950-650 Mass, w/ Night Vent	-4.043	-4.056	-3.568	-4.110	-4.289	-3.991	-4.289	-3.568	-4.009	18.0%	-3.991
980-680 Mass, w/ Insulation 20/27	-2.437	-2.435	-2.174	-2.732	-2.755	-2.791	-2.791	-2.174	-2.554	24.2%	-2.792
985-685 Mass, w/ 20/20 Tstat	-1.857	-2.626	-2.358	-2.760	-2.872	-2.738	-2.872	-1.857	-2.535	40.0%	-2.736
995-695 Mass, w/ Insulation 20/20	-1.273	-1.772	-1.615	-1.969	-2.000	-1.975	-2.000	-1.273	-1.767	41.1%	-1.975
PEAK HEATING [kW]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
800-430 Mass, w/ High Cond. Wall	-0.343	-0.476	-0.496	-0.393	-0.445	-0.442	-0.496	-0.343	-0.432	35.4%	-0.386
900-800 Himass, S. Win.	-0.406	-0.334	-0.411	-0.236	-0.207	-0.188	-0.411	-0.188	-0.297	74.9%	-0.202
900-810 Himass, Int. Sol. Abs.		-0.057	-0.059	-0.062	-0.062	-0.066	-0.066	-0.057	-0.061	15.4%	-0.066
910-610 Mass, w/ S. Shade	-0.405	-0.552	-0.565	-0.493	-0.549	-0.560	-0.565	-0.405	-0.521	30.7%	-0.480
920-620 Mass, w/ E&W Win.	-0.250	-0.525	-0.555	-0.459	-0.547	-0.520	-0.555	-0.250	-0.476	64.1%	-0.462
930-630 Mass w/ E&W Shade	-0.284	-0.502	-0.523	-0.422	-0.494	-0.487	-0.523	-0.284	-0.452	52.9%	-0.431
940-640 Mass, w/ Htg. Setback	-0.751	-1.171	-0.999	-1.416	-0.979	-0.634	-1.416	-0.634	-0.992	78.9%	-0.843
980-680 Mass, w/ Insulation 20/27	-0.433	-0.524	-0.429	-0.515	-0.549	-0.523	-0.549	-0.429	-0.495	24.2%	-0.522
985-685 Mass, w/ 20/20 Tstat	-0.415	-0.580	-0.596	-0.528	-0.605	-0.589	-0.605	-0.415	-0.552	34.4%	-0.520
995-695 Mass, w/ Insulation 20/20	-0.427	-0.426	-0.393	-0.450	-0.465	-0.456	-0.465	-0.393	-0.436	16.5%	-0.456
PEAK SENSIBLE COOLING [kW]							Statistics for Example Results				TRNSYS18
CASES	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
800-430 Mass, w/ High Cond. Wall	-0.881	-0.738	-0.683	-0.884	-0.822	-0.768	-0.884	-0.683	-0.796	25.2%	-0.770
900-800 Himass, S. Win.	1.753	2.275	1.399	1.995	1.844	2.004	1.399	2.275	1.878	46.6%	1.998
900-810 Himass, Int. Sol. Abs.		0.966	0.616	0.770	0.717	0.827	0.616	0.966	0.779	44.9%	0.827
910-610 Mass, w/ S. Shade	-2.973	-3.710	-3.228	-3.912	-3.722	-3.787	-3.912	-2.973	-3.555	26.4%	-3.738
920-620 Mass, w/ E&W Win.	-1.223	-1.436	-1.245	-1.537	-1.523	-1.434	-1.537	-1.223	-1.400	22.4%	-1.434
930-630 Mass w/ E&W Shade	-1.069	-1.336	-1.191	-1.431	-1.477	-1.336	-1.477	-1.069	-1.307	31.2%	-1.332
940-640 Mass, w/ Htg. Setback	-2.492	-3.053	-2.809	-3.257	-3.236	-3.029	-3.257	-2.492	-2.979	25.7%	-3.029
950-650 Mass, w/ Night Vent	-3.282	-3.926	-2.991	-3.751	-3.759	-3.561	-3.926	-2.991	-3.545	26.4%	-3.561
980-680 Mass, w/ Insulation 20/27	-2.377	-3.383	-2.931	-3.320	-3.335	-3.244	-3.383	-2.377	-3.098	32.5%	-3.244
985-685 Mass, w/ 20/20 Tstat	-2.341	-2.934	-2.863	-3.192	-3.198	-2.983	-3.198	-2.341	-2.918	29.4%	-2.982
995-695 Mass, w/ Insulation 20/20	-2.103	-3.317	-3.040	-3.157	-3.285	-3.060	-3.317	-2.103	-2.994	40.6%	-3.061

** ABS[(Max-Min) / (Mean of Example Simulation Results)]

**ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024**

Note: The statistics in the tables below are based on the listed example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8-11. Annual Transmissivity Coefficient of Windows

(ANNUAL UNSHADED TRANSMITTED SOLAR RADIATION)/(ANNUAL UNSHADED INCIDENT SOLAR RADIATION)

Simulation Model: Case	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Statistics for Example Results				TRNSYS18
							Min	Max	Mean	(Max-Min)/ Mean* (%)	
600 South	0.591	0.627	0.624	0.587	0.597	0.594	0.587	0.627	0.603	6.7%	0.594
620 West	0.600		0.629	0.601	0.616	0.640	0.600	0.640	0.617	6.5%	0.640
660 South, Low-E	0.322	0.381	0.392	0.318	0.325	0.324	0.318	0.392	0.344	21.6%	0.324
670 South, Single-Pane	0.748	0.750	0.770	0.747	0.754	0.751	0.747	0.770	0.753	3.1%	0.751

* ABS[(Max-Min) / (Mean of Example Simulation Results)]

Table B8-12. Annual Shading Coefficient of Window Shading Devices: Overhangs & Fins

(1-(ANNUAL SHADED TRANSMITTED SOLAR RADIATION))/(ANNUAL UNSHADED TRANSMITTED SOLAR RADIATION)

Simulation Model: Case	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Statistics for Example Results				TRNSYS18
							Min	Max	Mean	(Max-Min)/ Mean* (%)	
610/600 South	0.218	0.194	0.176	0.196	0.224	0.195	0.176	0.224	0.201	24.0%	0.197
630/620 West	0.268		0.299	0.278	0.342	0.286	0.268	0.342	0.294	25.2%	0.287

* ABS[(Max-Min) / (Mean of Example Simulation Results)]

Table B8-13. Case 600 Annual Incident Solar Radiation (kWh/m²)

Simulation Model: Case	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Statistics for Example Results				TRNSYS18
							Min	Max	Mean	(Max-Min)/ Mean* (%)	
Horizontal	1670	1663	1667	1664	1665	1669	1663	1670	1666	0.4%	1669
North	453	399	477	438	432	440	399	477	440	17.8%	440
East	1061	1027	1017	1062	1054	1068	1017	1068	1048	4.9%	1068
South	1387	1317	1291	1370	1363	1384	1291	1387	1352	7.1%	1384
West	997	903	906	967	961	974	903	997	951	9.9%	974

* ABS[(Max-Min) / (Mean of Example Simulation Results)]

Table B8-14. Annual Transmitted Solar Radiation - Unshaded (kWh/m²)

Simulation Model: Case	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Statistics for Example Results				TRNSYS18
							Min	Max	Mean	(Max-Min)/ Mean* (%)	
600 South	820	826	805	804	814	823	804	826	815	2.6%	823
620 West	598		569	581	592	624	569	624	593	9.2%	624
660 South	447	501	506	436	443	448	436	506	464	15.2%	448
670 South	1037	988	994	1024	1028	1039	988	1039	1018	5.0%	1039

* ABS[(Max-Min) / (Mean of Example Simulation Results)]

Table B8-15. Annual Transmitted Solar Radiation - Shaded (kWh/m²)

Simulation Model: Case	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Statistics for Example Results				TRNSYS18
							Min	Max	Mean	(Max-Min)/ Mean* (%)	
610 South	641	665	663	646	631	662	631	665	651	5.2%	661
630 West	438		399	419	390	446	390	446	418	13.4%	445

* ABS[(Max-Min) / (Mean of Example Simulation Results)]

**ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF
(TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024**

Note: The statistics in the tables below are based on the listed example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8-16. Sky Temperature Output, Case 600

MAXIMUM ANNUAL HOURLY INTEGRATED SKY TEMPERATURE																													
Simulation Model:	BSIMAC			CSE			DeST			EnergyPlus			ESP-r			TRNSYS			TestSpec-Alt Alternative Values				Example Result Statistics				TRNSYS18		
	T (°C)	Mo.	Day Hr	T (°C)	Mo.	Day Hr	T (°C)	Mo.	Day Hr	T (°C)	Mo.	Day Hr	T (°C)	Mo.	Day Hr	T (°C)	Mo.	Day Hr	T (°C)	Mo.	Day Hr	Min T (°C)	Max T (°C)	Mean T (°C)	(Max-Min)/ Mean** (%)	T (°C)	Mo.	Day Hr	
Average Annual Hourly Integrated				-3.9			-5.9			-2.0			-5.2			-5.1			-5.9			-5.9	-2.0	-4.7	83.2%	-5.1			
Minimum Annual Hourly Integrated				-46.2	Dec	31 24	-46.9	Dec	31 23	-38.0	Dec	31 24	-46.9	Dec	31 23	-46.2	Dec	31 24	-46.9			-46.9	-38.0	-45.2	19.8%	-46.2	Dec	31 24	
Maximum Annual Hourly Integrated				30.1	Jun	13 15	24.6	Aug	4 15	24.7	Aug	4 16	26.7	Aug	4 15	26.0	Jun	13 18	24.6			24.6	30.1	26.1	20.9%	26.0	Jun	13 18	

** ABS[(Max-Min) / (Mean of Example Simulation Results)]

ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF (TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

Note: The statistics in the tables below are based on the listed example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B8-M1. Monthly Heating Loads (kWh)

Simulation Model:	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Statistics for Example Results				TRNSYS18
							Min	Max	Mean	(Max-Min)/ Mean** (%)	
Case 600											
Jan	664.0	655.6	672.7	711.9	732.0	734.9	655.6	734.9	695.2	11.4%	731.2
Feb	653.3	626.3	635.3	682.6	682.0	702.1	626.3	702.1	663.6	11.4%	702.1
Mar	433.5	435.7	450.5	472.2	481.0	495.0	433.5	495.0	461.3	13.3%	495.0
Apr	511.0	457.0	448.0	510.1	479.0	517.3	448.0	517.3	487.1	14.2%	517.3
May	112.8	127.8	128.0	136.8	139.0	150.7	112.8	150.7	132.5	28.6%	150.7
Jun	2.7	11.7	11.2	10.1	14.0	16.0	2.7	16.0	10.9	120.7%	16.0
Jul	4.8	11.5	10.1	12.0	14.0	16.7	4.8	16.7	11.5	103.0%	16.7
Aug	1.4	6.9	8.4	6.6	9.0	9.6	1.4	9.6	7.0	118.1%	9.6
Sep	51.8	74.3	76.7	73.3	81.0	84.8	51.8	84.8	73.7	44.9%	84.8
Oct	317.0	328.4	324.1	347.7	354.0	367.1	317.0	367.1	339.7	14.7%	367.1
Nov	598.7	575.6	585.8	625.3	629.0	645.8	575.6	645.8	610.0	11.5%	645.8
Dec	698.7	682.0	697.8	735.7	750.0	763.5	682.0	763.5	721.3	11.3%	763.6
Case 900											
Jan	277.8	206.1	275.3	255.8	266.0	291.9	206.1	291.9	262.2	32.7%	280.2
Feb	307.4	243.2	292.9	294.2	283.0	322.1	243.2	322.1	290.5	27.2%	322.2
Mar	134.4	102.4	120.0	125.5	115.0	143.8	102.4	143.8	123.5	33.5%	143.9
Apr	275.7	222.4	214.2	268.7	228.0	275.5	214.2	275.7	247.4	24.9%	275.5
May	20.1	33.3	26.8	33.4	29.0	37.5	20.1	37.5	30.0	58.0%	37.5
Jun	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	#DIV/0!	0.0
Jul	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	#DIV/0!	0.0
Aug	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	#DIV/0!	0.0
Sep	2.1	0.0	0.0	0.1	0.0	0.5	0.0	2.1	0.5	458.3%	0.5
Oct	80.5	65.1	63.6	81.1	70.0	85.0	63.6	85.0	74.2	28.9%	85.0
Nov	298.2	251.6	283.9	297.0	286.0	318.2	251.6	318.2	289.2	23.0%	318.3
Dec	329.8	254.7	314.3	307.9	308.0	339.4	254.7	339.4	309.0	27.4%	339.4

** ABS[(Max-Min) / (Mean of Example Simulation Results)]

Table B8-M2. Monthly Sensible Cooling Loads (kWh)

Simulation Model:	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Statistics for Example Results				TRNSYS18
							Min	Max	Mean	(Max-Min)/ Mean** (%)	
Case 600											
Jan	475.4	554.0	417.9	521.8	523.0	495.0	417.9	554.0	497.9	27.3%	495.0
Feb	349.2	394.3	315.4	387.5	398.0	367.4	315.4	398.0	368.6	22.4%	367.4
Mar	450.3	474.4	410.7	484.4	489.0	457.4	410.7	489.0	461.0	17.0%	457.4
Apr	218.7	220.1	230.2	240.5	263.0	235.4	218.7	263.0	234.6	18.9%	235.4
May	342.7	321.2	338.6	339.9	364.0	325.2	321.2	364.0	338.6	12.7%	325.2
Jun	578.3	497.4	526.4	539.6	550.0	516.1	497.4	578.3	534.6	15.1%	516.1
Jul	568.4	505.9	525.1	536.4	556.0	514.4	505.9	568.4	534.4	11.7%	514.4
Aug	658.2	606.5	621.1	648.5	674.0	634.1	606.5	674.0	640.4	10.5%	634.1
Sep	724.8	705.2	672.1	733.7	743.0	710.5	672.1	743.0	714.9	9.9%	710.5
Oct	628.4	676.1	611.1	675.3	681.0	649.5	611.1	681.0	653.6	10.7%	649.5
Nov	394.3	454.7	377.1	437.7	444.0	418.6	377.1	454.7	421.1	18.4%	418.5
Dec	433.3	503.3	386.2	481.9	476.0	456.1	386.2	503.3	456.1	25.7%	456.0
Case 900											
Jan	73.3	67.8	33.5	53.3	42.0	44.6	33.5	73.3	52.4	76.0%	44.5
Feb	24.0	15.1	4.7	12.3	11.0	9.2	4.7	24.0	12.7	151.4%	9.2
Mar	86.4	68.5	40.9	65.4	56.0	50.6	40.9	86.4	61.3	74.2%	50.5
Apr	29.3	12.3	18.3	18.5	22.0	16.1	12.3	29.3	19.4	87.8%	16.0
May	131.1	117.8	128.6	114.5	125.0	98.4	98.4	131.1	119.2	27.5%	98.3
Jun	447.5	372.3	408.5	401.3	404.0	365.8	365.8	447.5	399.9	20.4%	365.8
Jul	440.9	380.4	408.1	398.7	410.0	365.5	365.5	440.9	400.6	18.8%	365.5
Aug	532.6	485.7	510.2	510.3	531.0	487.6	485.7	532.6	509.6	9.2%	487.5
Sep	517.9	484.0	466.1	492.8	492.0	458.9	458.9	517.9	485.3	12.2%	458.8
Oct	296.2	305.6	269.6	292.7	281.0	260.9	260.9	305.6	284.3	15.7%	260.8
Nov	72.7	80.5	56.2	68.0	63.0	60.2	56.2	80.5	66.8	36.4%	60.1
Dec	62.1	73.7	38.1	60.9	48.0	49.5	38.1	73.7	55.4	64.4%	49.3

** ABS[(Max-Min) / (Mean of Example Simulation Results)]

RAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-9 (TRNSYS18) vs. Annex B8, Section B8.1 Example Results
By Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

Note: The statistics in the tables below are based on the listed example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.


Table B8-M5. Monthly Load 600-900 Sensitivity Tests

ANNUAL HEATING [MWh]							Statistics for Example Results				TRNSYS18
Month	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
Jan	386.2	449.5	397.4	456.0	466.0	443.0	386.2	466.0	433.0	18.4%	451.1
Feb	345.9	383.0	342.4	388.5	399.0	379.9	342.4	399.0	373.1	15.2%	379.9
Mar	299.1	333.3	330.5	346.7	366.0	351.2	299.1	366.0	337.8	19.8%	351.1
Apr	235.3	234.6	233.8	241.5	251.0	241.8	233.8	251.0	239.7	7.2%	241.8
May	92.7	94.4	101.2	103.4	110.0	113.2	92.7	113.2	102.5	20.1%	113.2
Jun	2.7	11.7	11.2	10.1	14.0	16.0	2.7	16.0	10.9	120.7%	16.0
Jul	4.8	11.5	10.1	12.0	14.0	16.7	4.8	16.7	11.5	103.0%	16.7
Aug	1.4	6.9	8.4	6.6	9.0	9.6	1.4	9.6	7.0	118.1%	9.6
Sep	49.7	74.3	76.7	73.2	81.0	84.3	49.7	84.3	73.2	47.3%	84.3
Oct	236.5	263.3	260.6	266.6	284.0	282.0	236.5	284.0	265.5	17.9%	282.0
Nov	300.5	324.0	301.9	328.3	343.0	327.6	300.5	343.0	320.9	13.3%	327.5
Dec	368.9	427.3	383.5	427.9	442.0	424.2	368.9	442.0	412.3	17.7%	424.2
ANNUAL SENSIBLE COOLING [MWh]							Statistics for Example Results				TRNSYS18
Month	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
Jan	402.1	486.2	384.4	468.5	481.0	450.4	384.4	486.2	445.4	22.8%	450.4
Feb	325.2	379.2	310.7	375.2	387.0	358.2	310.7	387.0	355.9	21.4%	358.2
Mar	363.9	405.8	369.8	419.0	433.0	406.8	363.9	433.0	399.7	17.3%	406.9
Apr	189.4	207.8	211.9	222.0	241.0	219.3	189.4	241.0	215.2	24.0%	219.3
May	211.6	203.3	210.0	225.4	239.0	226.8	203.3	239.0	219.4	16.3%	226.8
Jun	130.8	125.2	118.0	138.3	146.0	150.2	118.0	150.2	134.7	24.0%	150.3
Jul	127.5	125.4	117.0	137.7	146.0	148.9	117.0	148.9	133.7	23.8%	148.9
Aug	125.6	120.8	110.9	138.2	143.0	146.6	110.9	146.6	130.8	27.2%	146.6
Sep	206.9	221.2	206.0	240.9	251.0	251.6	206.0	251.6	229.6	19.9%	251.7
Oct	332.2	370.6	341.6	382.6	400.0	388.6	332.2	400.0	369.3	18.4%	388.7
Nov	321.6	374.3	320.9	369.7	381.0	358.4	320.9	381.0	354.3	17.0%	358.4
Dec	371.2	429.5	348.2	420.9	428.0	406.6	348.2	429.5	400.7	20.3%	406.7
PEAK HEATING [kW]							Statistics for Example Results				TRNSYS18
Month	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
Jan	0.778	0.943	0.858	1.075	1.030	0.980	0.778	1.075	0.944	31.4%	1.075
Feb	0.490	0.456	0.469	0.379	0.510	0.447	0.379	0.510	0.459	28.5%	0.446
Mar	0.501	0.422	0.419	0.370	0.470	0.429	0.370	0.501	0.435	30.1%	0.429
Apr	0.449	0.437	0.513	0.319	0.450	0.421	0.319	0.513	0.431	45.0%	0.421
May	0.350	0.450	0.445	0.356	0.520	0.454	0.350	0.520	0.429	39.6%	0.454
Jun	0.805	0.778	0.748	0.732	0.760	0.853	0.732	0.853	0.779	15.4%	0.853
Jul	0.599	0.540	0.512	0.514	0.570	0.619	0.512	0.619	0.559	19.1%	0.619
Aug	0.572	0.553	0.532	0.479	0.560	0.591	0.479	0.591	0.548	20.5%	0.591
Sep	1.116	1.120	1.114	1.065	1.190	1.017	1.017	1.190	1.104	15.7%	1.017
Oct	0.501	0.435	0.461	0.356	0.560	0.482	0.356	0.560	0.466	43.7%	0.482
Nov	0.828	0.764	0.730	0.790	0.830	0.744	0.730	0.830	0.781	12.8%	0.744
Dec	1.051	1.014	0.991	1.030	1.130	1.098	0.991	1.130	1.052	13.2%	1.098
PEAK SENSIBLE COOLING [kW]							Statistics for Example Results				TRNSYS18
Month	BSIMAC	CSE	DeST	EnergyPlus	ESP-r	TRNSYS	Min	Max	Mean	(Max-Min)/ Mean** (%)	
Jan	3.668	4.239	3.785	4.274	4.380	4.168	3.668	4.380	4.086	17.4%	4.168
Feb	3.825	4.397	3.856	4.558	4.570	4.326	3.825	4.570	4.255	17.5%	4.326
Mar	2.950	3.714	3.109	3.515	3.770	3.314	2.950	3.770	3.395	24.2%	3.314
Apr	2.380	3.384	2.568	2.978	3.090	2.966	2.380	3.384	2.894	34.7%	2.966
May	1.219	1.652	1.448	1.553	1.640	1.576	1.219	1.652	1.515	28.6%	1.576
Jun	1.152	1.352	1.194	1.483	1.540	1.405	1.152	1.540	1.354	28.7%	1.405
Jul	1.179	1.347	1.325	1.560	1.670	1.522	1.179	1.670	1.434	34.3%	1.522
Aug	1.560	1.634	1.826	2.146	2.190	2.117	1.560	2.190	1.912	32.9%	2.117
Sep	2.125	2.313	2.355	2.726	2.770	2.549	2.125	2.770	2.473	26.1%	2.549
Oct	2.538	2.894	2.729	3.182	3.170	2.983	2.538	3.182	2.916	22.1%	2.983
Nov	3.494	3.916	3.546	4.192	4.090	3.883	3.494	4.192	3.854	18.1%	3.884
Dec	3.468	4.345	3.699	4.283	4.450	4.252	3.468	4.450	4.083	24.1%	4.253

** ABS[(Max-Min) / (Mean of Example Simulation Results)]

ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF (TRNSYS18) vs. Annex B8, Section B8.1 Example Results, by Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

**Figure B8-1.
Annual Incident Solar Radiation**

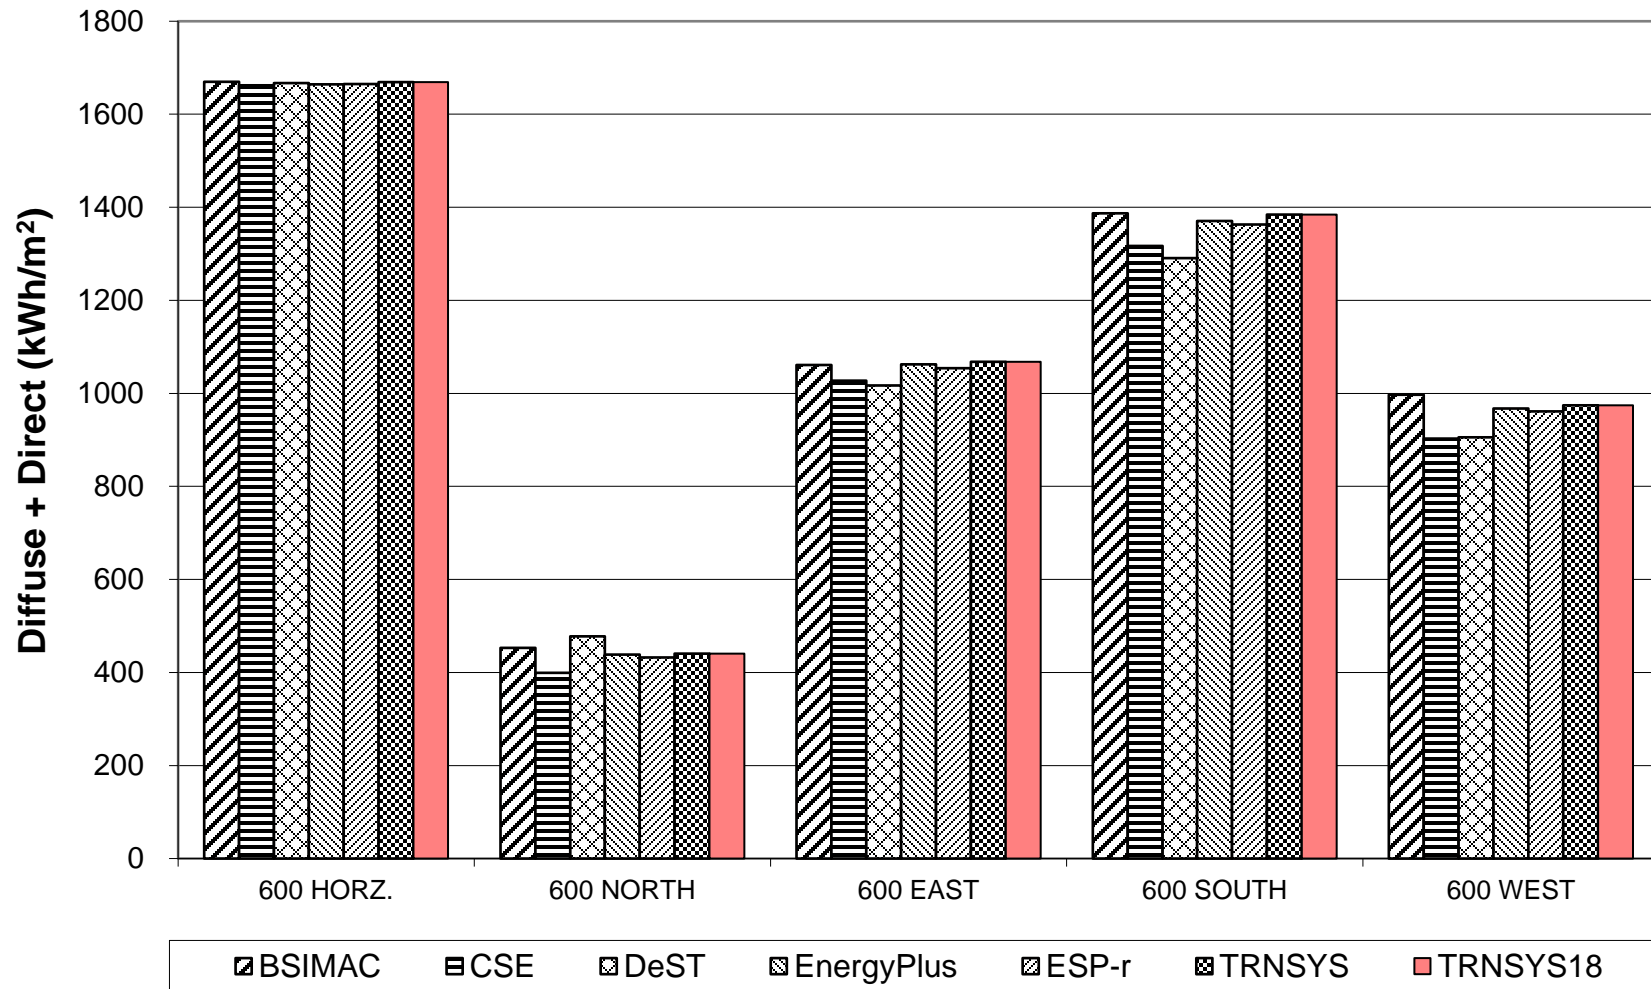

**Figure B8-2.
Annual Transmitted Solar Radiation - Unshaded**

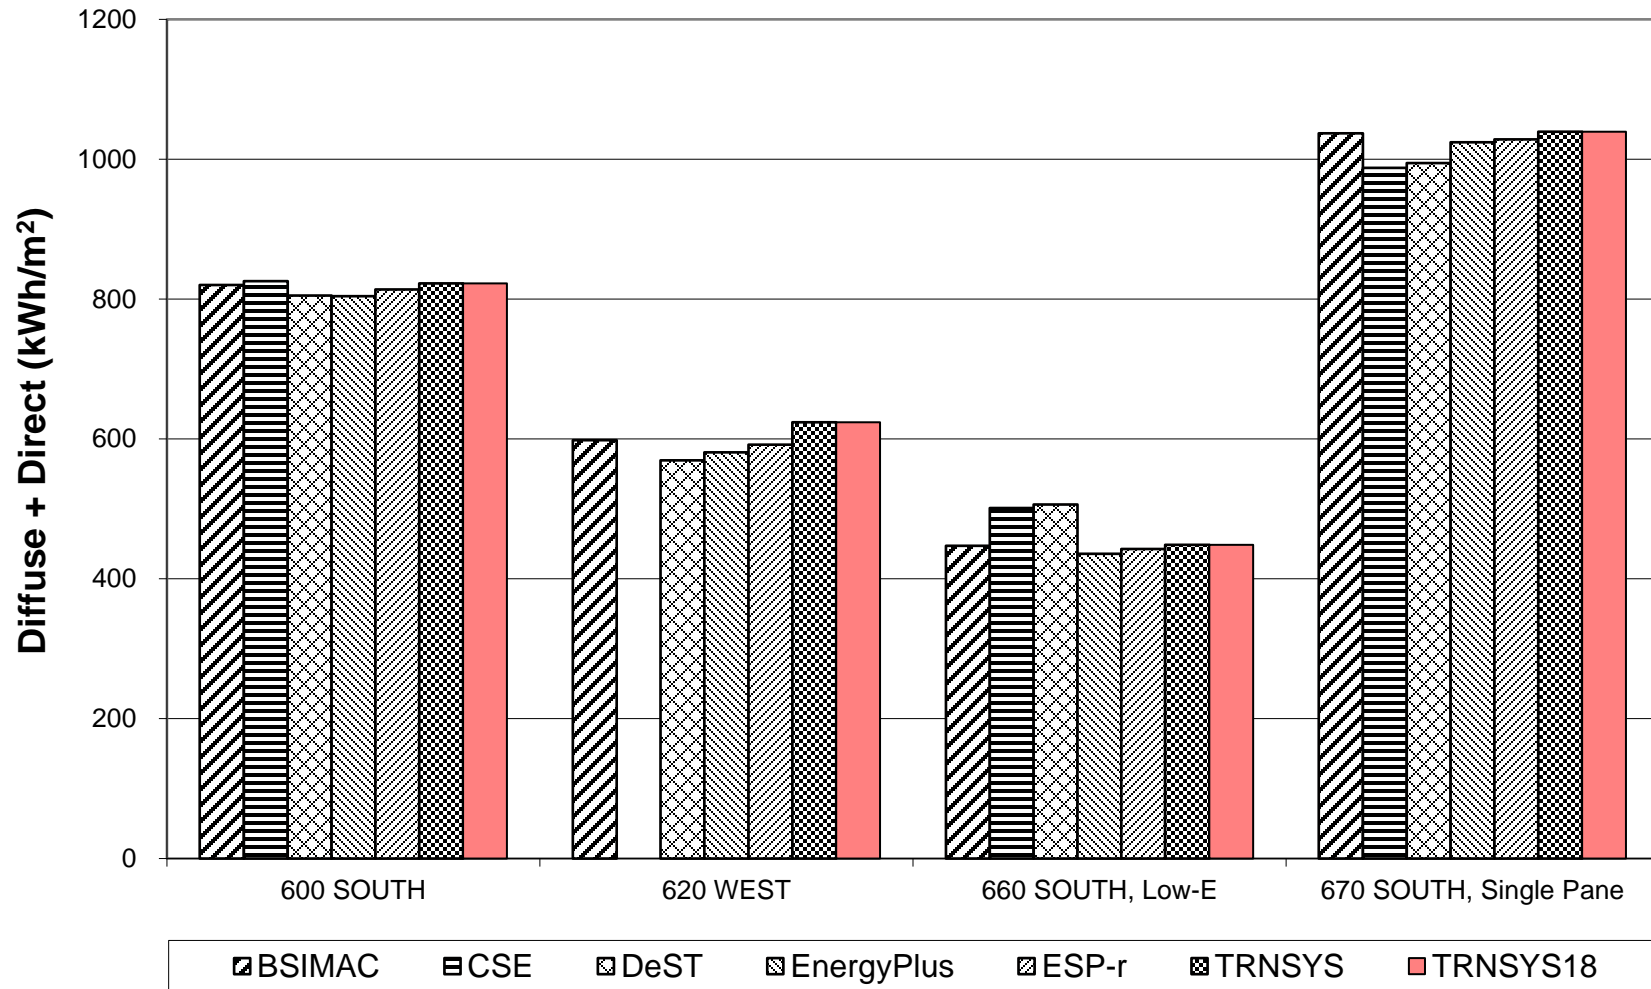


Figure B8-3.
Annual Transmitted Solar Radiation - Shaded

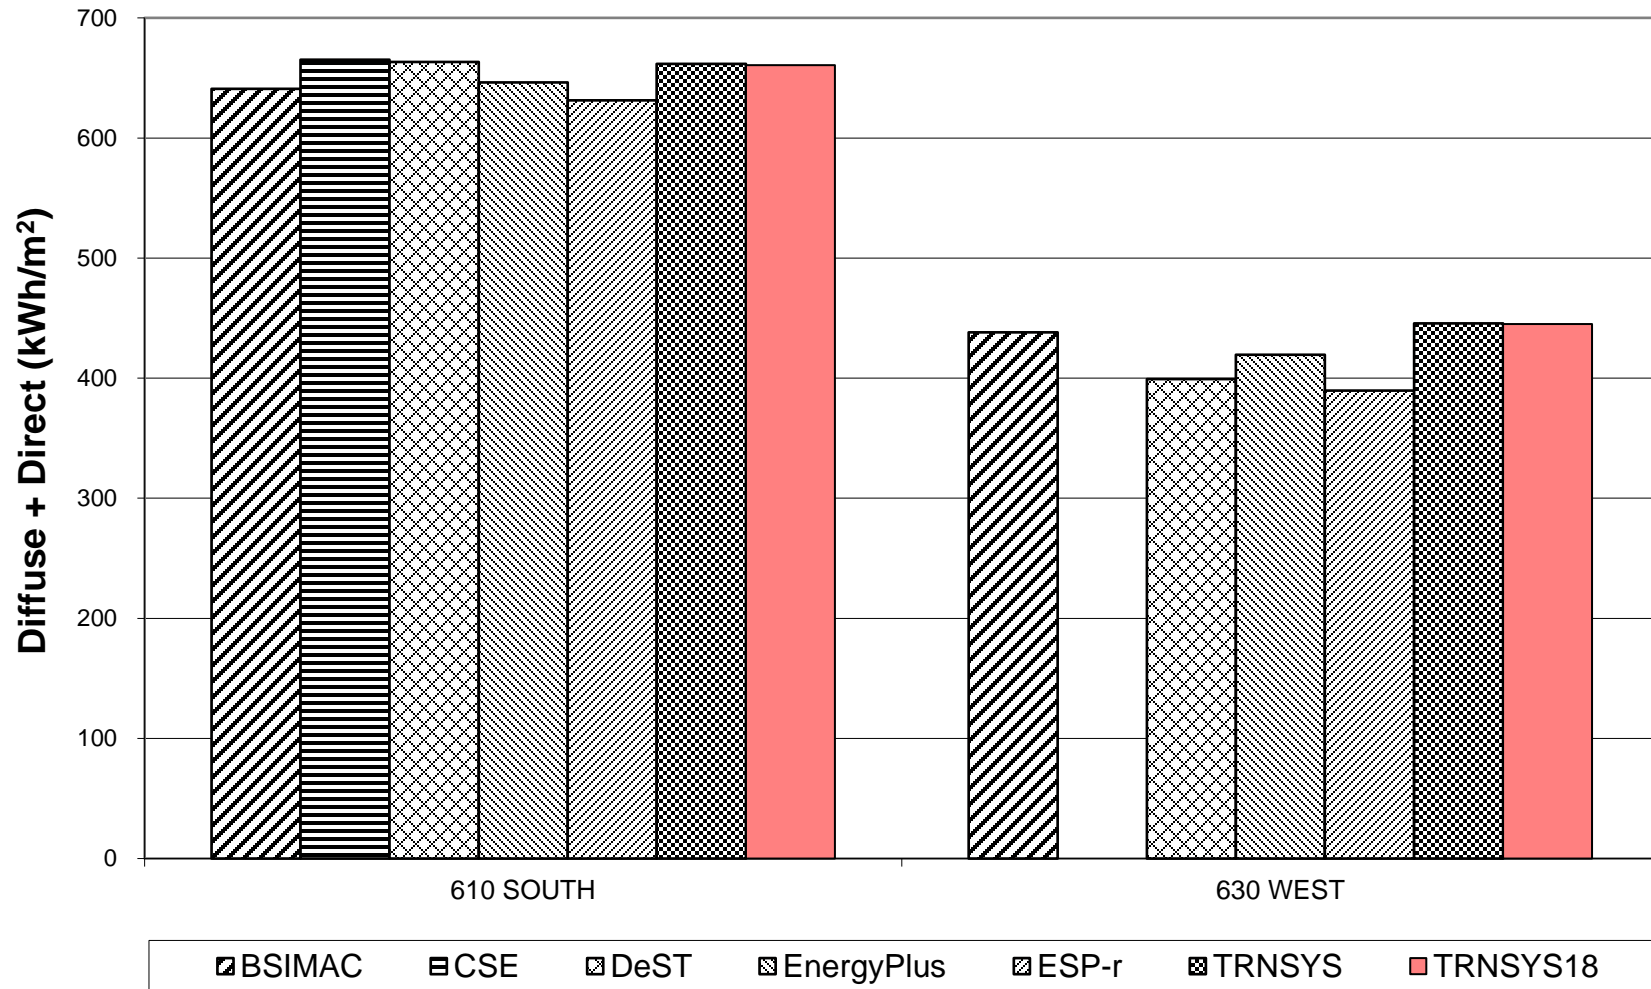


Figure B8-4.
Annual Transmissivity Coefficient of Windows
(Unshaded Transmitted)/(Incident Solar Radiation)

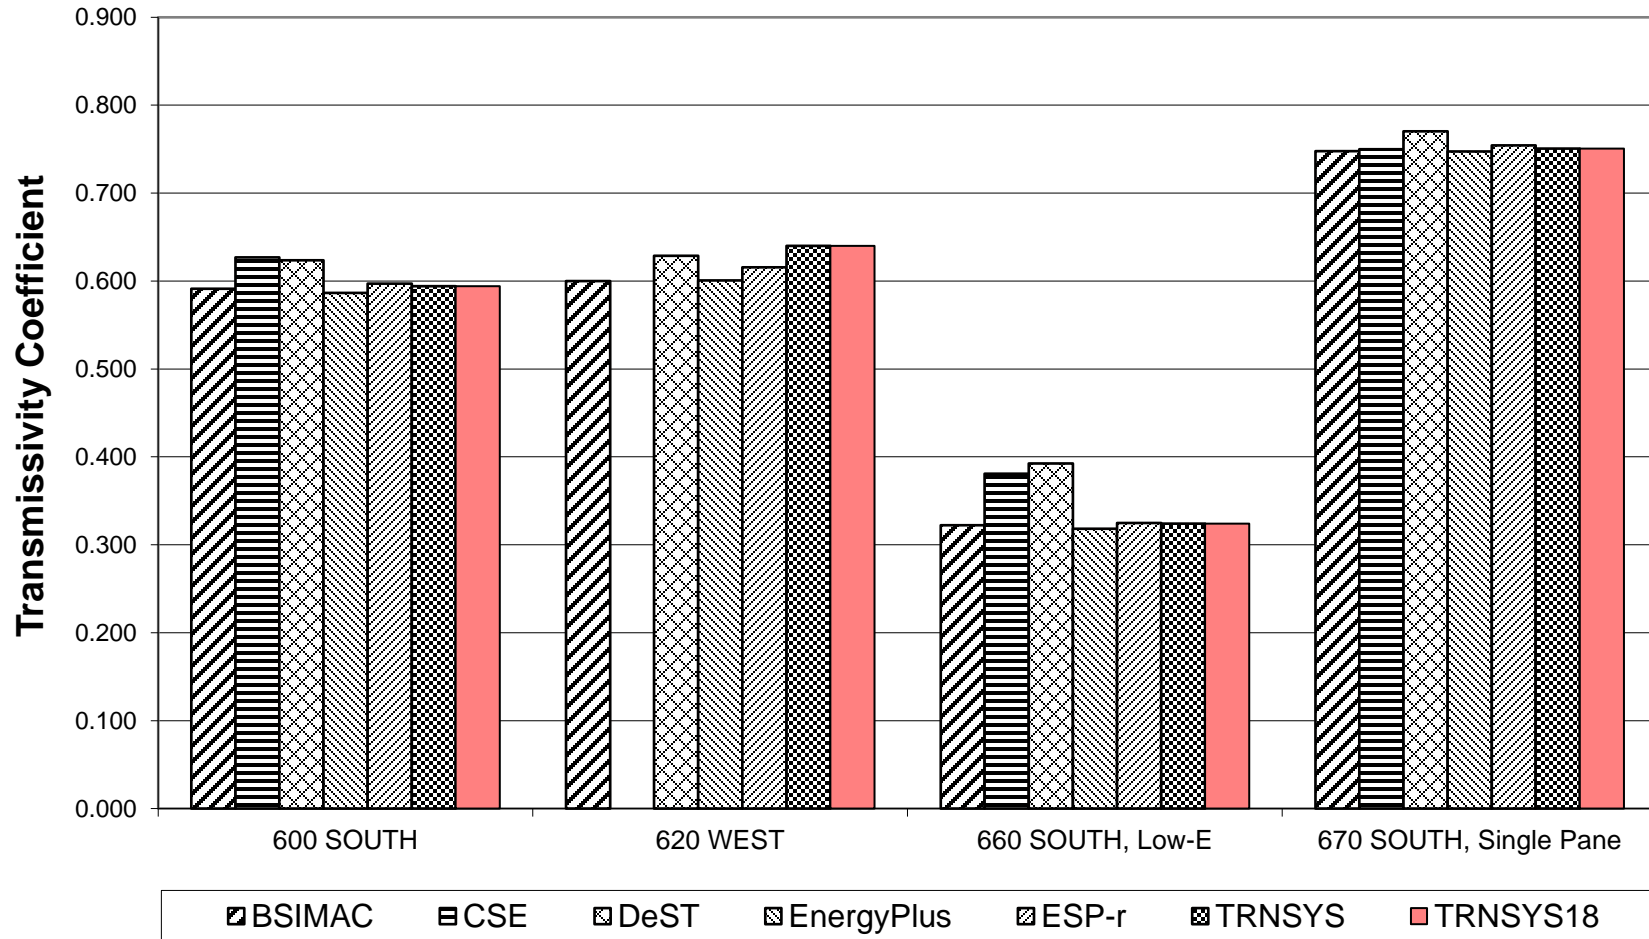


Figure B8-5.
Annual Overhang and Fin Shading Coefficients
(1-(Shaded)/(Unshaded)) Transmitted Solar Radiation



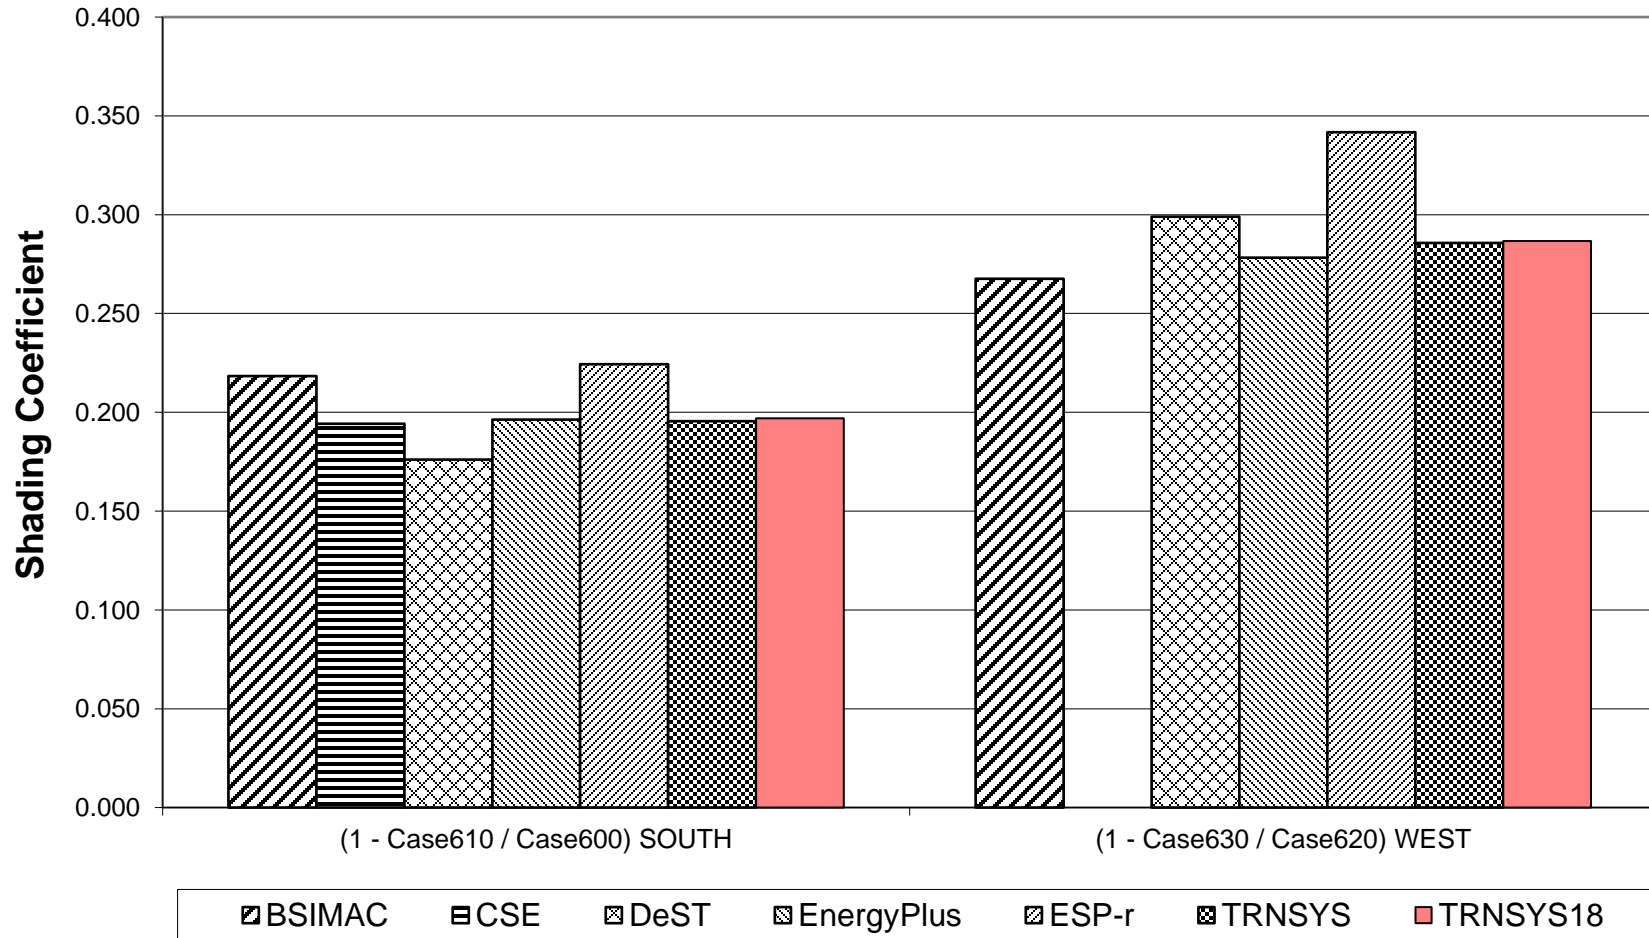


Figure B8-6.
Average, Minimum and Maximum Sky Temperature
Case 600

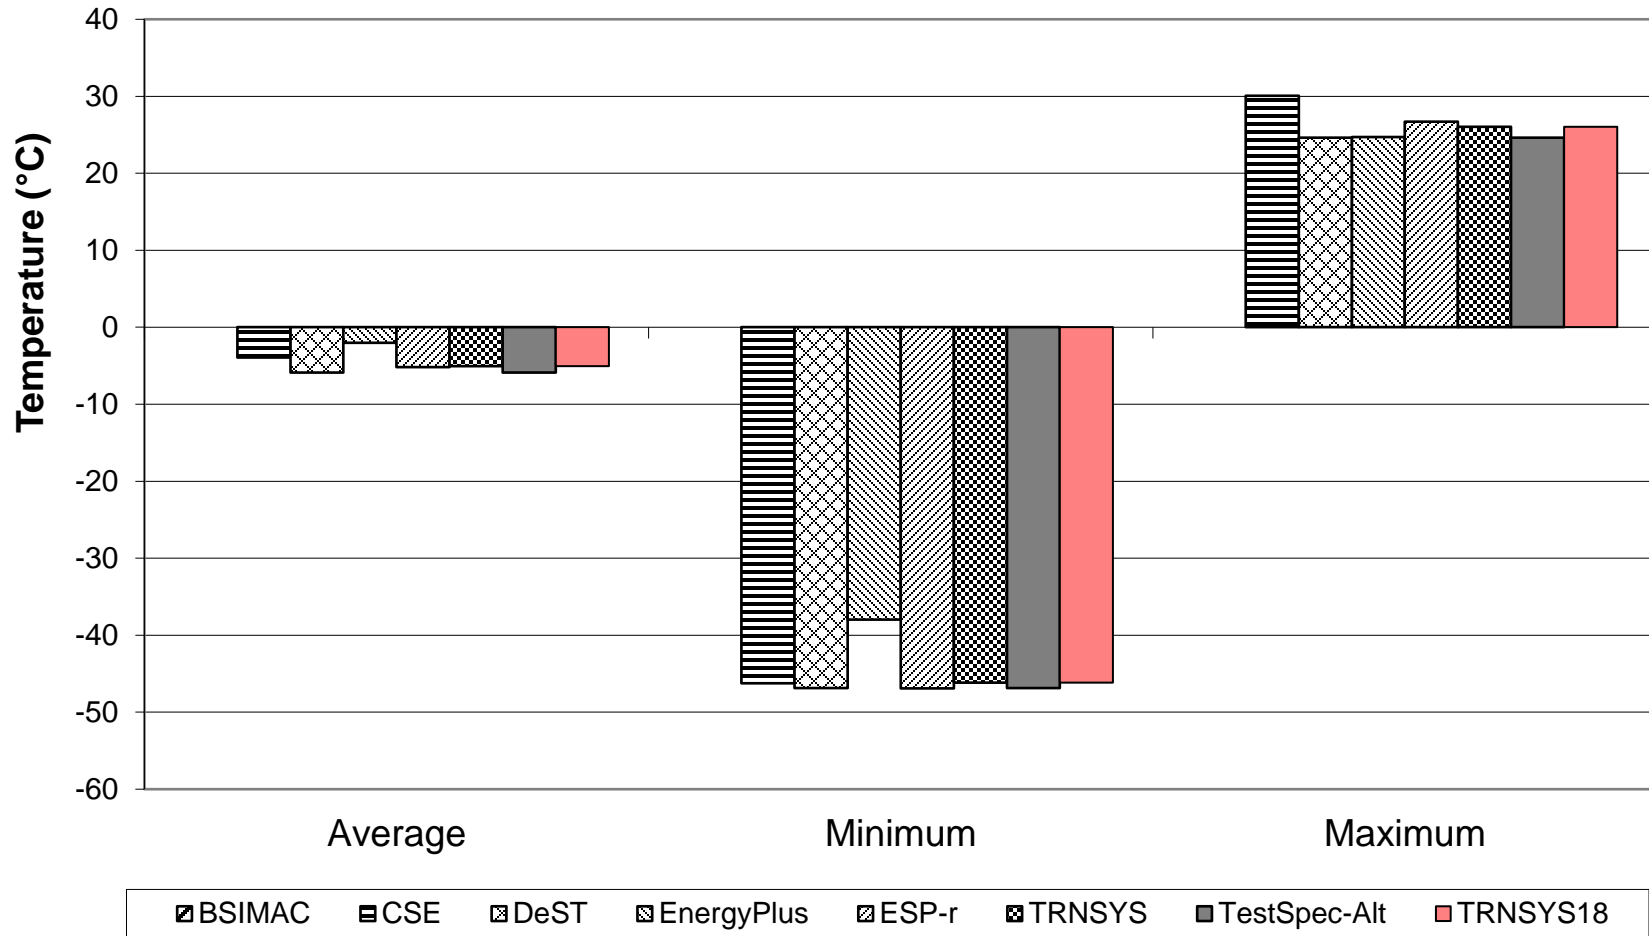


**Figure B8-7. Basic:
Low Mass Annual Heating**

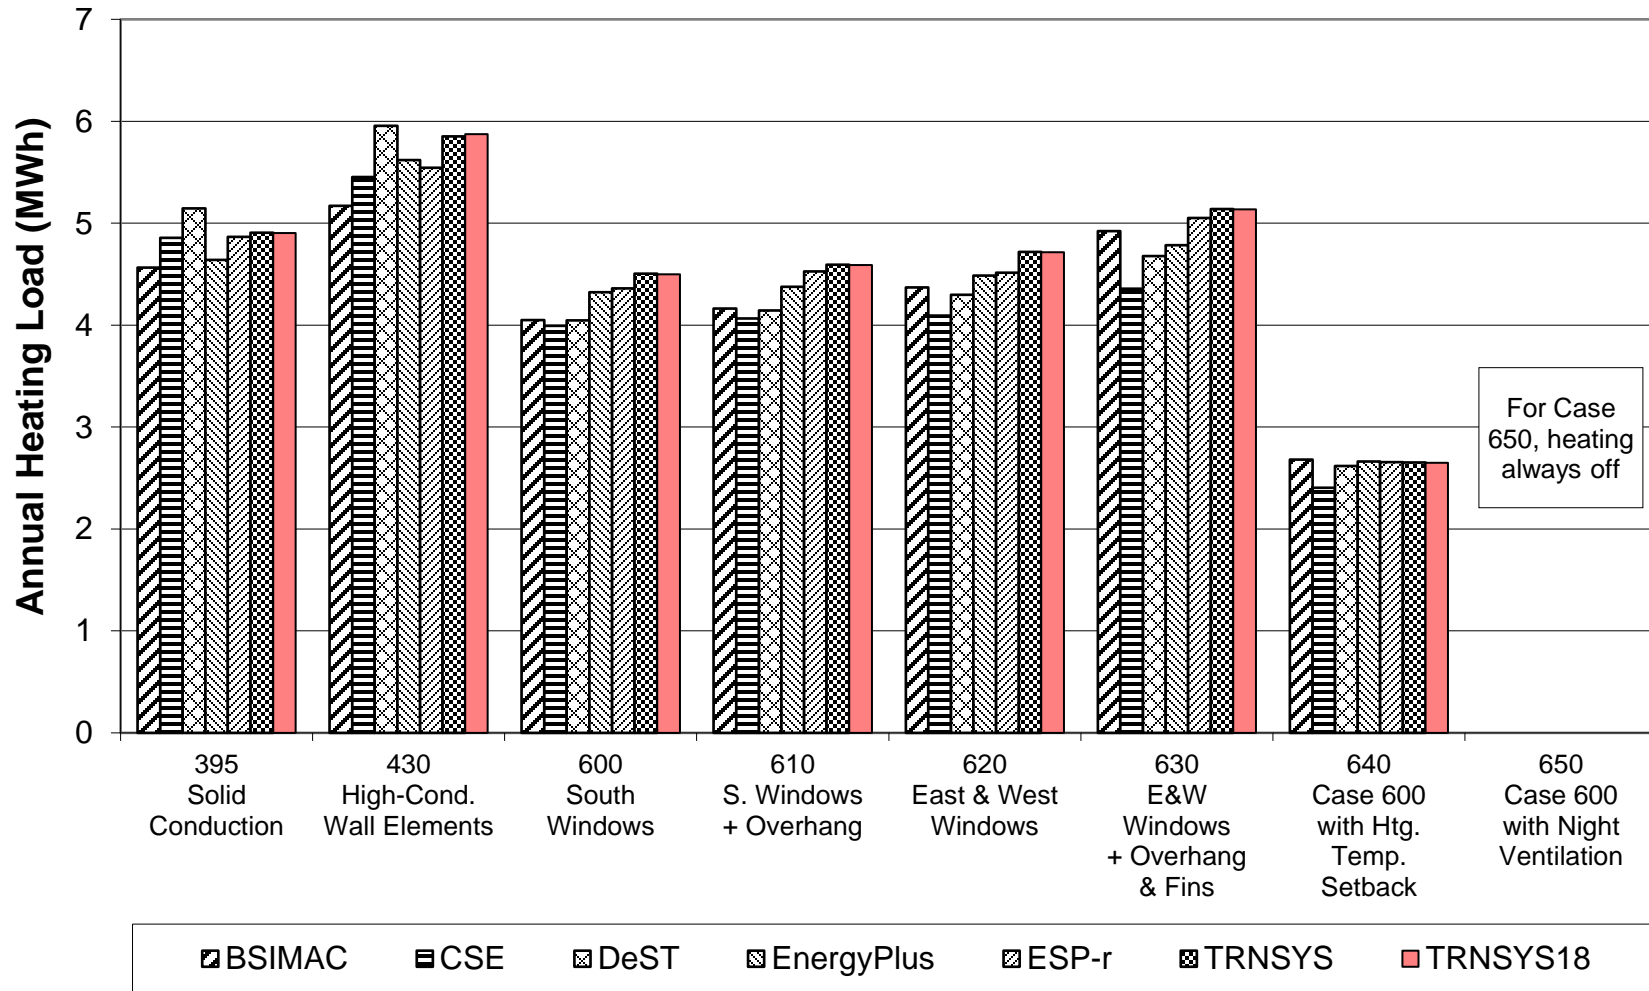


ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF (TRNSYS18) vs. Annex B8, Section B8.1 Example Results, by Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

**Figure B8-8. Basic:
Low Mass Annual Sensible Cooling**

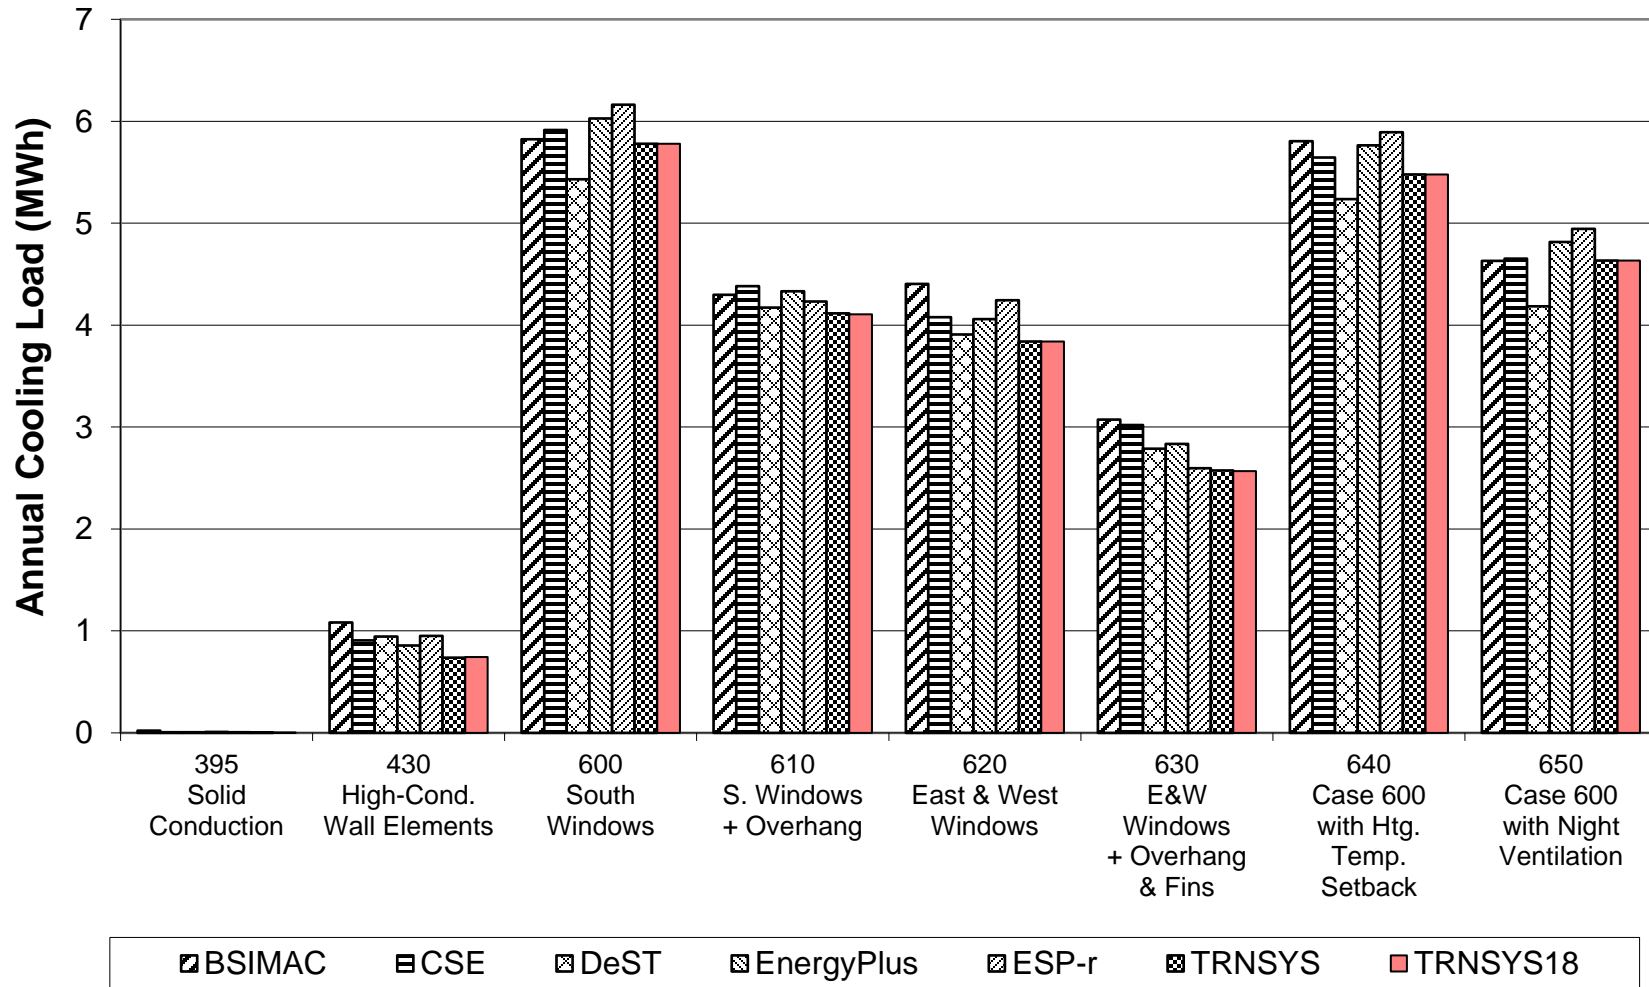


**Figure B8-9. Basic:
Low Mass Peak Heating**

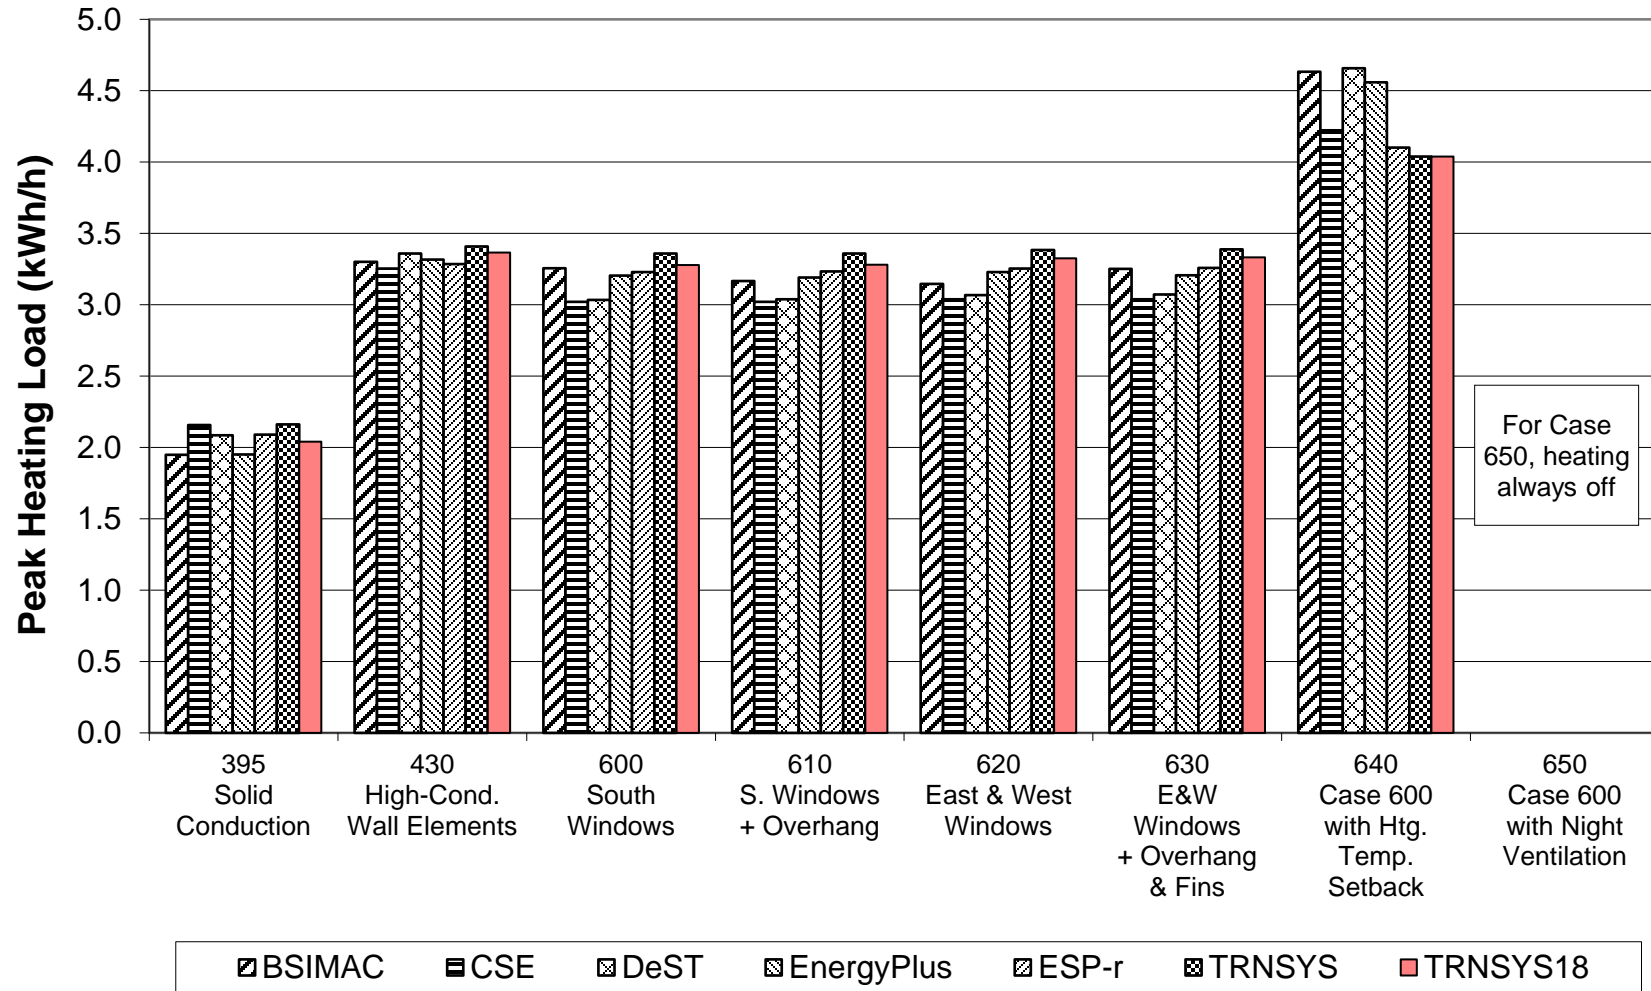


ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF (TRNSYS18) vs. Annex B8, Section B8.1 Example Results, by Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024


**Figure B8-10. Basic:
Low Mass Peak Sensible Cooling**

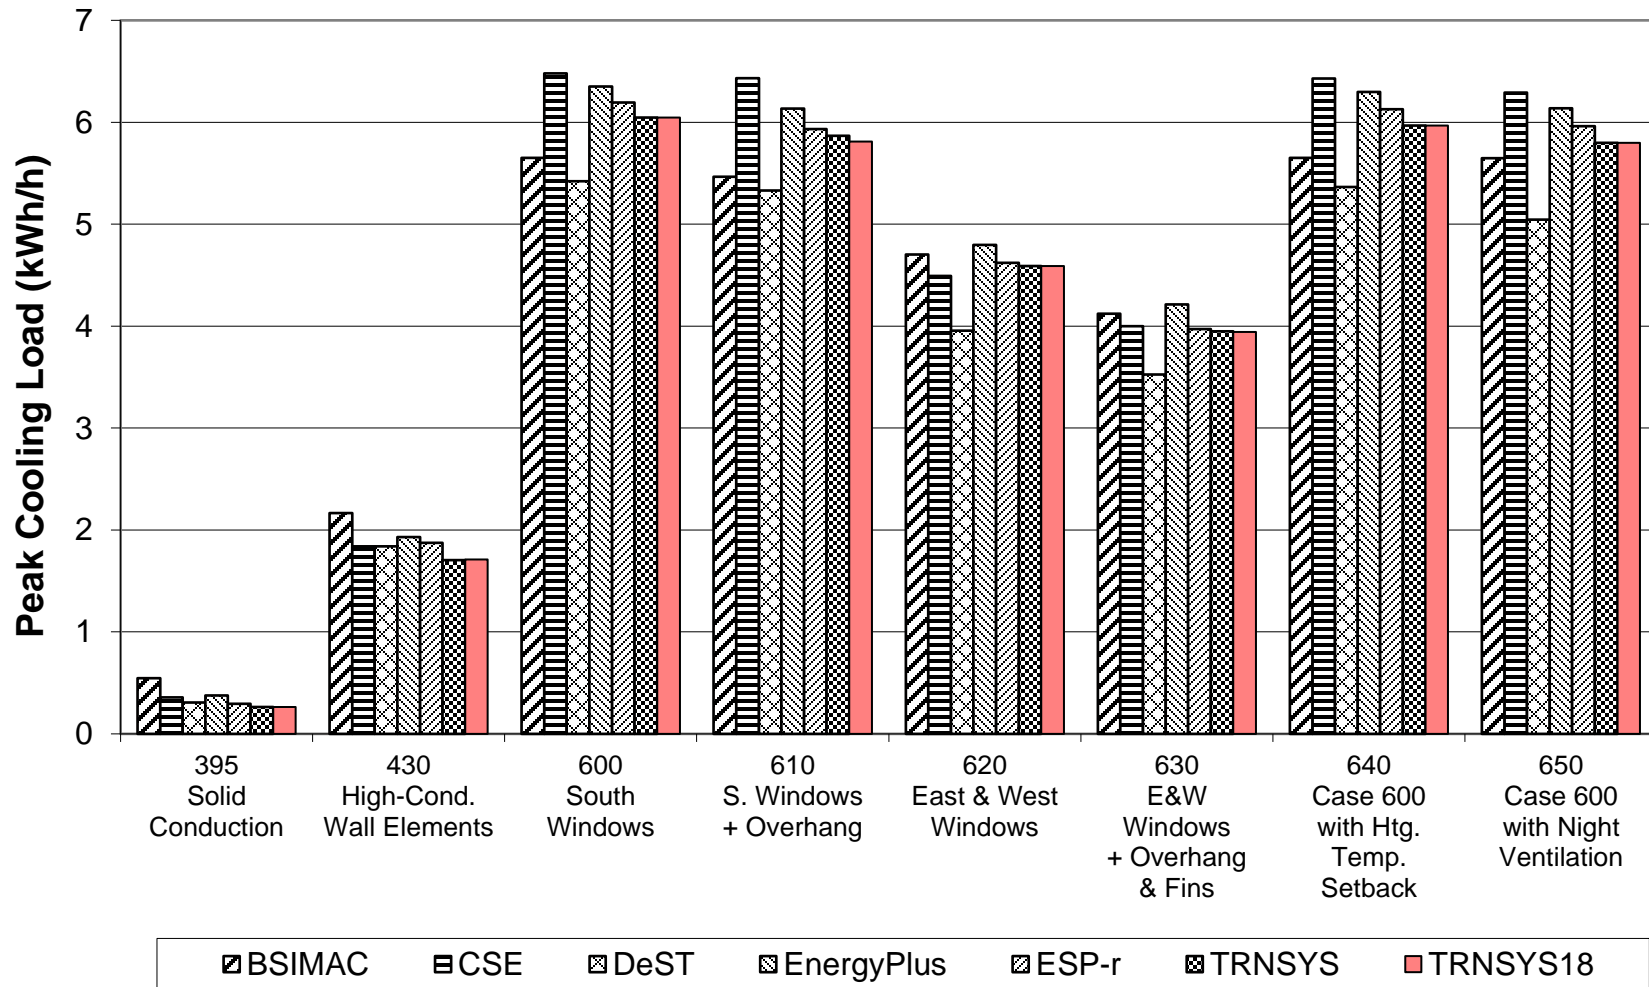


**Figure B8-11. Basic:
High Mass Annual Heating**

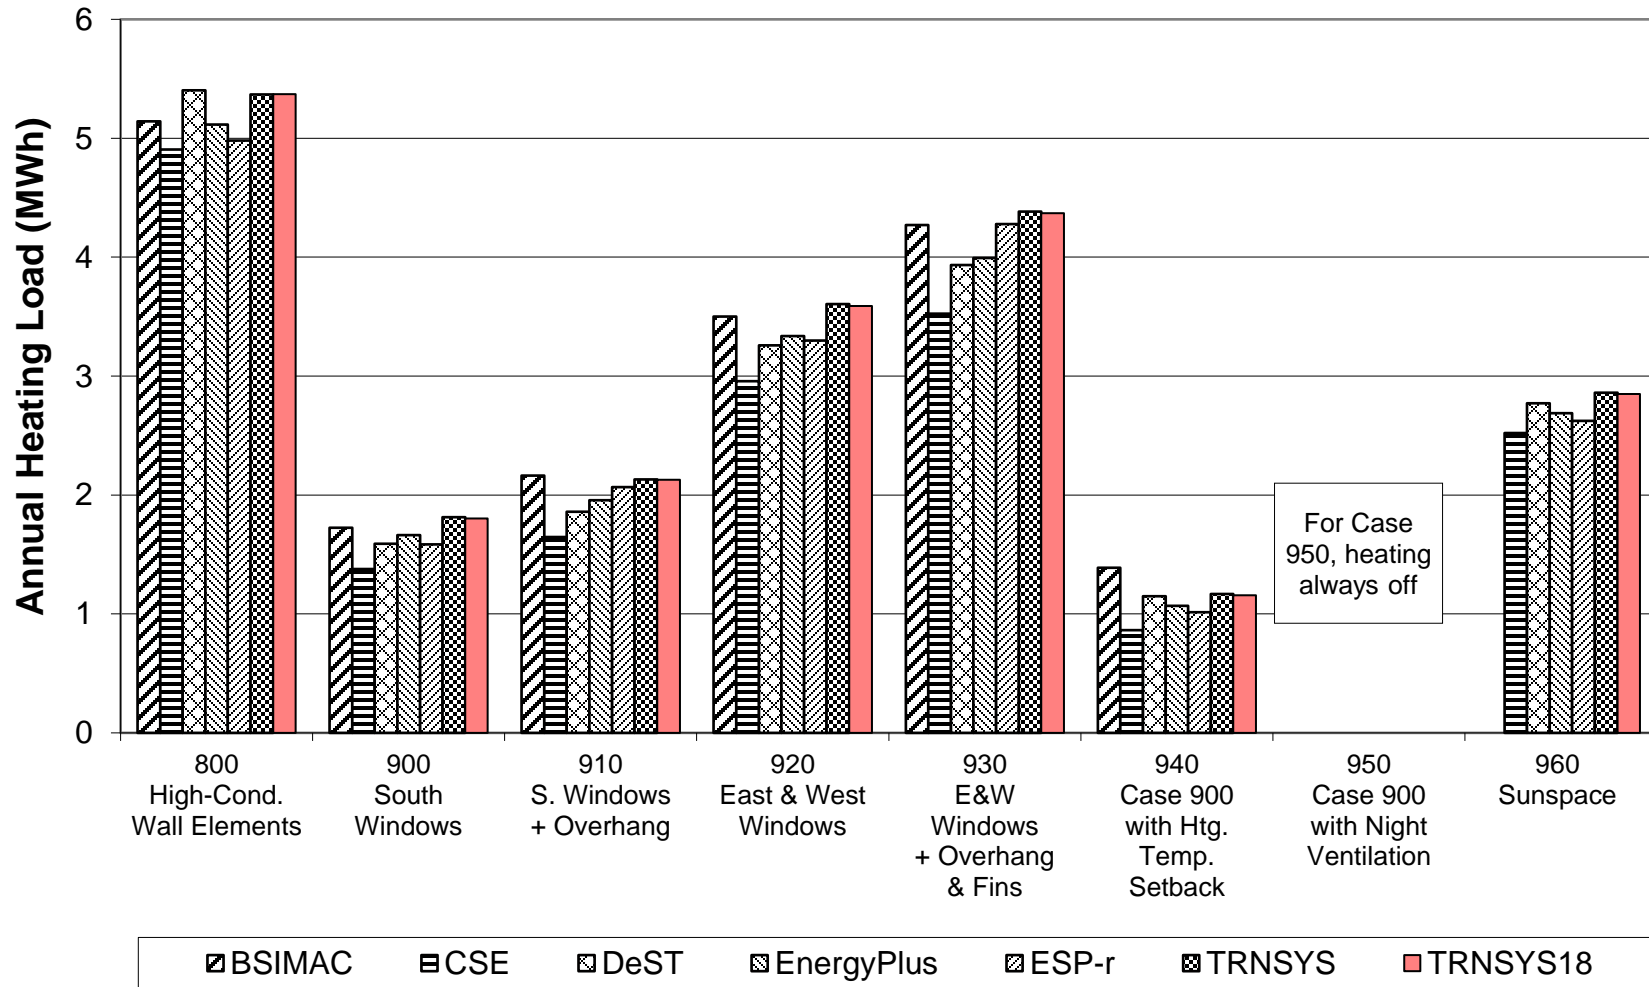


**Figure B8-12. Basic:
High Mass Annual Sensible Cooling**

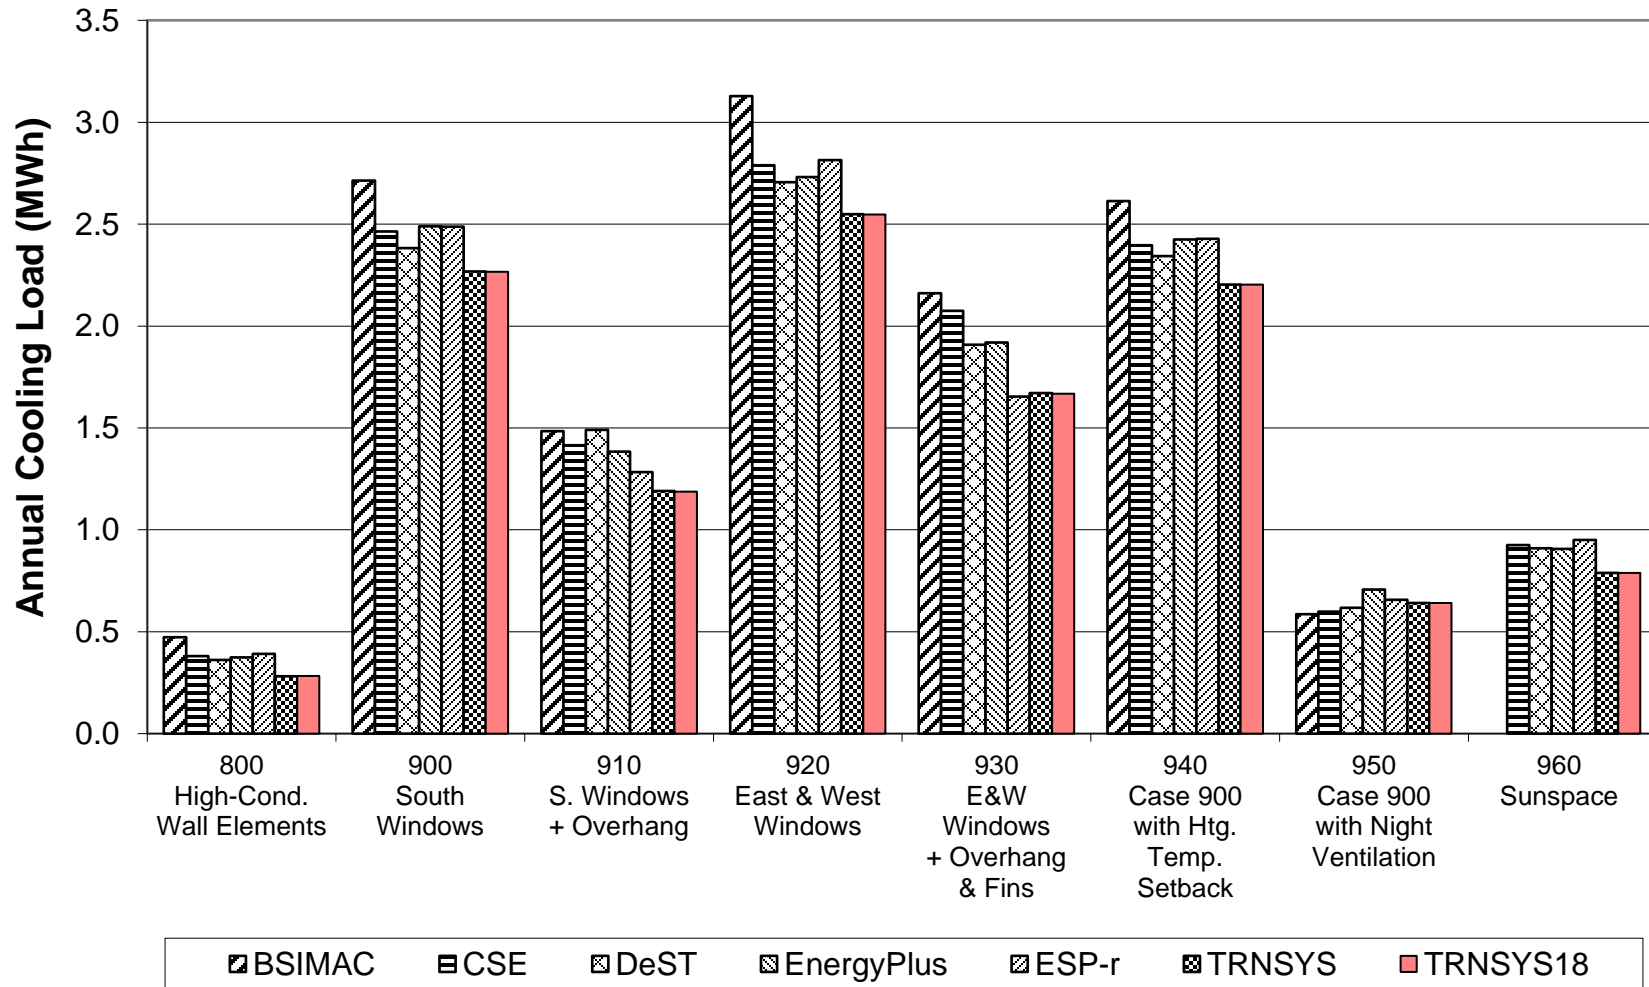


**Figure B8-13. Basic:
High Mass Peak Heating**

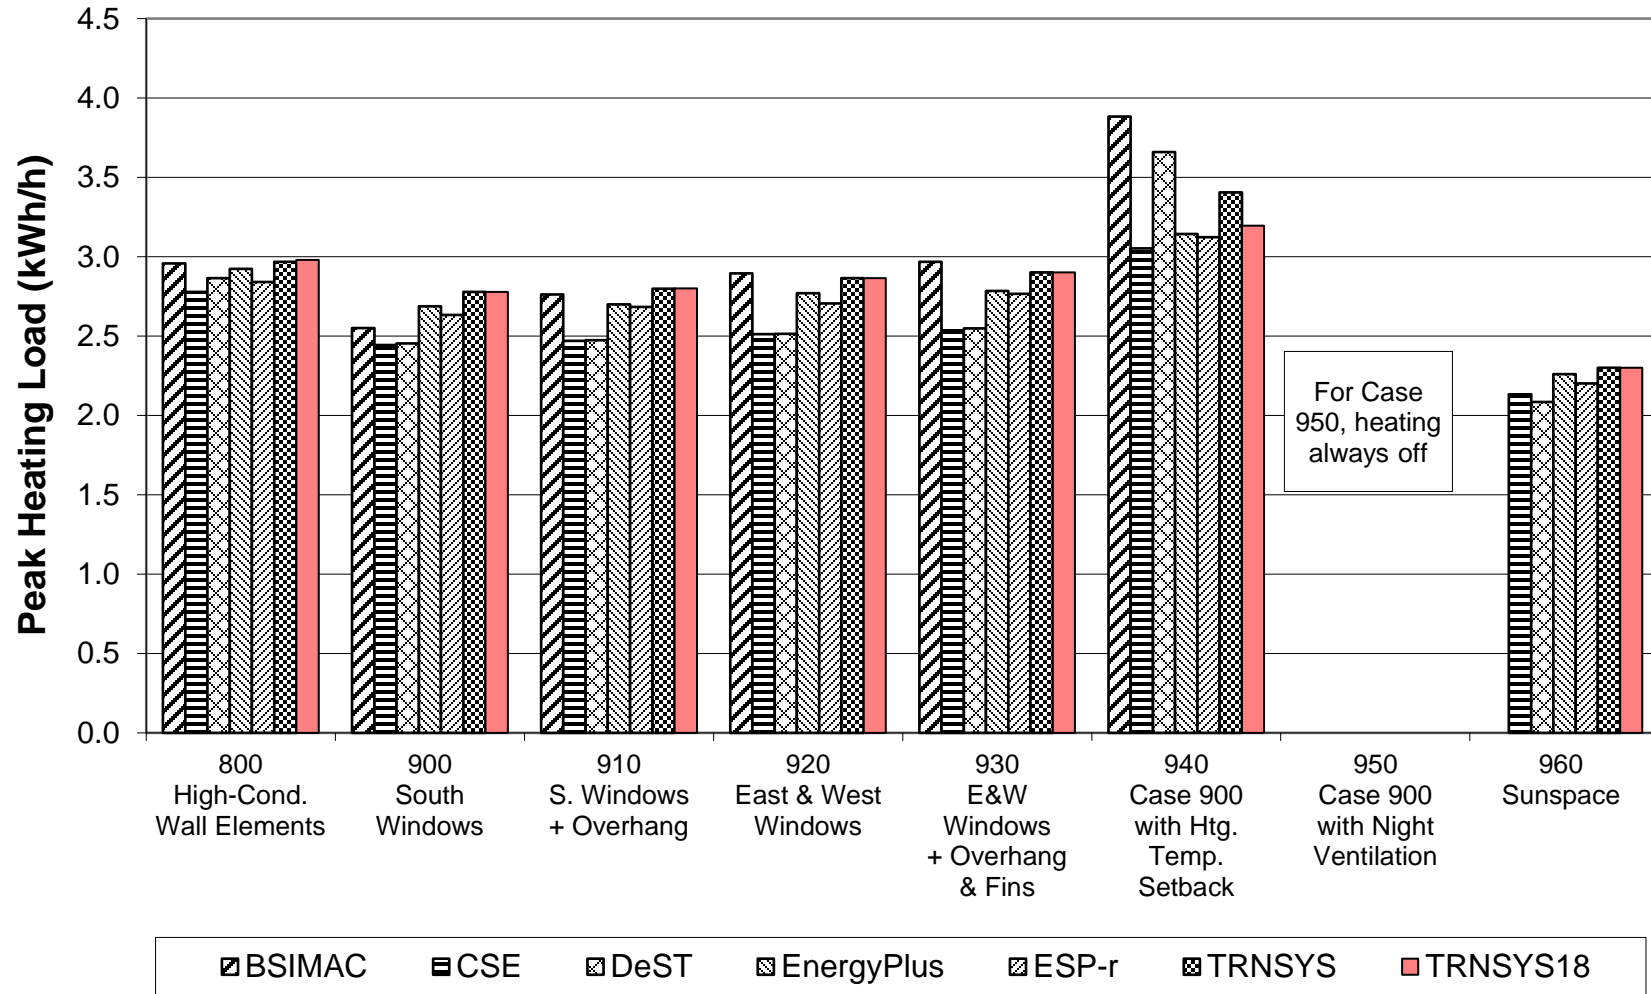


**Figure B8-14. Basic:
High Mass Peak Sensible Cooling**

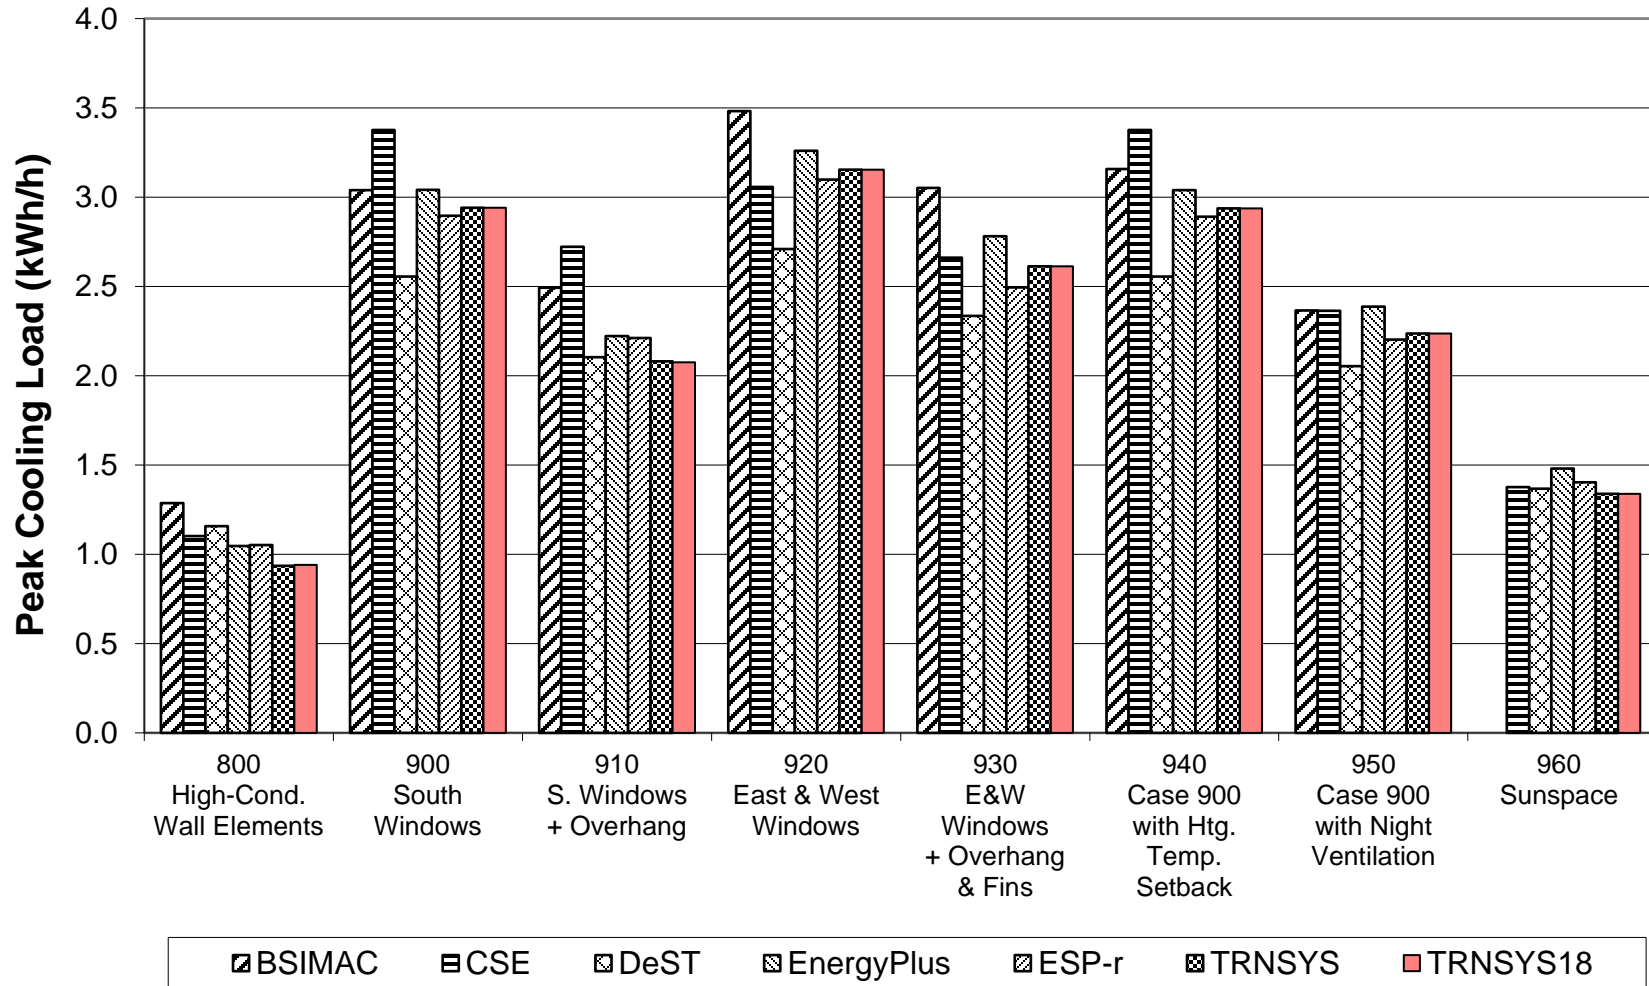


**Figure B8-15. Basic and In-Depth:
South Window (Delta)
Annual Heating and Sensible Cooling**

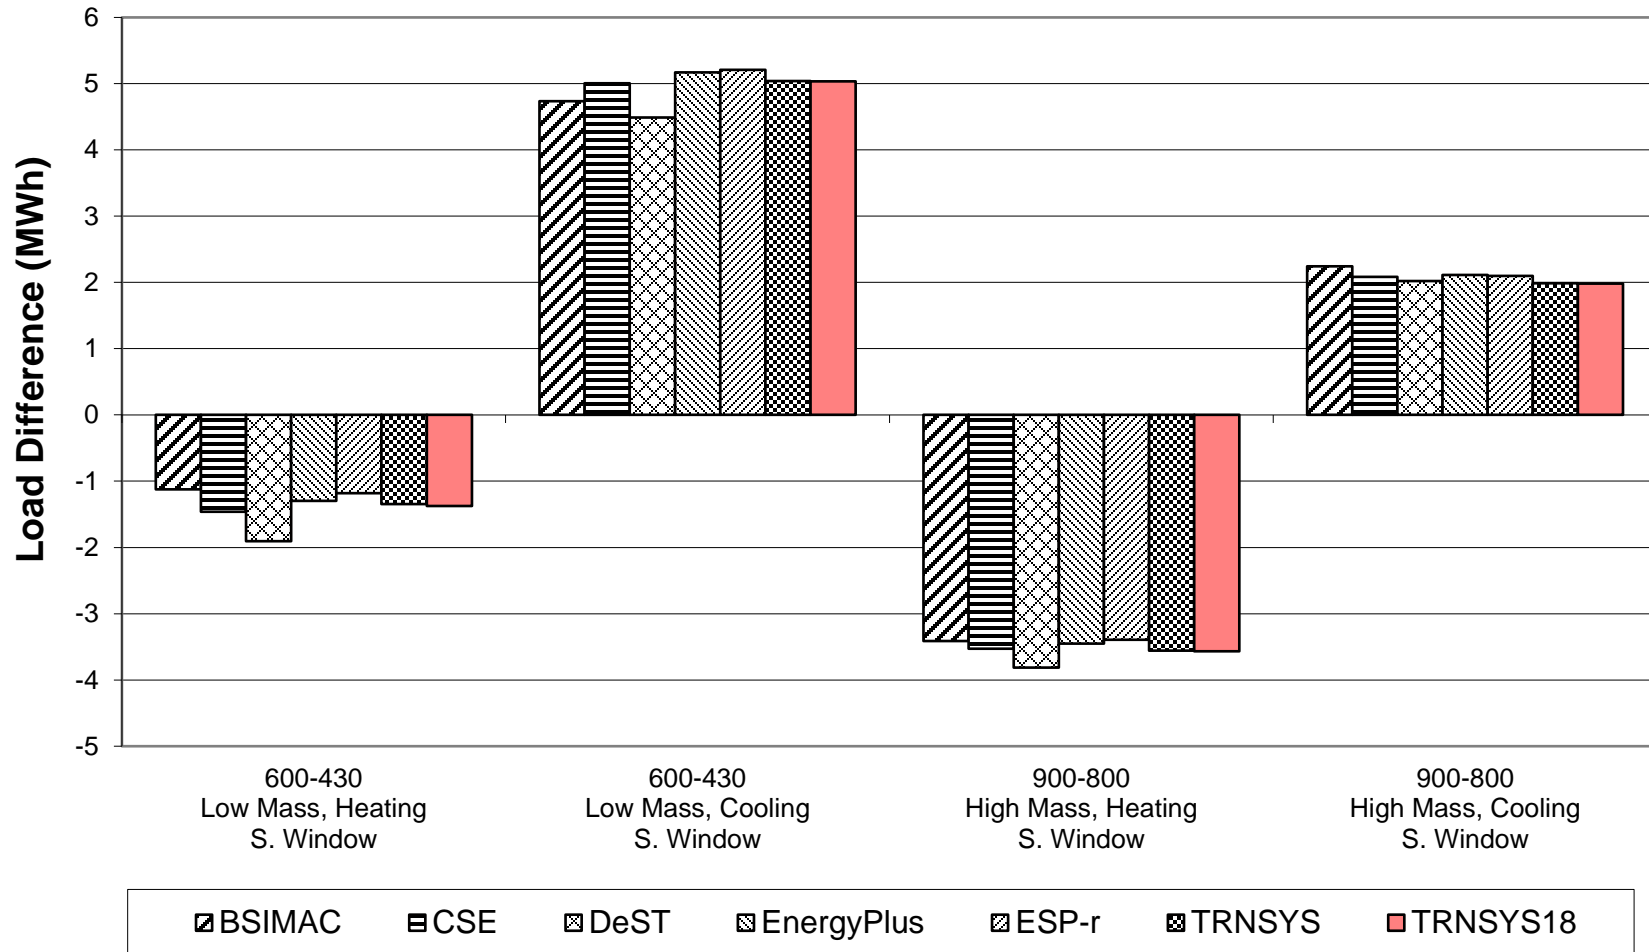


**Figure B8-16. Basic and In-Depth:
South Window (Delta)
Peak Heating and Sensible Cooling**

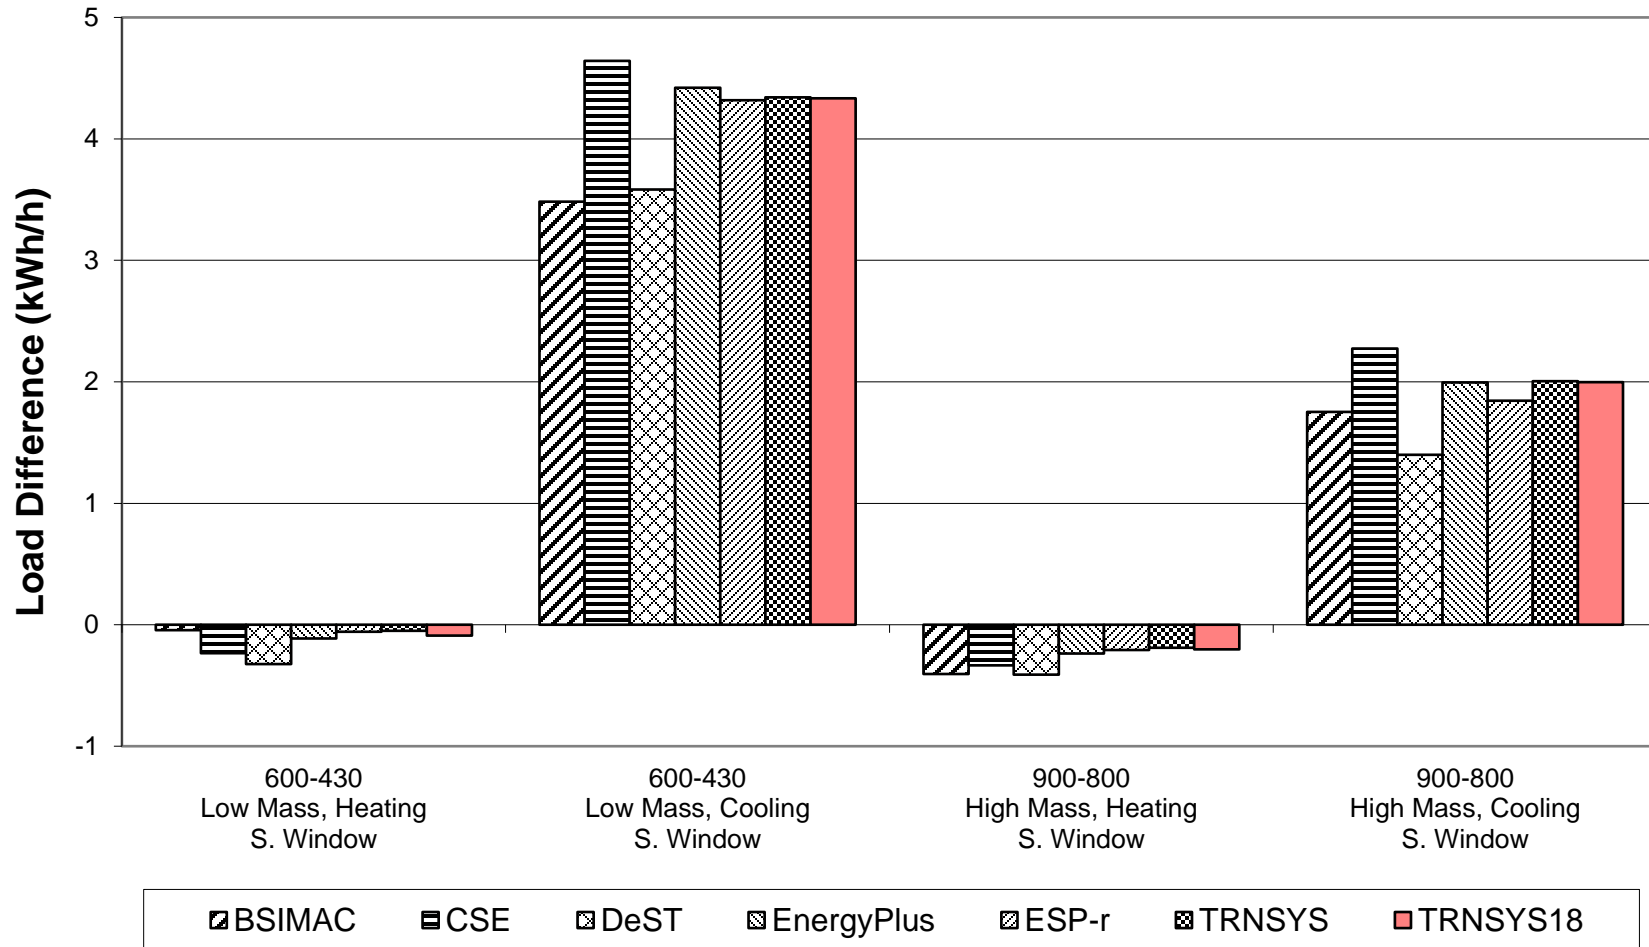


**Figure B8-17. Basic:
Window Shading and Orientation (Delta)
Annual Heating and Sensible Cooling**

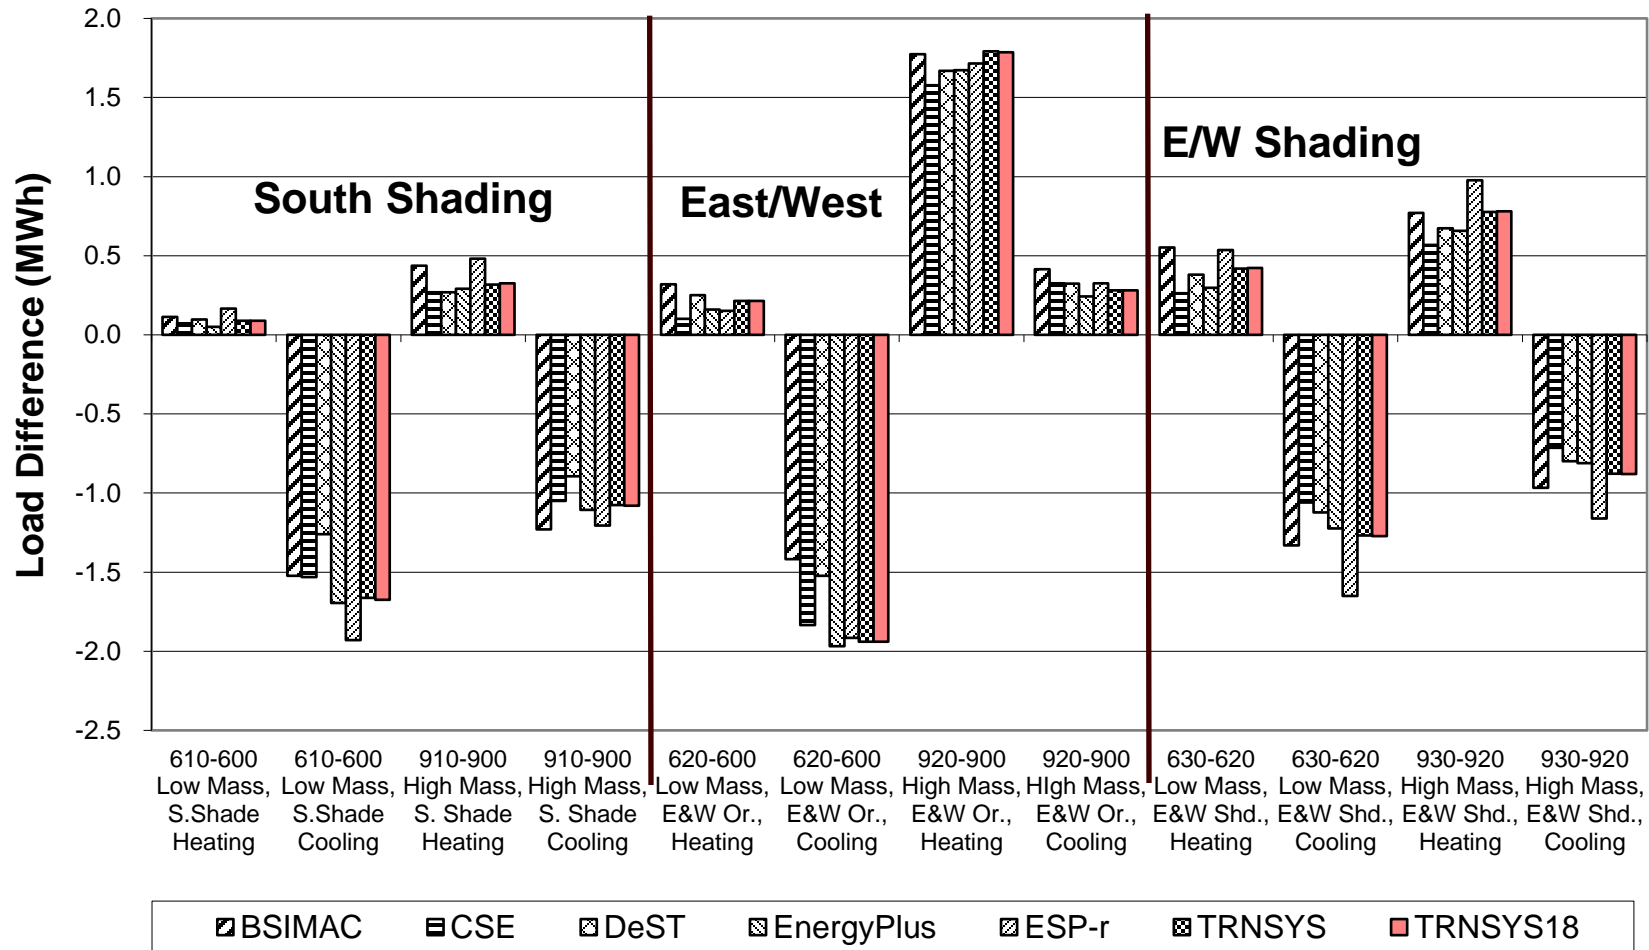


**Figure B8-18. Basic:
Window Shading and Orientation (Delta)
Peak Heating and Sensible Cooling**

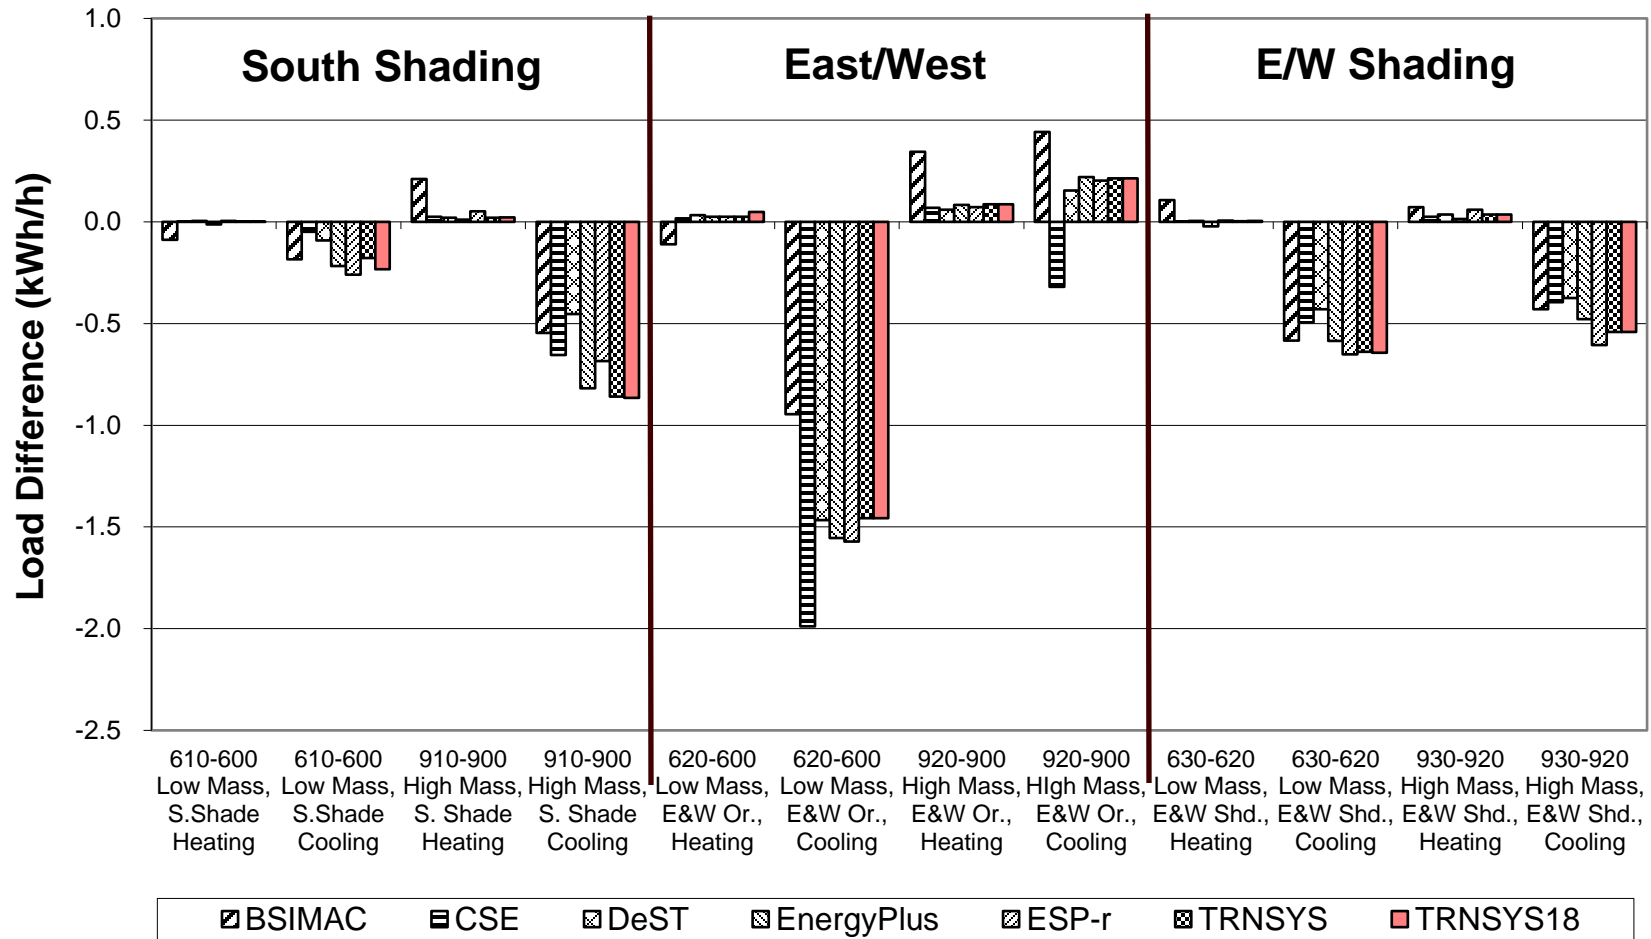


**Figure B8-19. Basic:
Thermostat Setback, Vent Cooling, and Sunspace (Delta)
Annual Heating and Sensible Cooling**

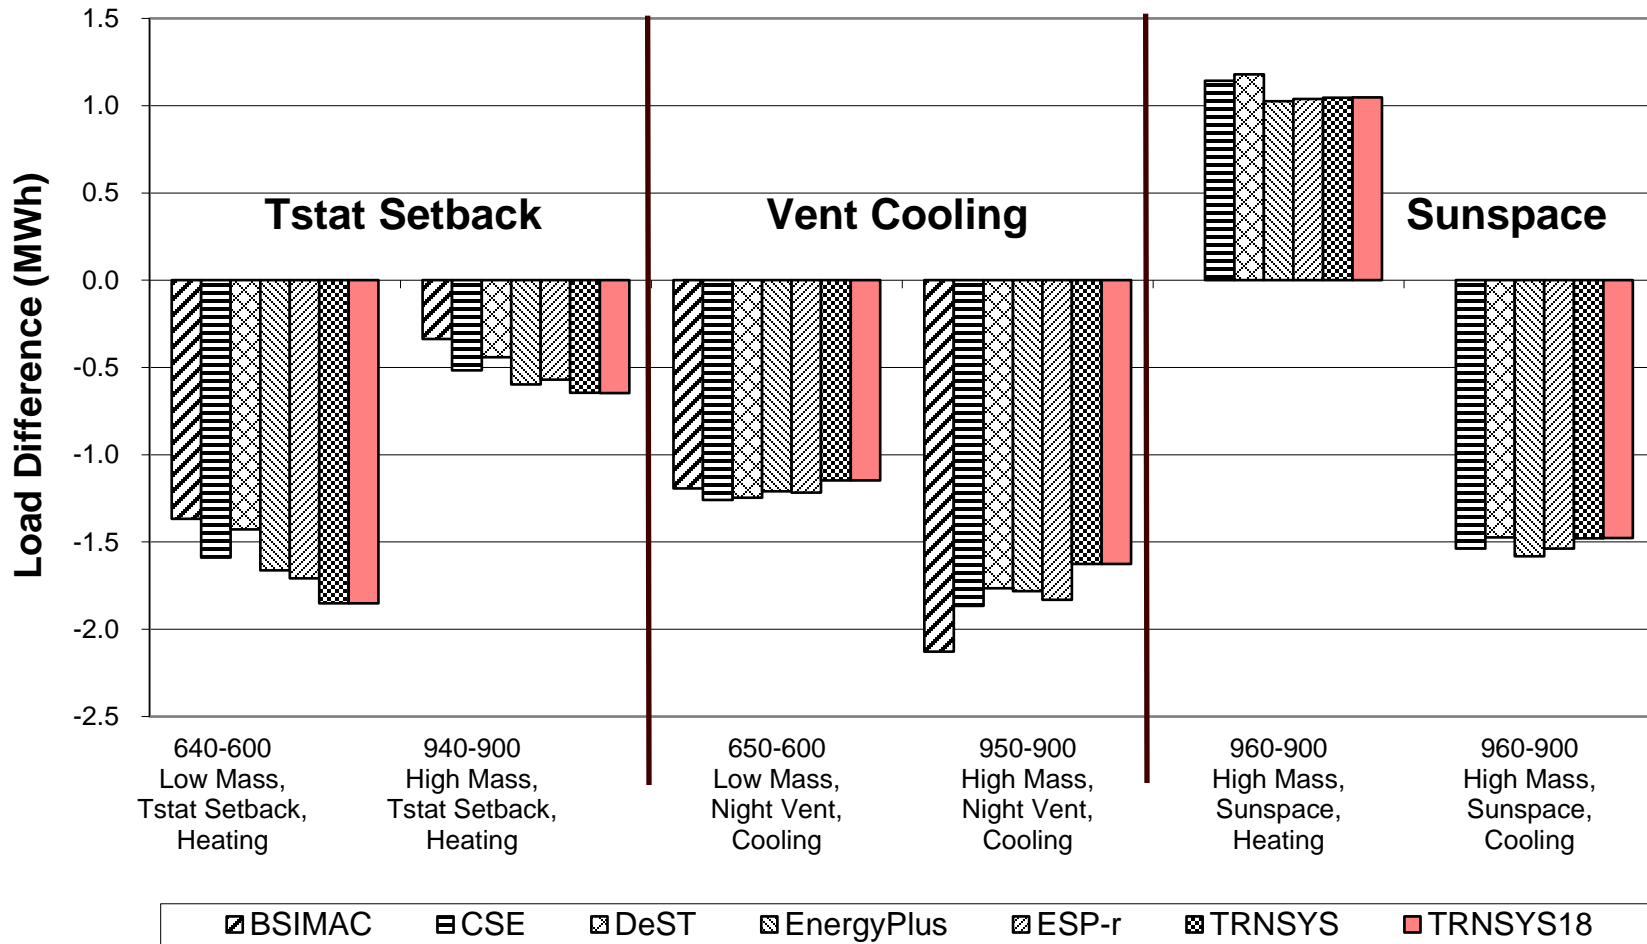


**Figure B8-20. Basic:
Thermostat Setback, Vent Cooling, and Sunspace (Delta)
Peak Heating and Sensible Cooling**

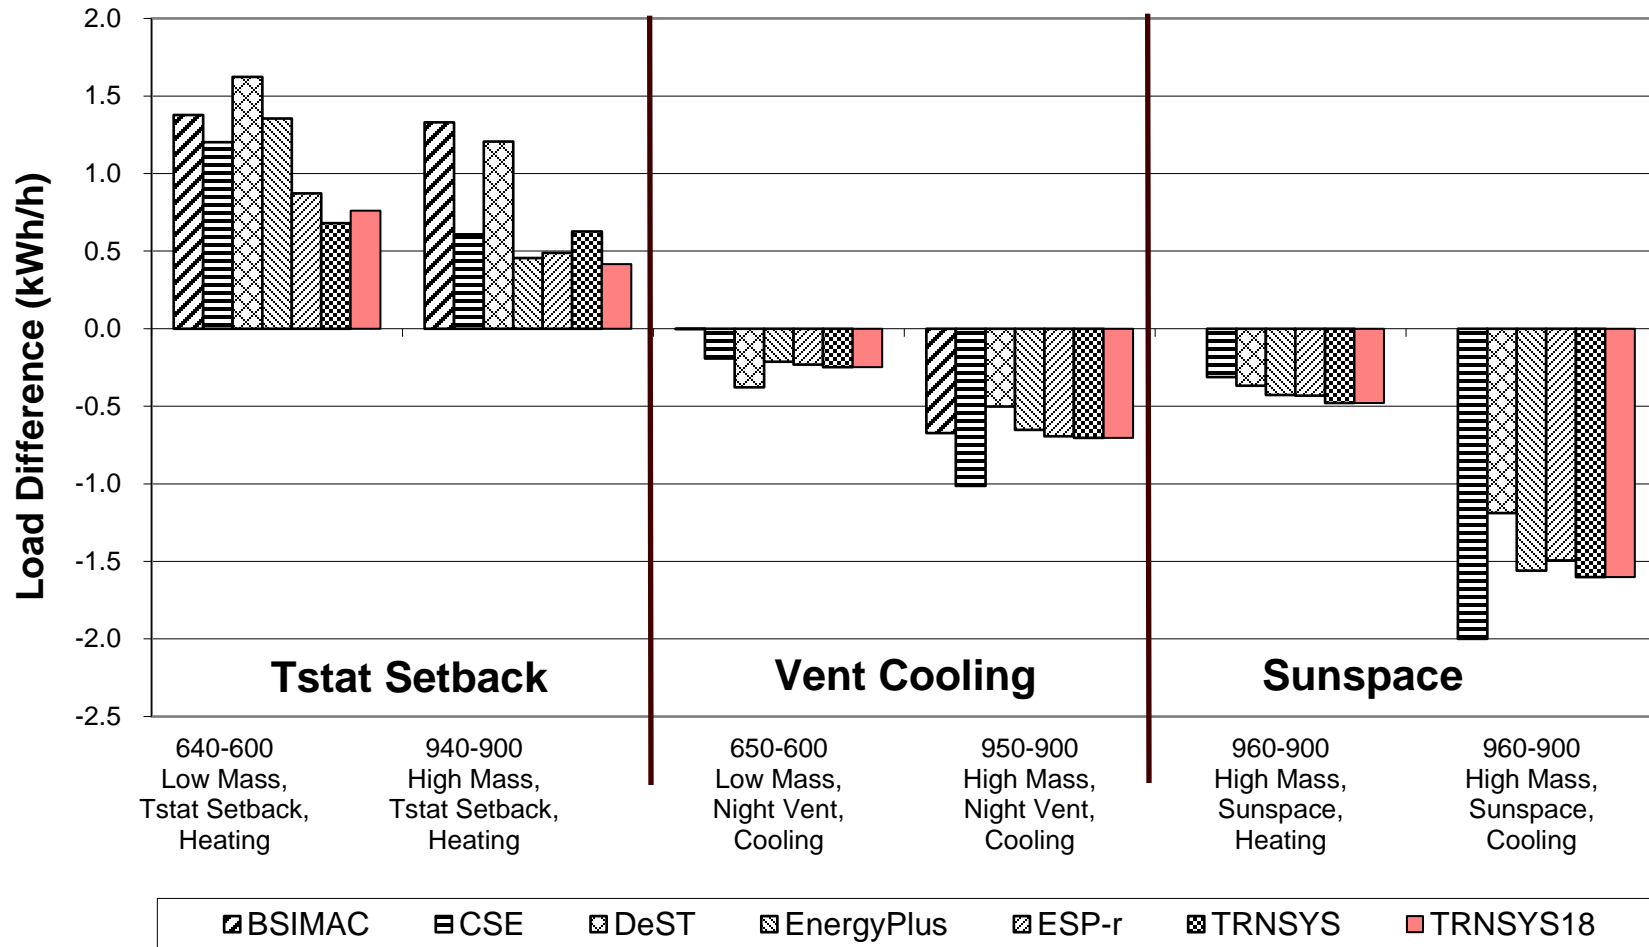


**Figure B8-21. Basic and In-Depth:
Mass Effect (Delta)
Annual Heating and Sensible Cooling**

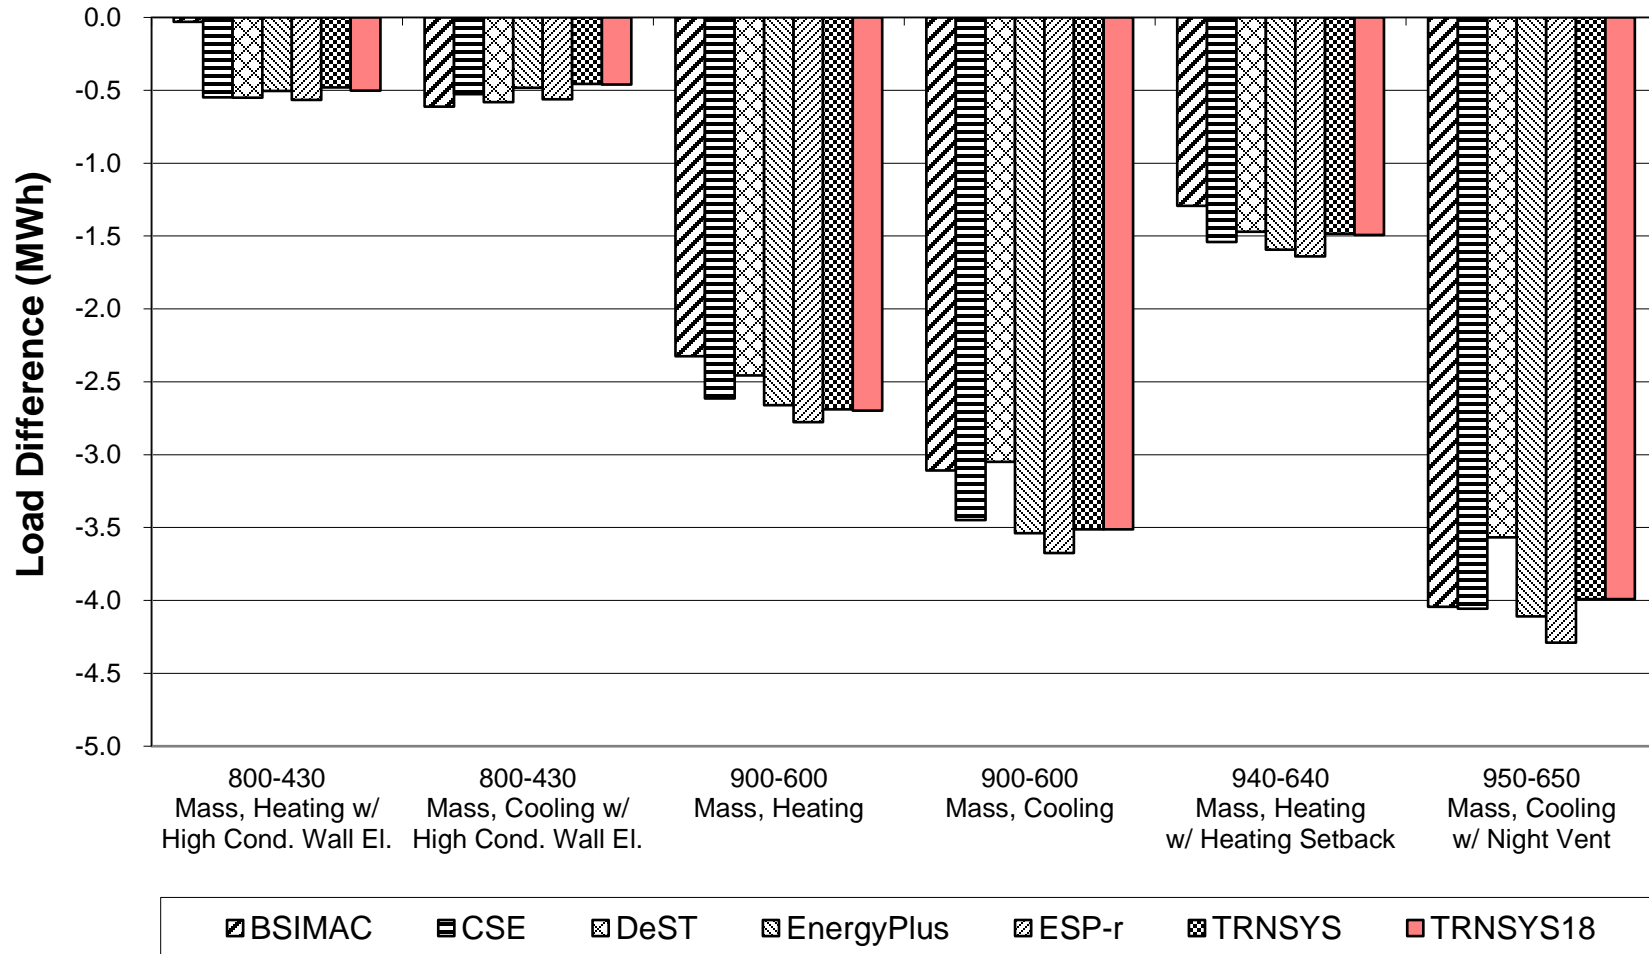


**Figure B8-22. Basic and In-Depth:
Mass Effect (Delta)
Peak Heating and Sensible Cooling**

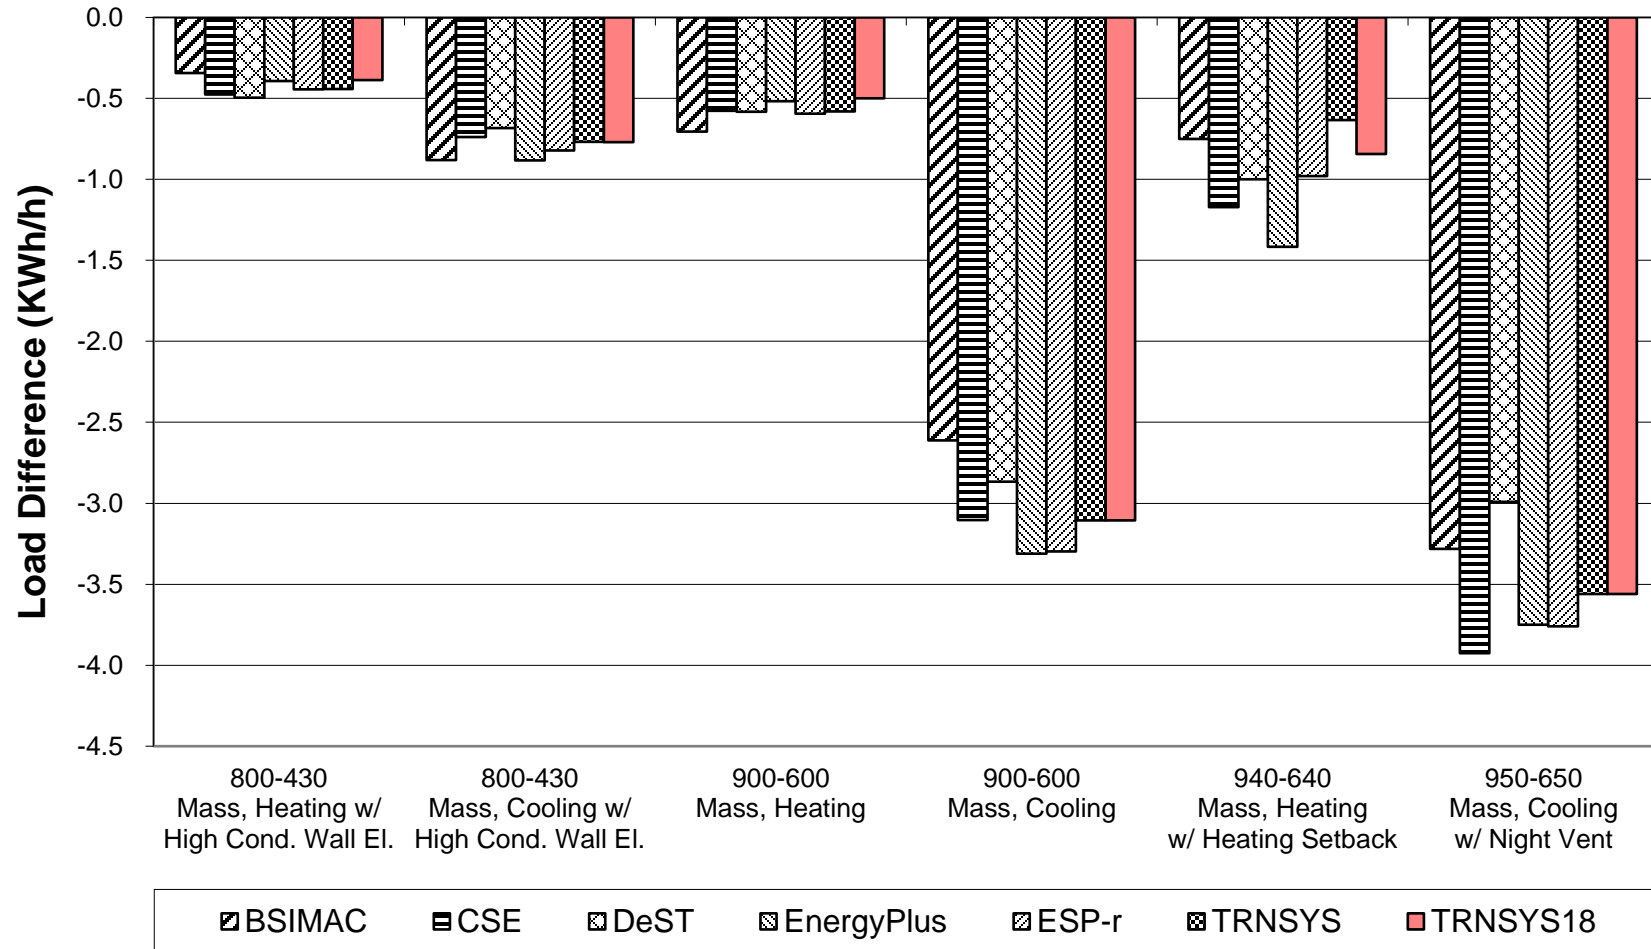


**Figure B8-23. Basic:
Cases 660 to 695 and 980 to 995
Annual Heating**

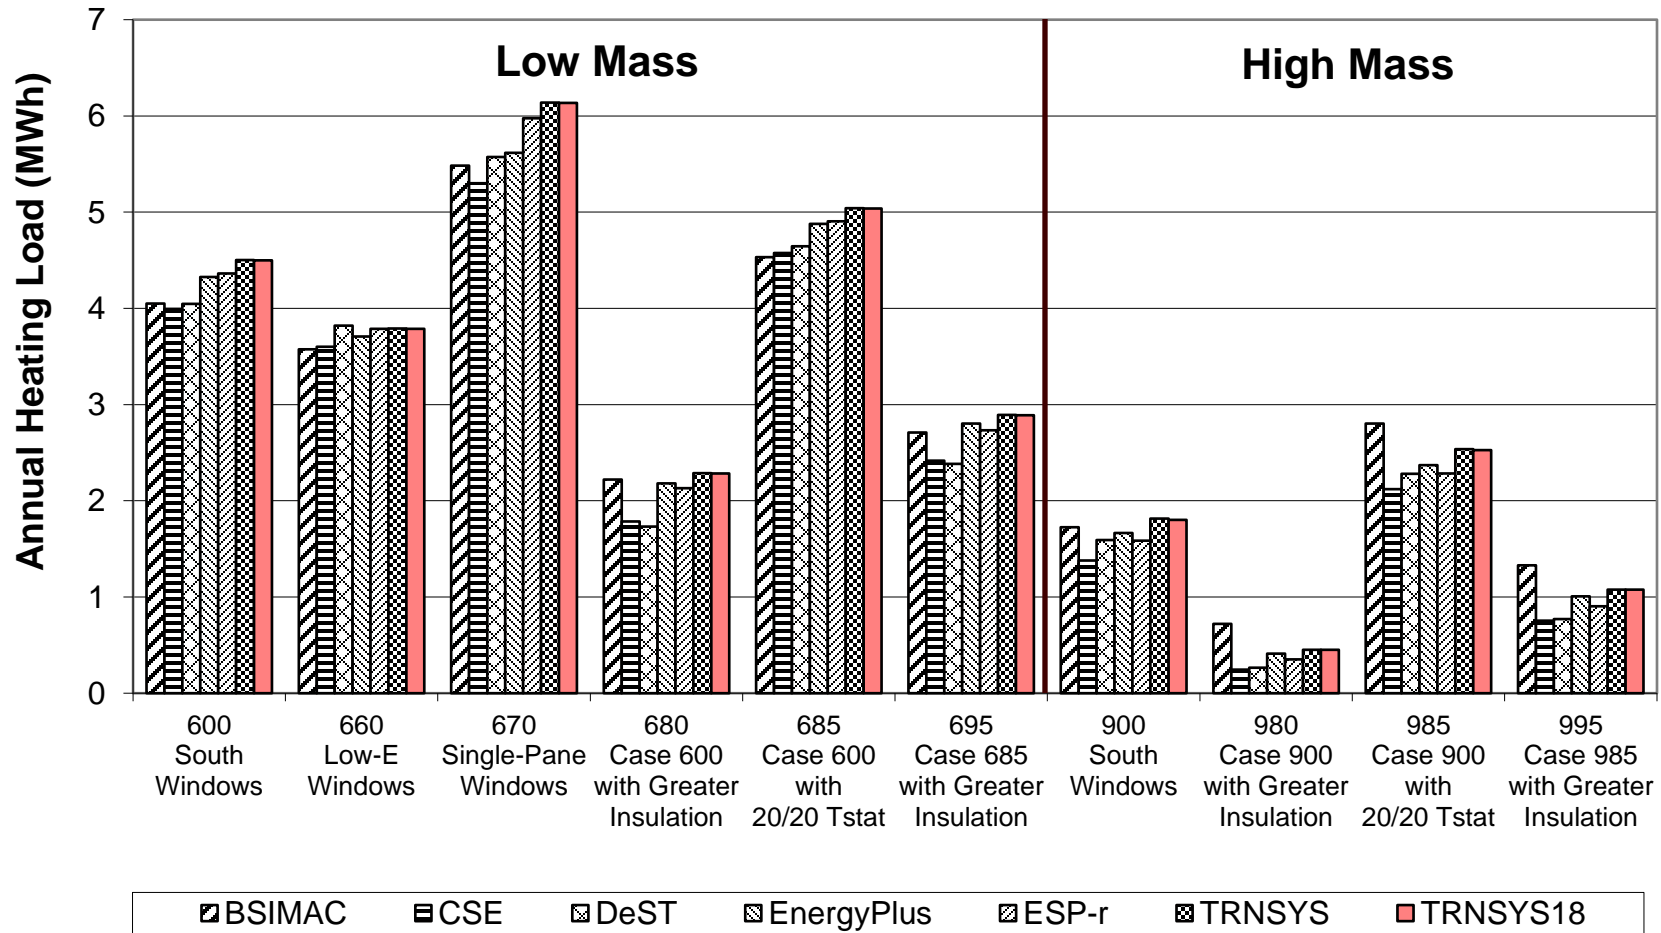


**Figure B8-24. Basic:
Cases 660 to 695 and 980 to 995
Annual Cooling**

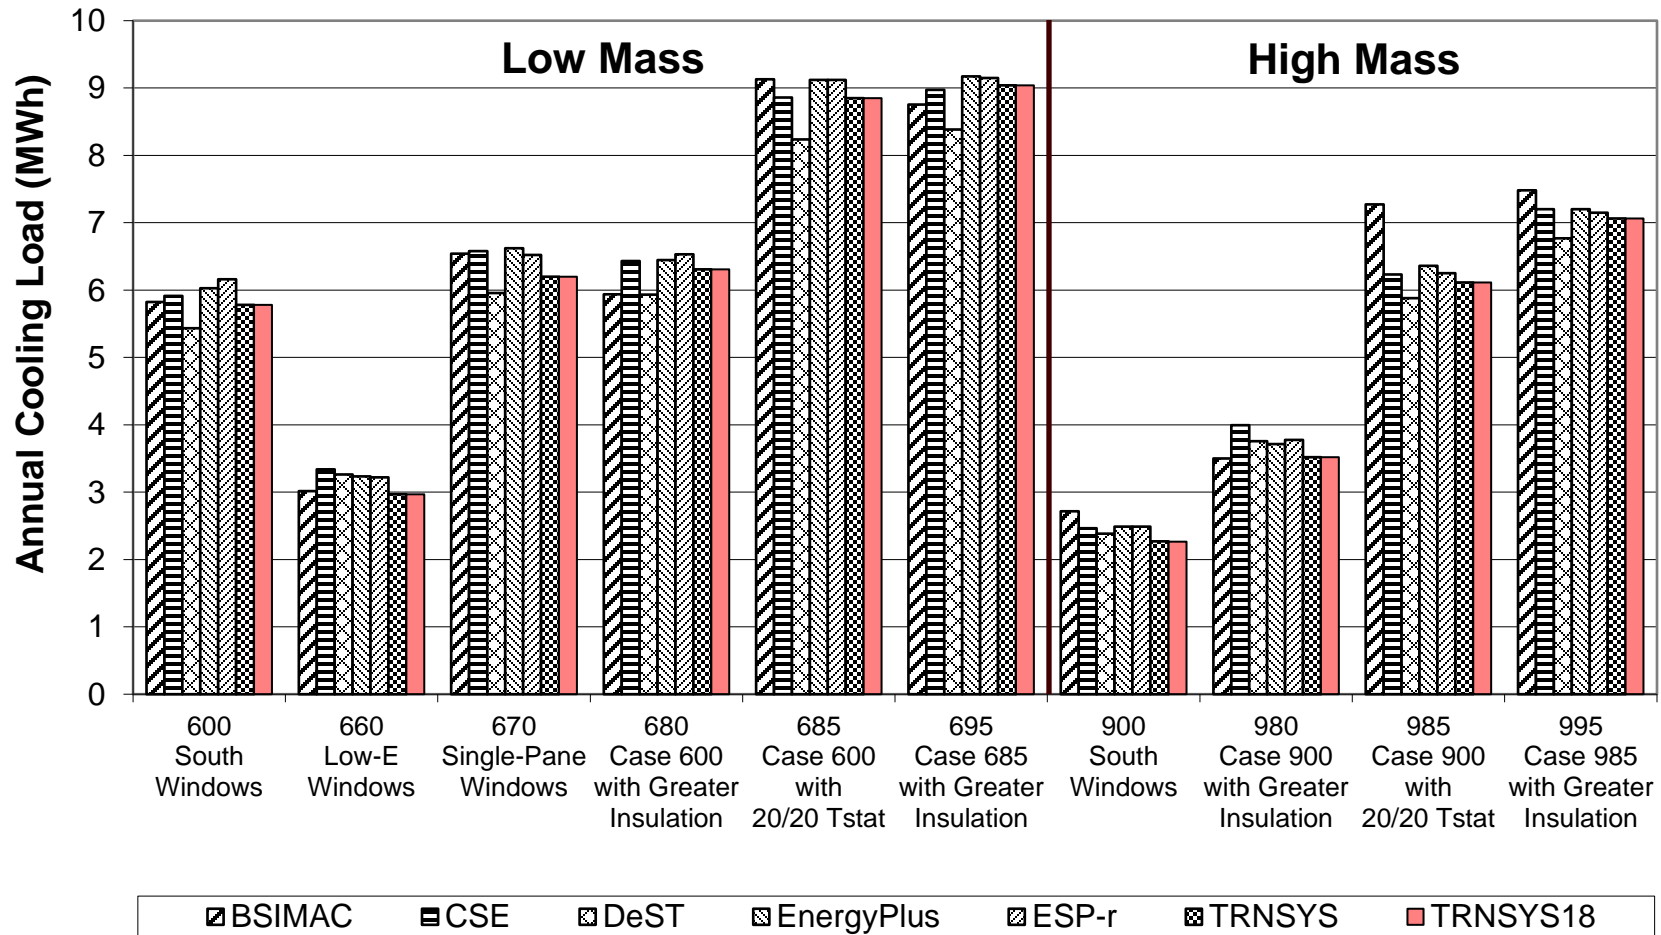


**Figure B8-25. Basic:
Cases 660 to 695 and 980 to 995
Peak Heating**

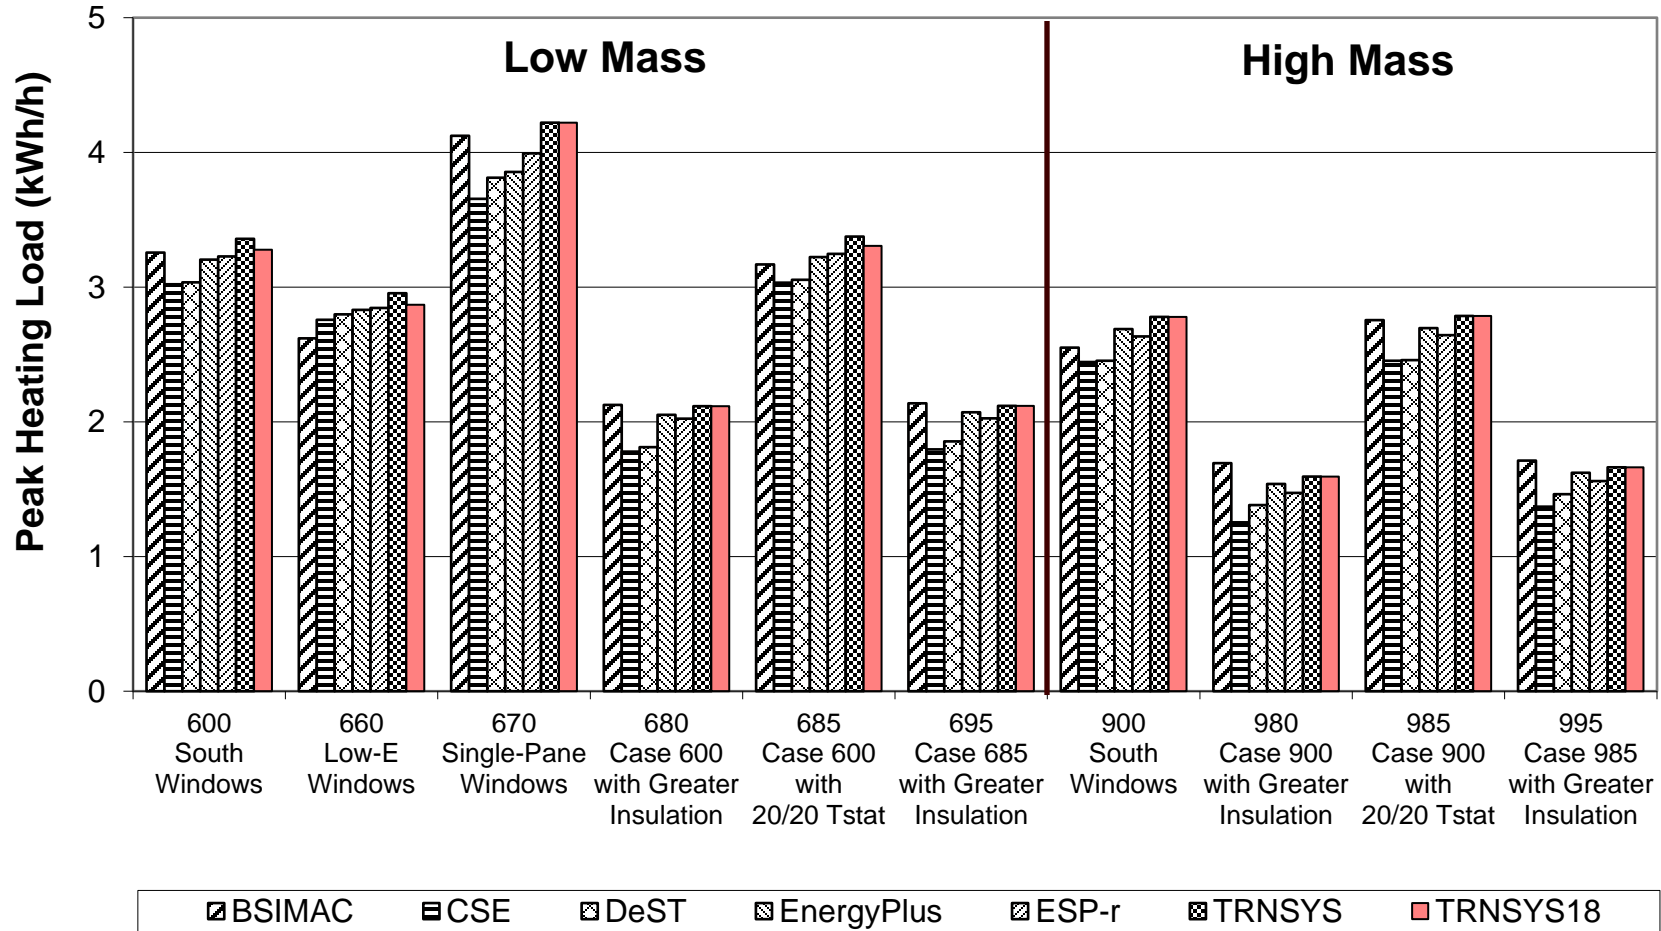


**Figure B8-26. Basic:
Cases 660 to 695 and 980 to 995
Peak Cooling**

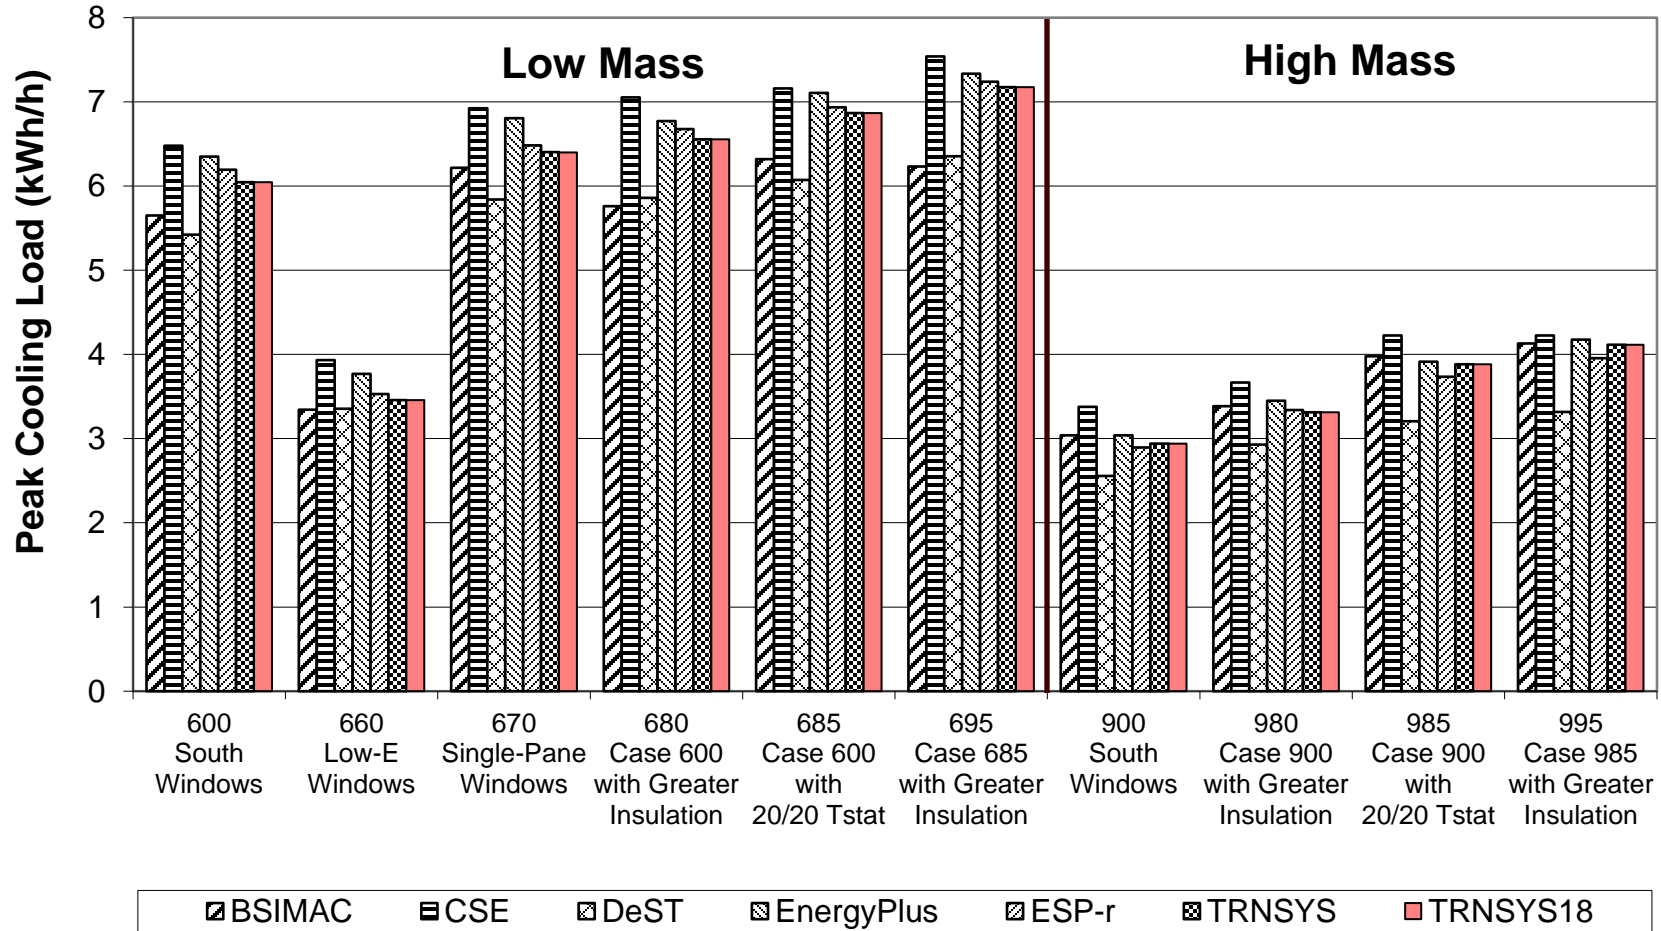


**Figure B8-27. Basic:
Window Types (Delta)
Annual Heating and Sensible Cooling**

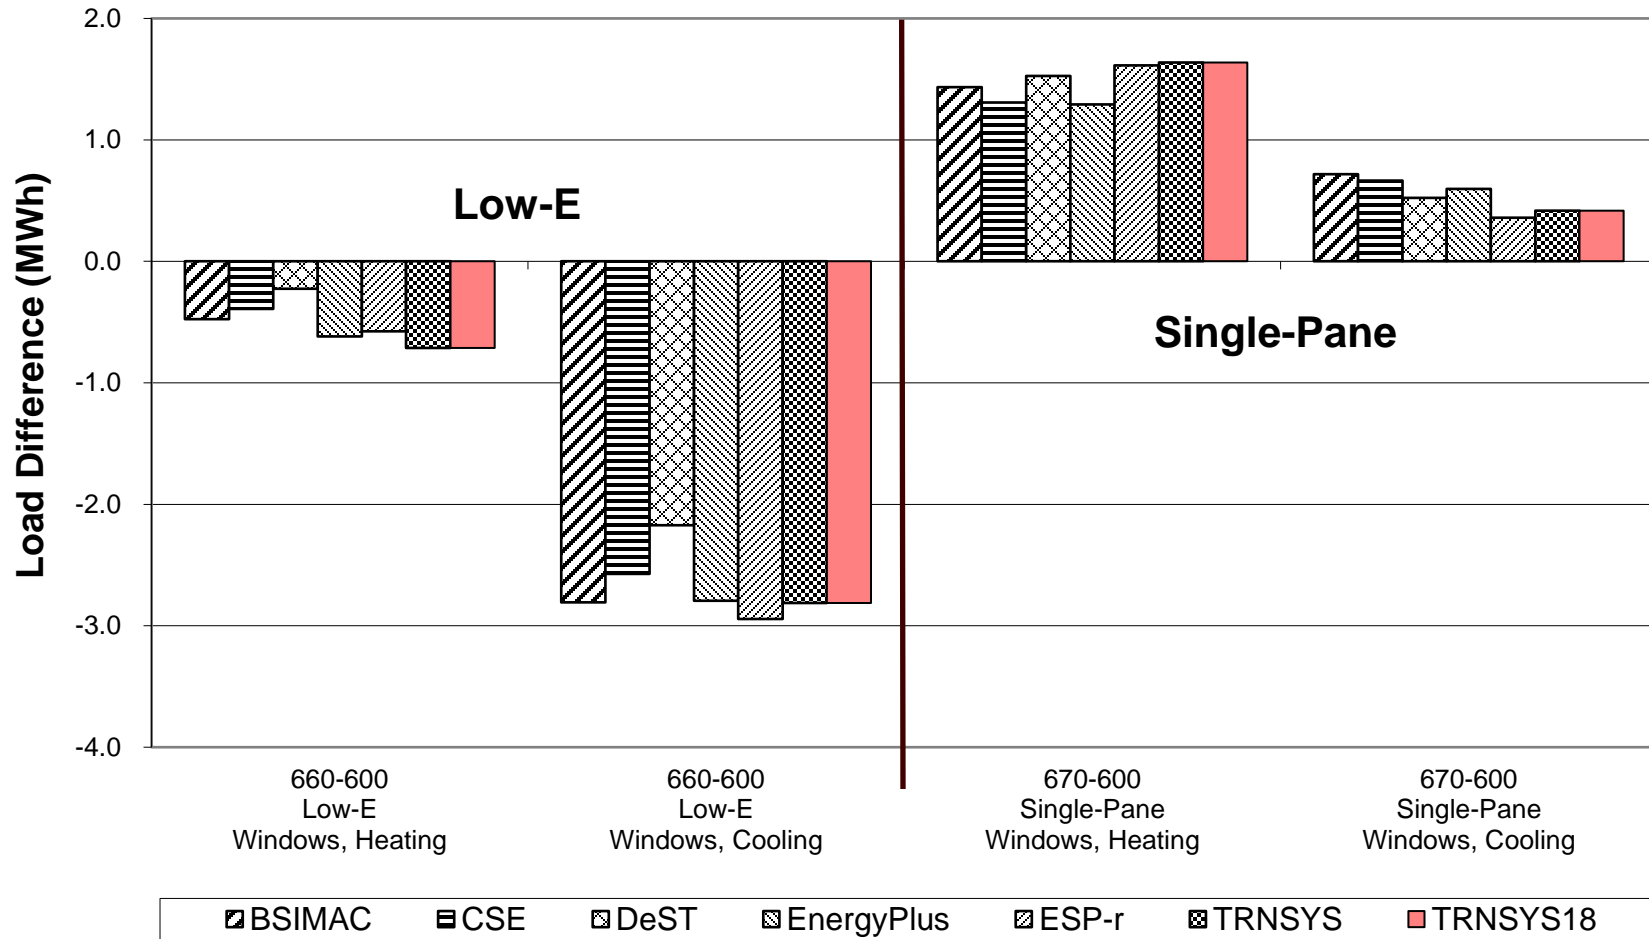

**Figure B8-28. Basic:
Window Types (Delta)
Peak Heating and Sensible Cooling**

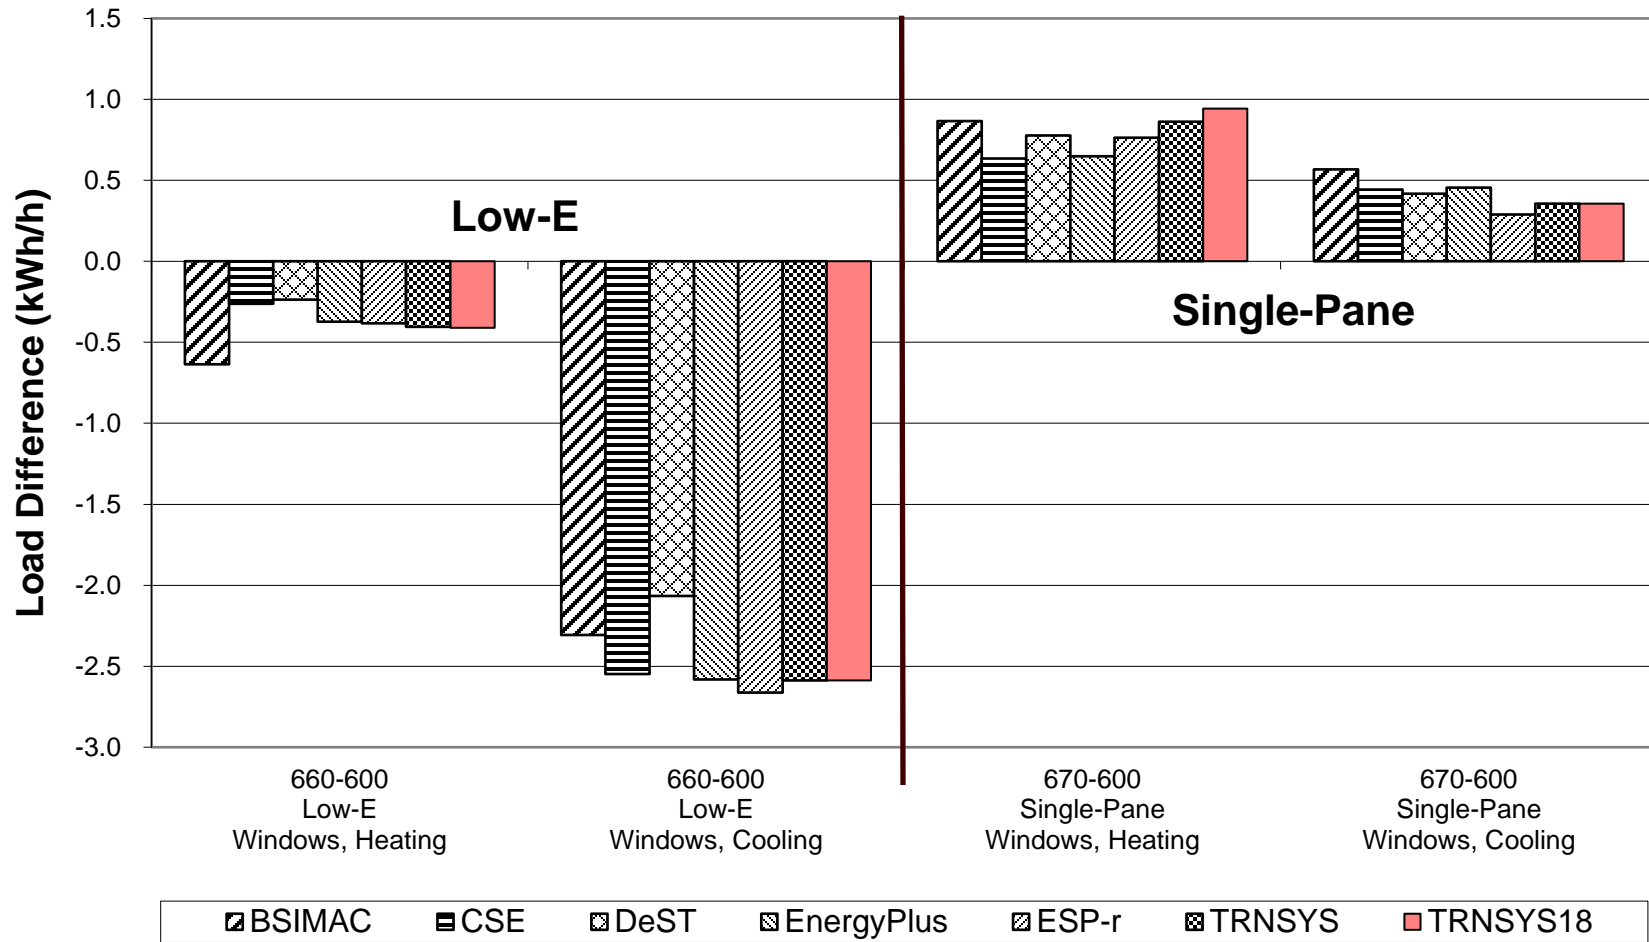


**Figure B8-29. Basic:
Insulation (Delta)
Annual Heating and Sensible Cooling**

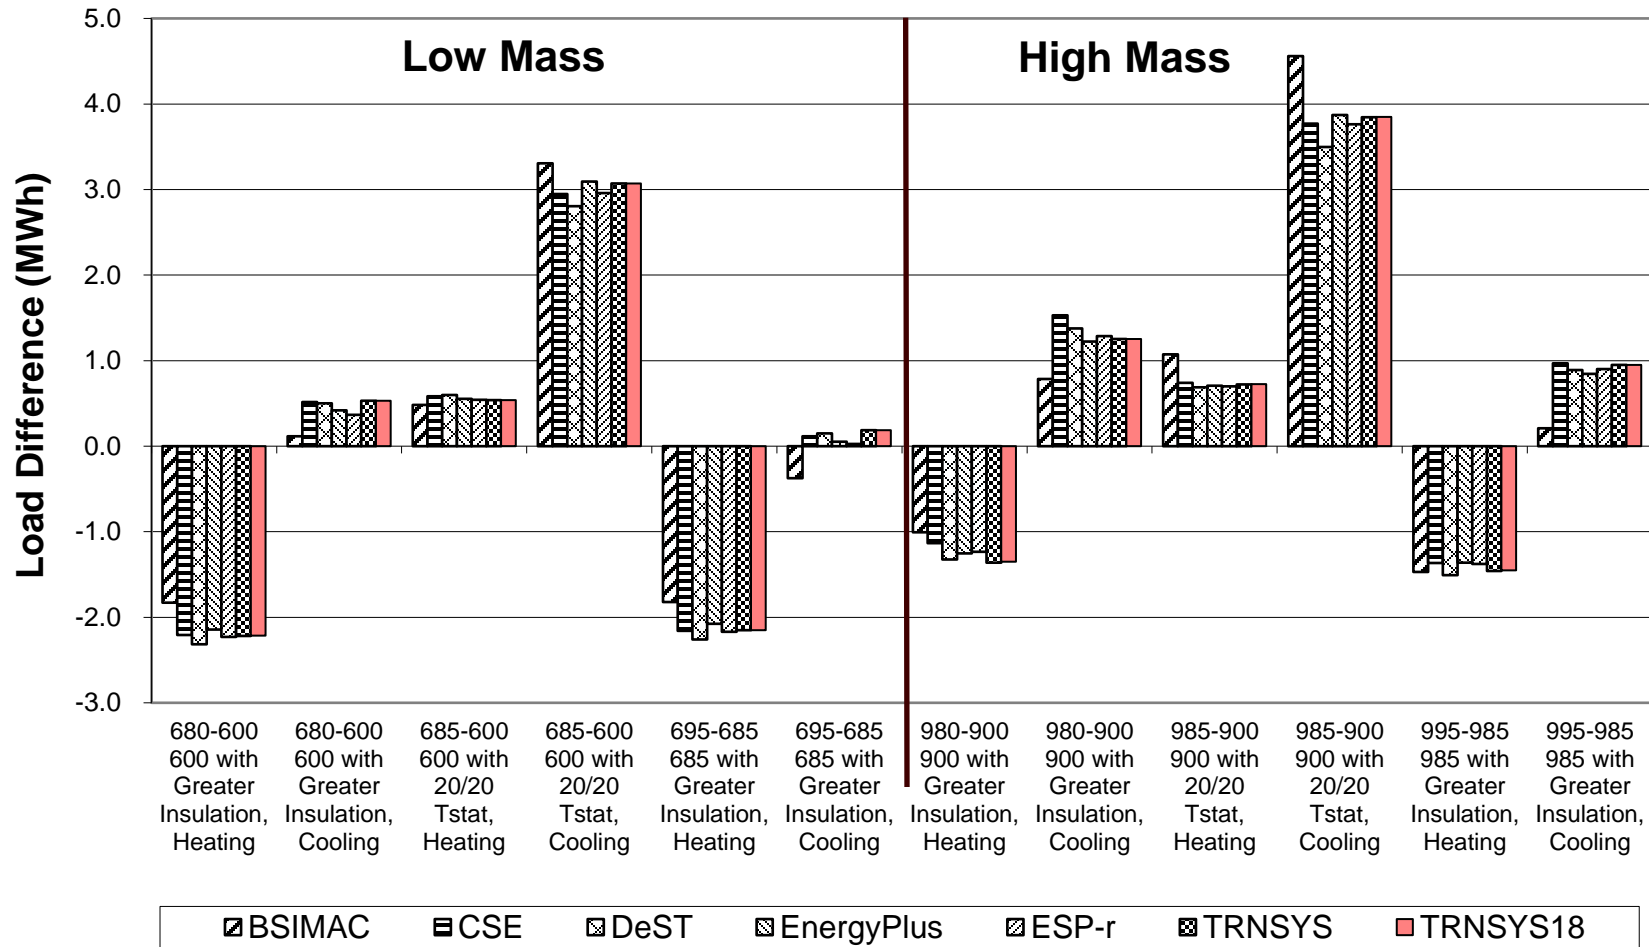


ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF (TRNSYS18) vs. Annex B8, Section B8.1 Example Results, by Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024


**Figure B8-30. Basic:
Insulation (Delta)
Peak Heating and Sensible Cooling**

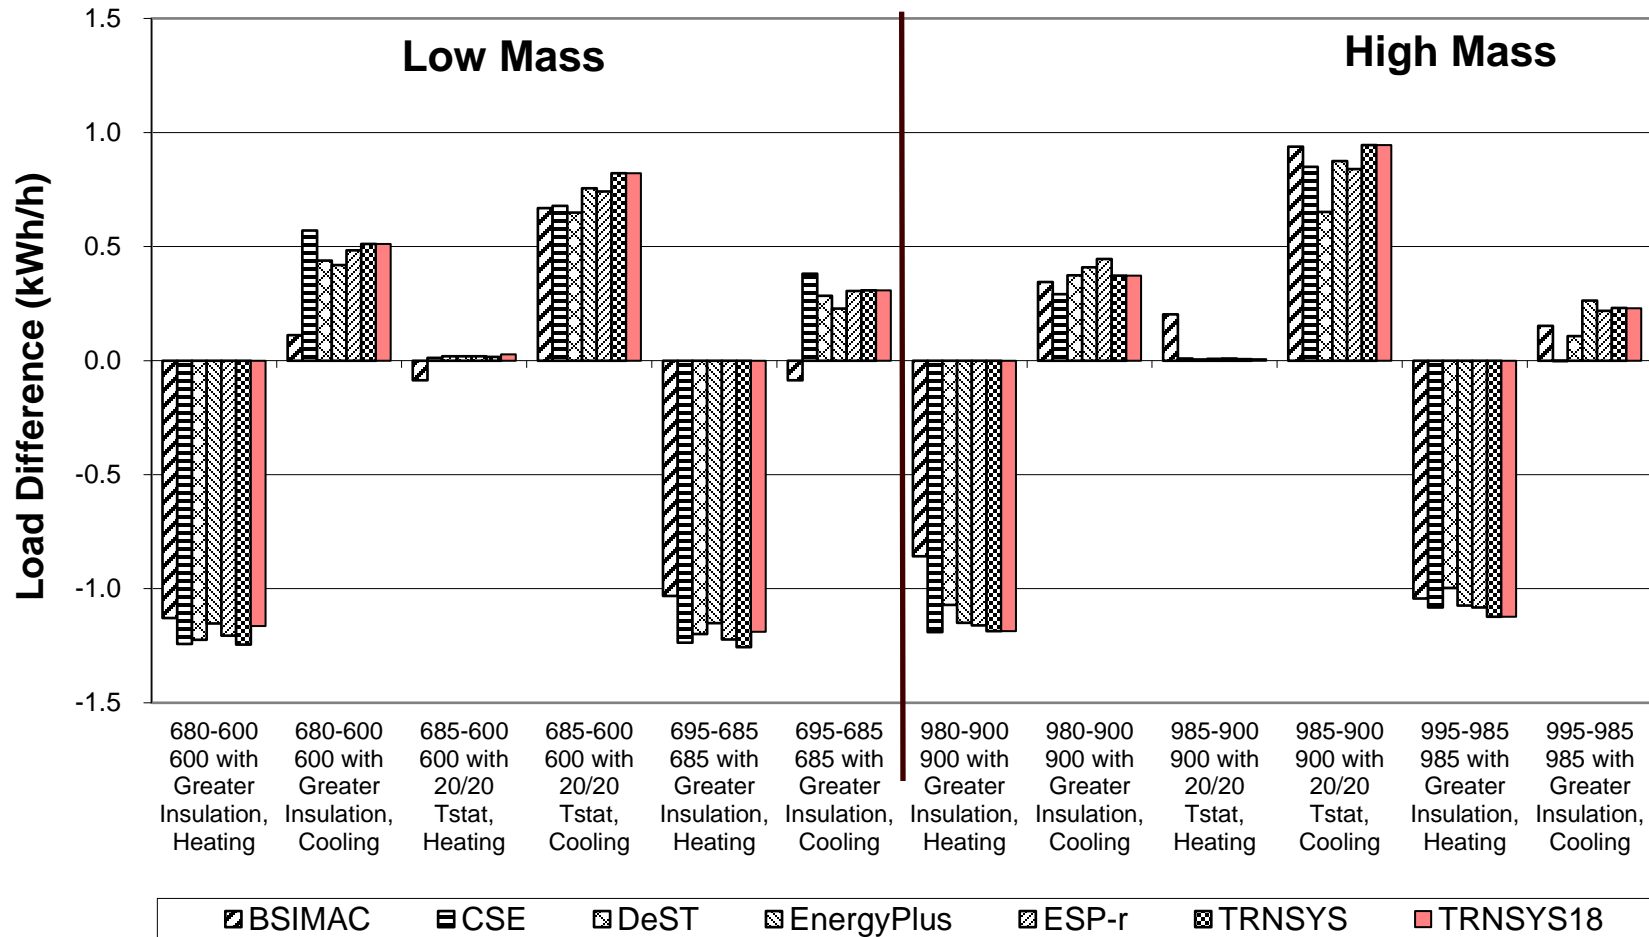


**Figure B8-32. Basic:
Insulation, Mass Effect (Delta)
Peak Heating and Sensible Cooling**

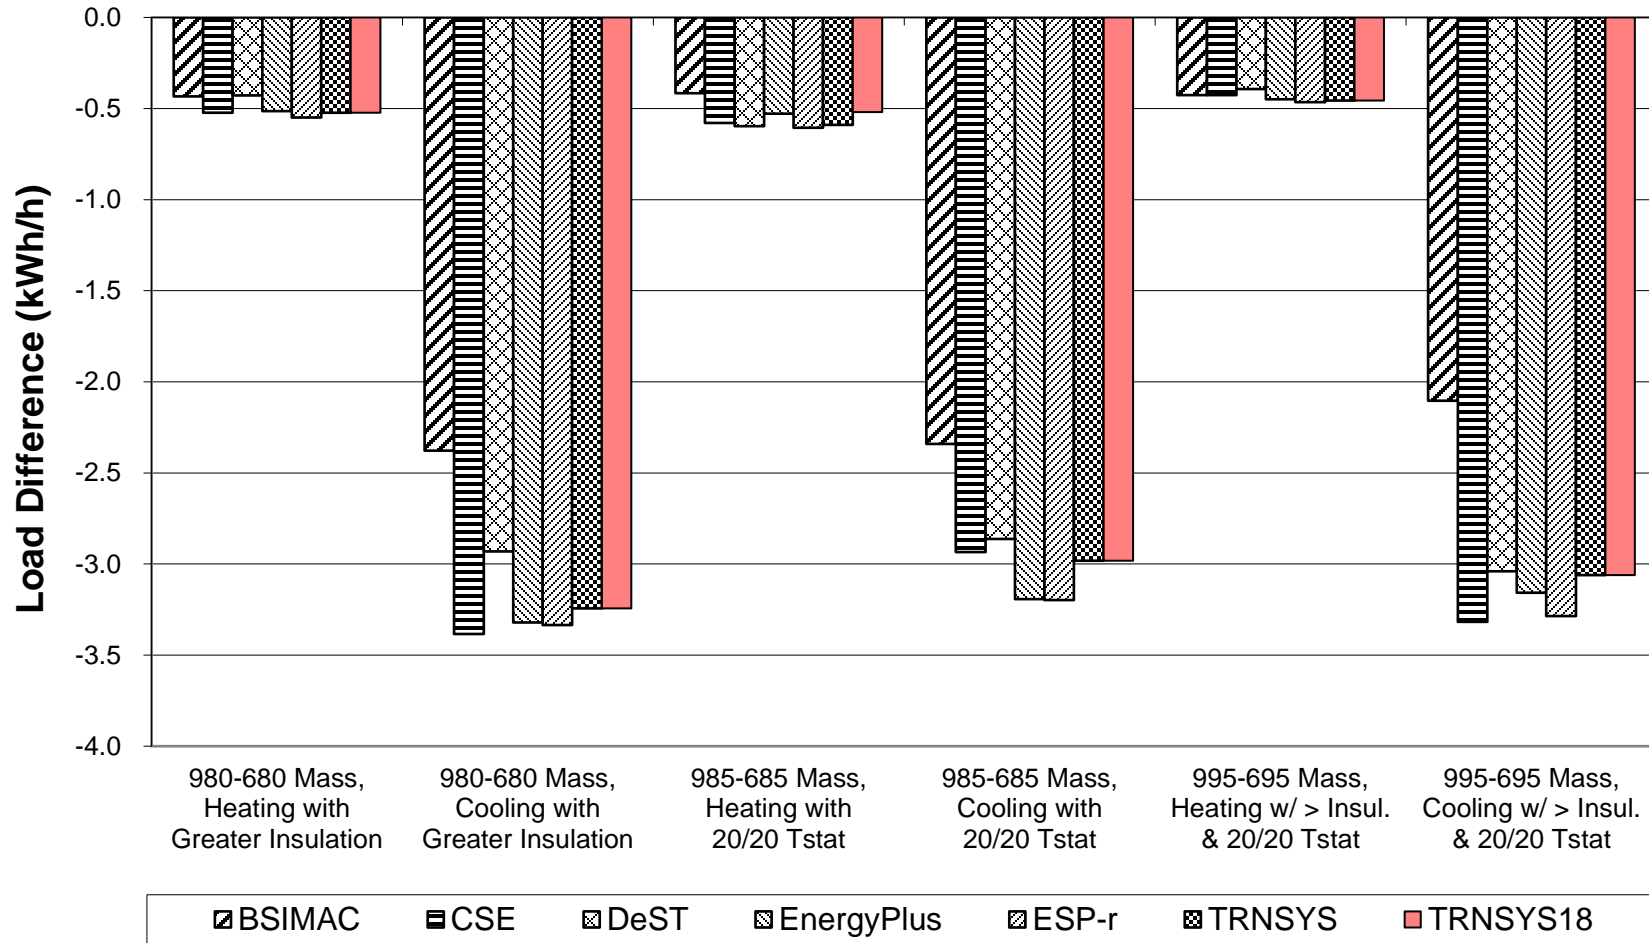


**Figure B8-33. Basic:
Average Hourly Annual Temperature
Free-Float Cases**

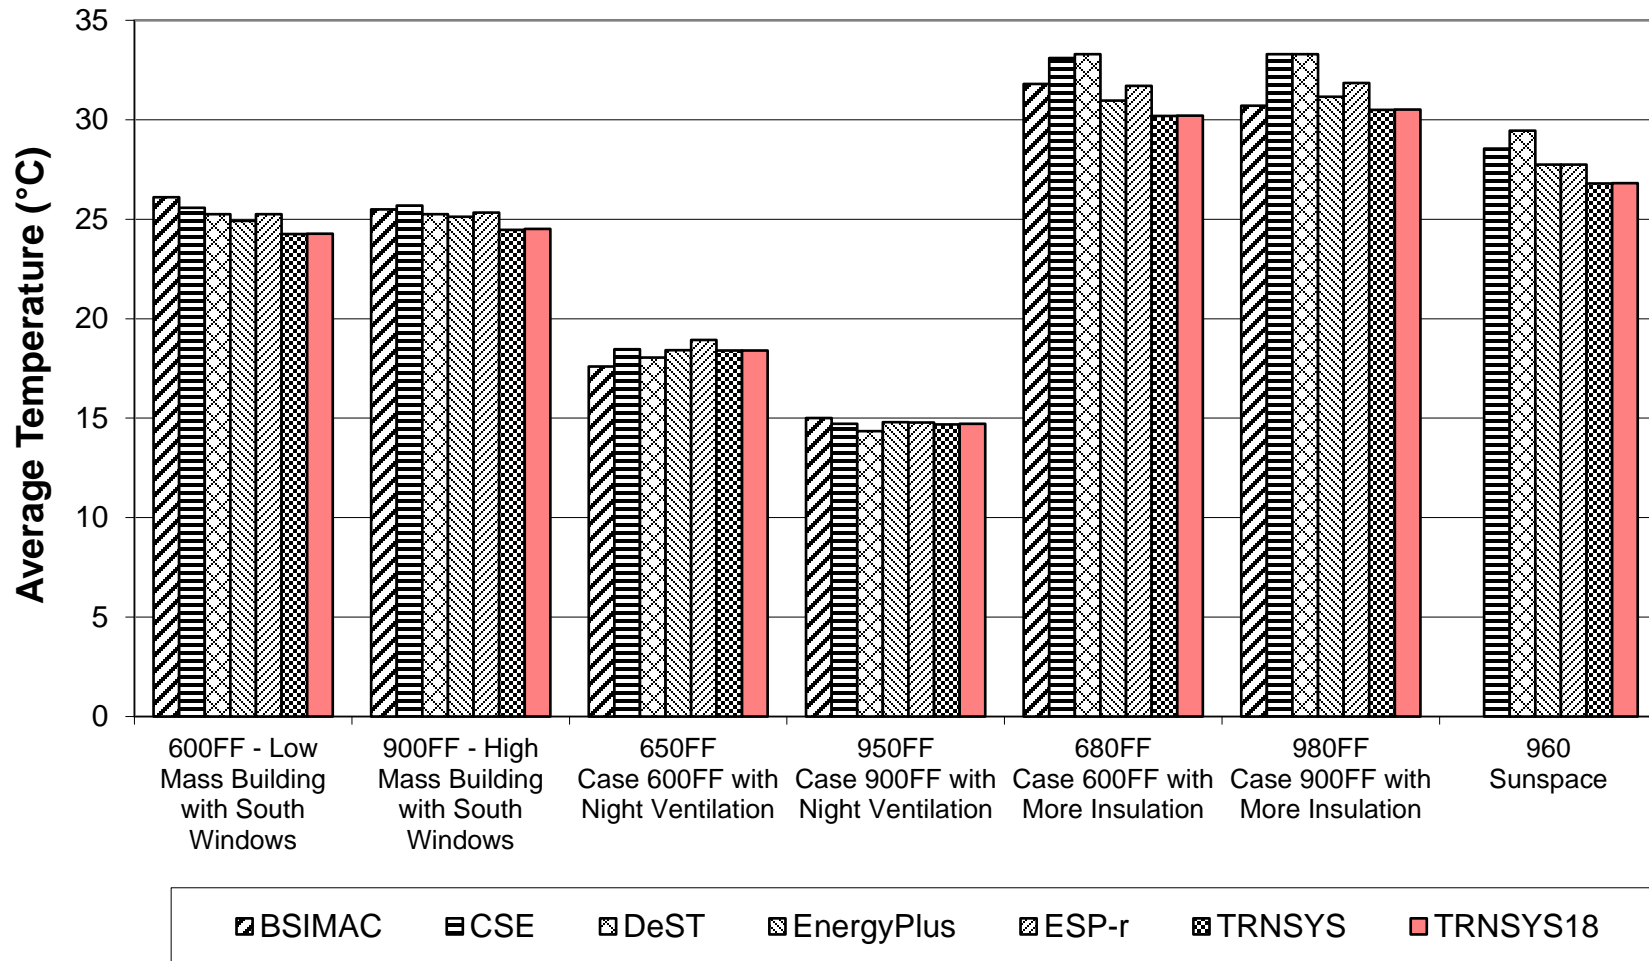


**Figure B8-34. Basic:
Maximum Hourly Annual Temperature
Free-Float Cases**

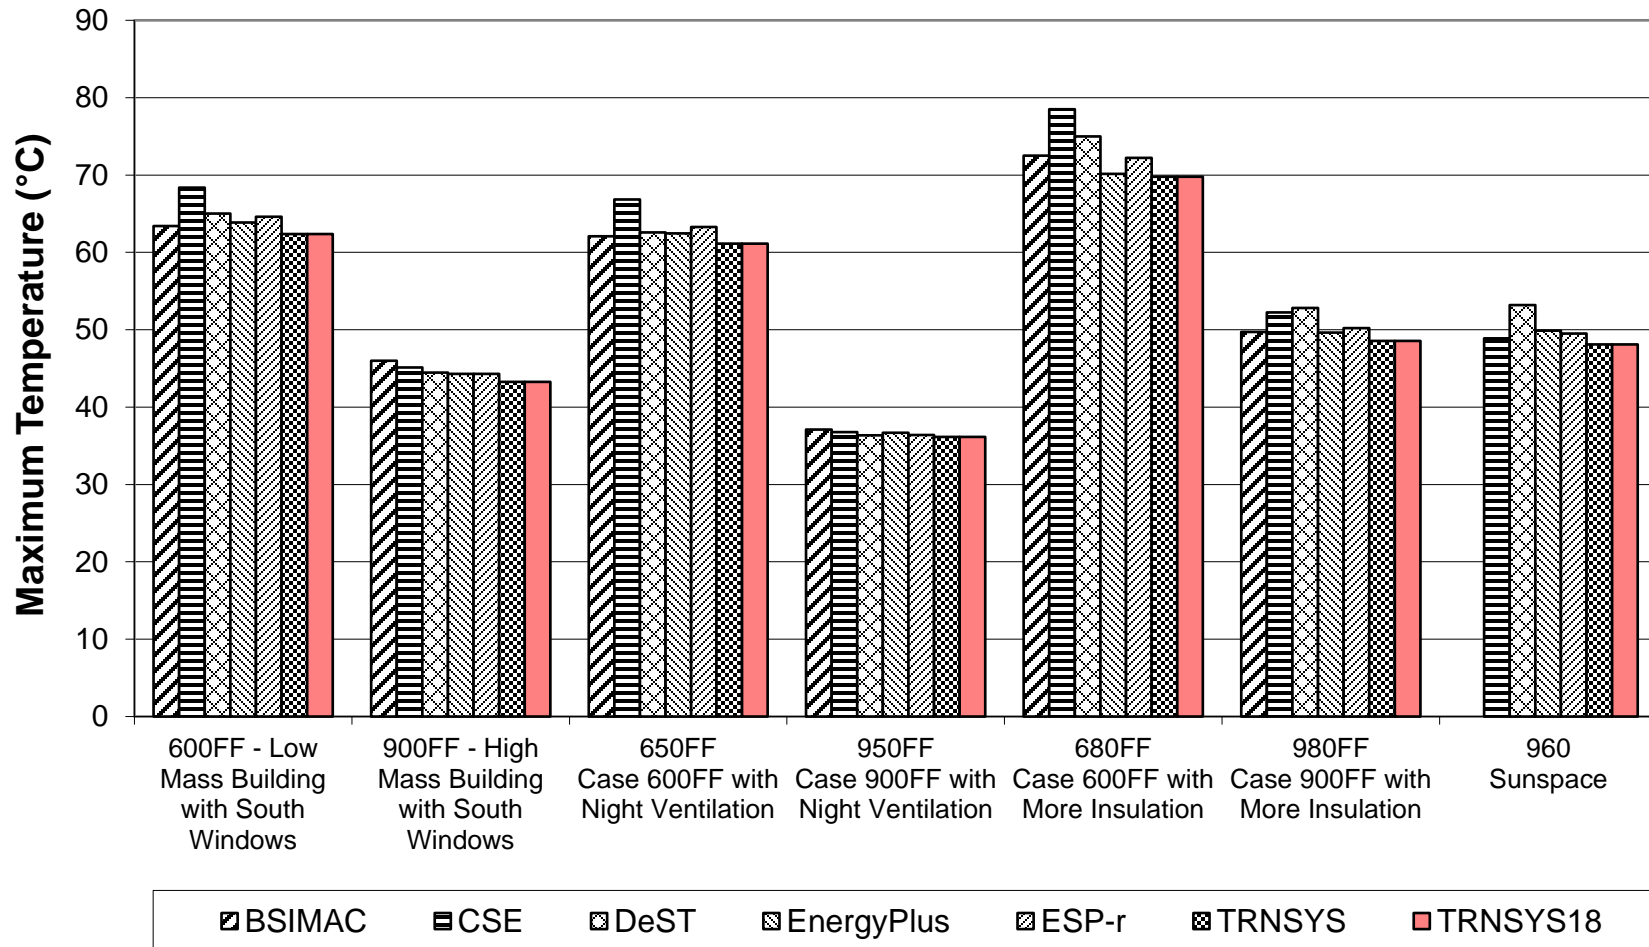


**Figure B8-35. Basic:
Minimum Hourly Annual Temperature
Free-Float Cases**

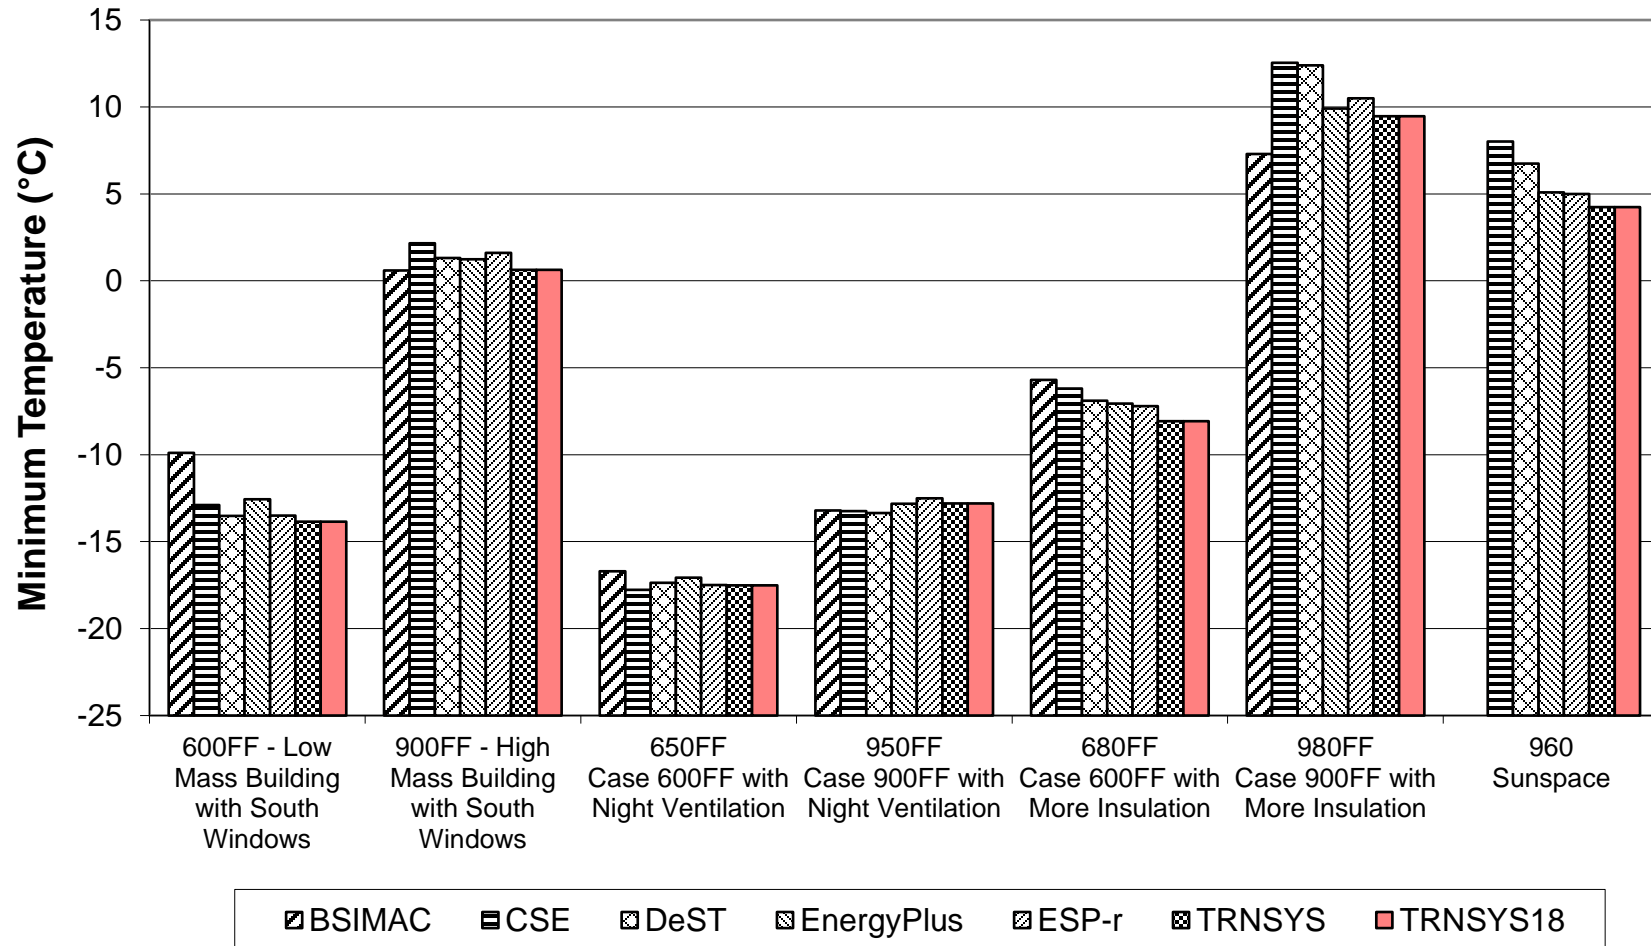


**Figure B8-36. In-Depth:
Low Mass Cases 195 to 250
Annual Heating**

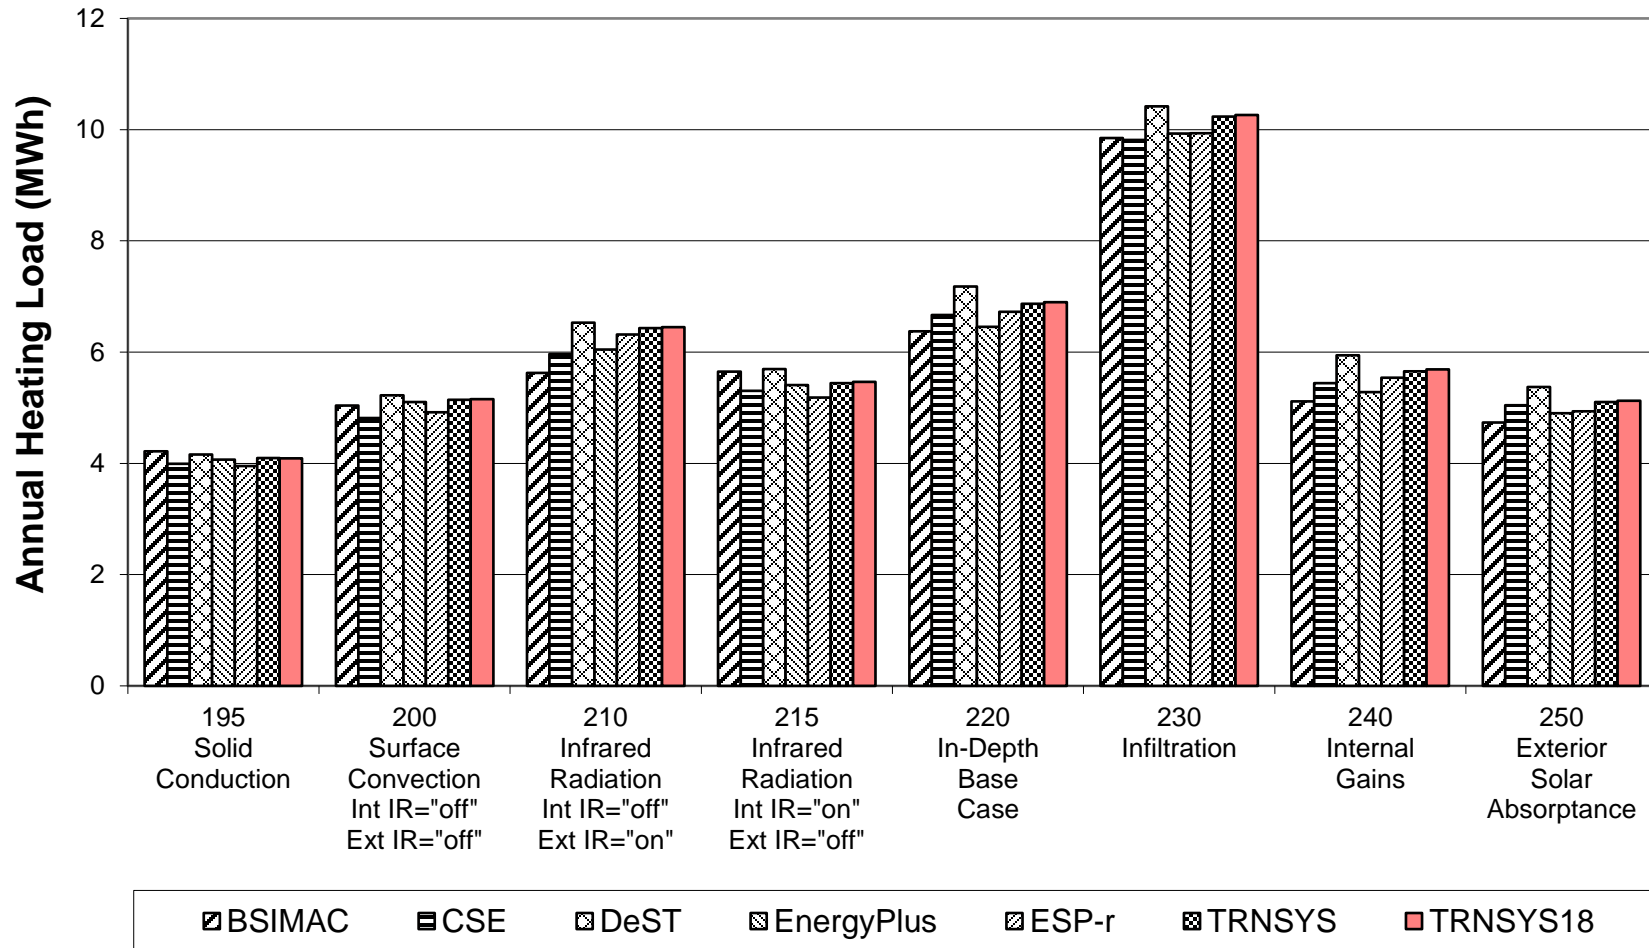


**Figure B8-37. In-Depth:
Low Mass Cases 195 to 250
Annual Sensible Cooling**

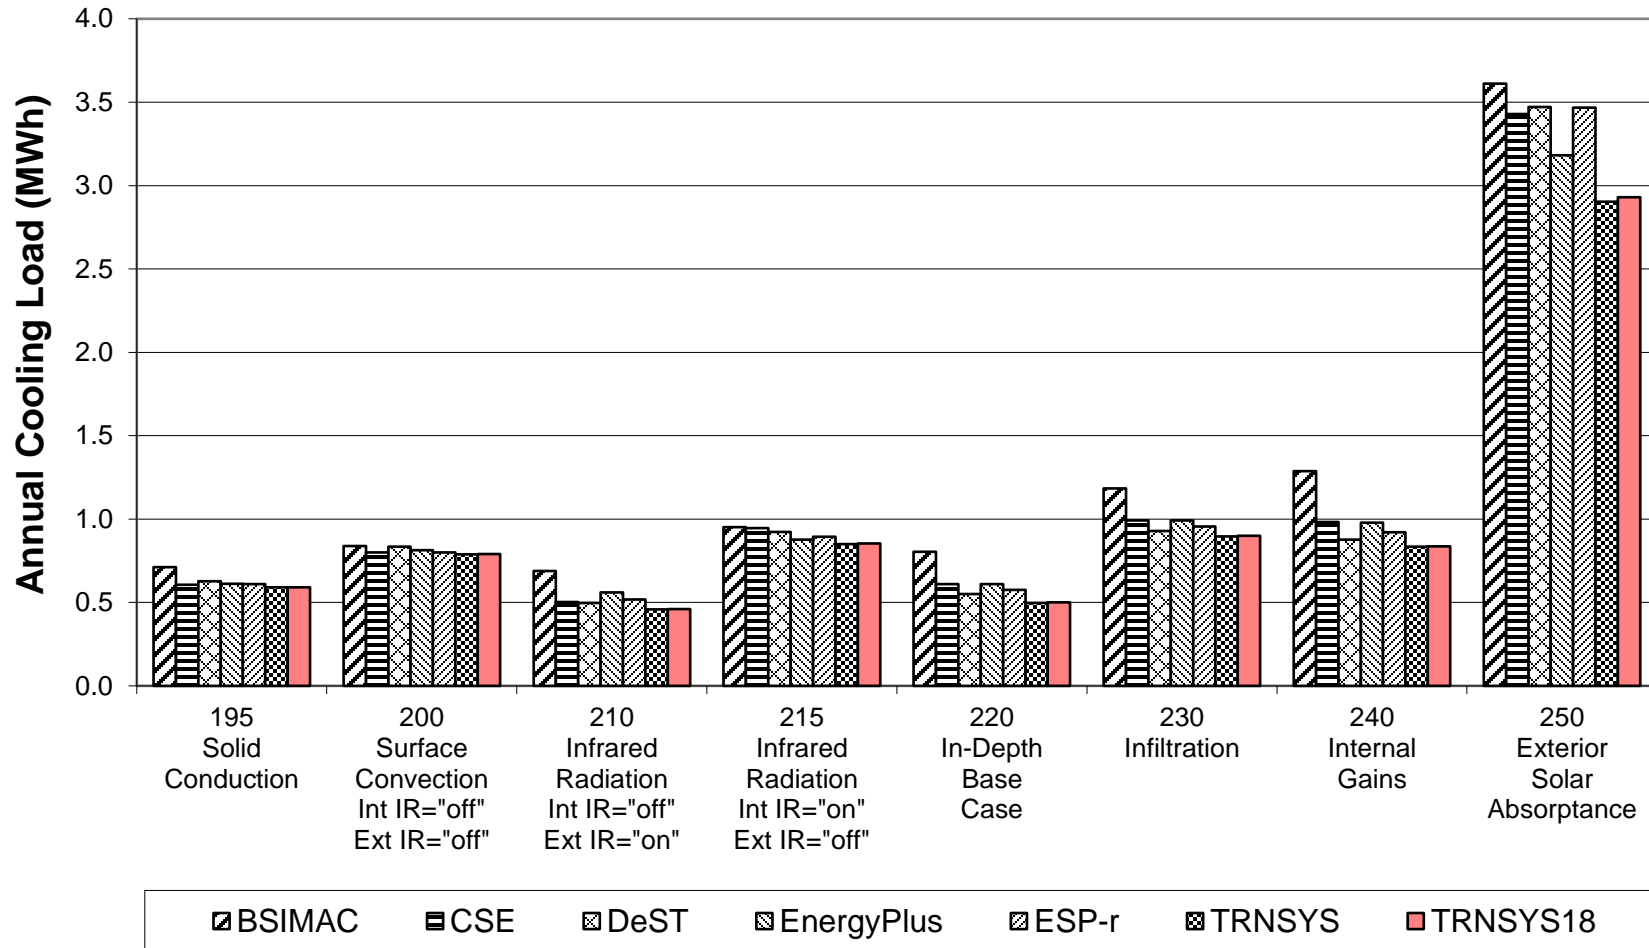


**Figure B8-38. In-Depth:
Low Mass Cases 195 to 250
Peak Heating**

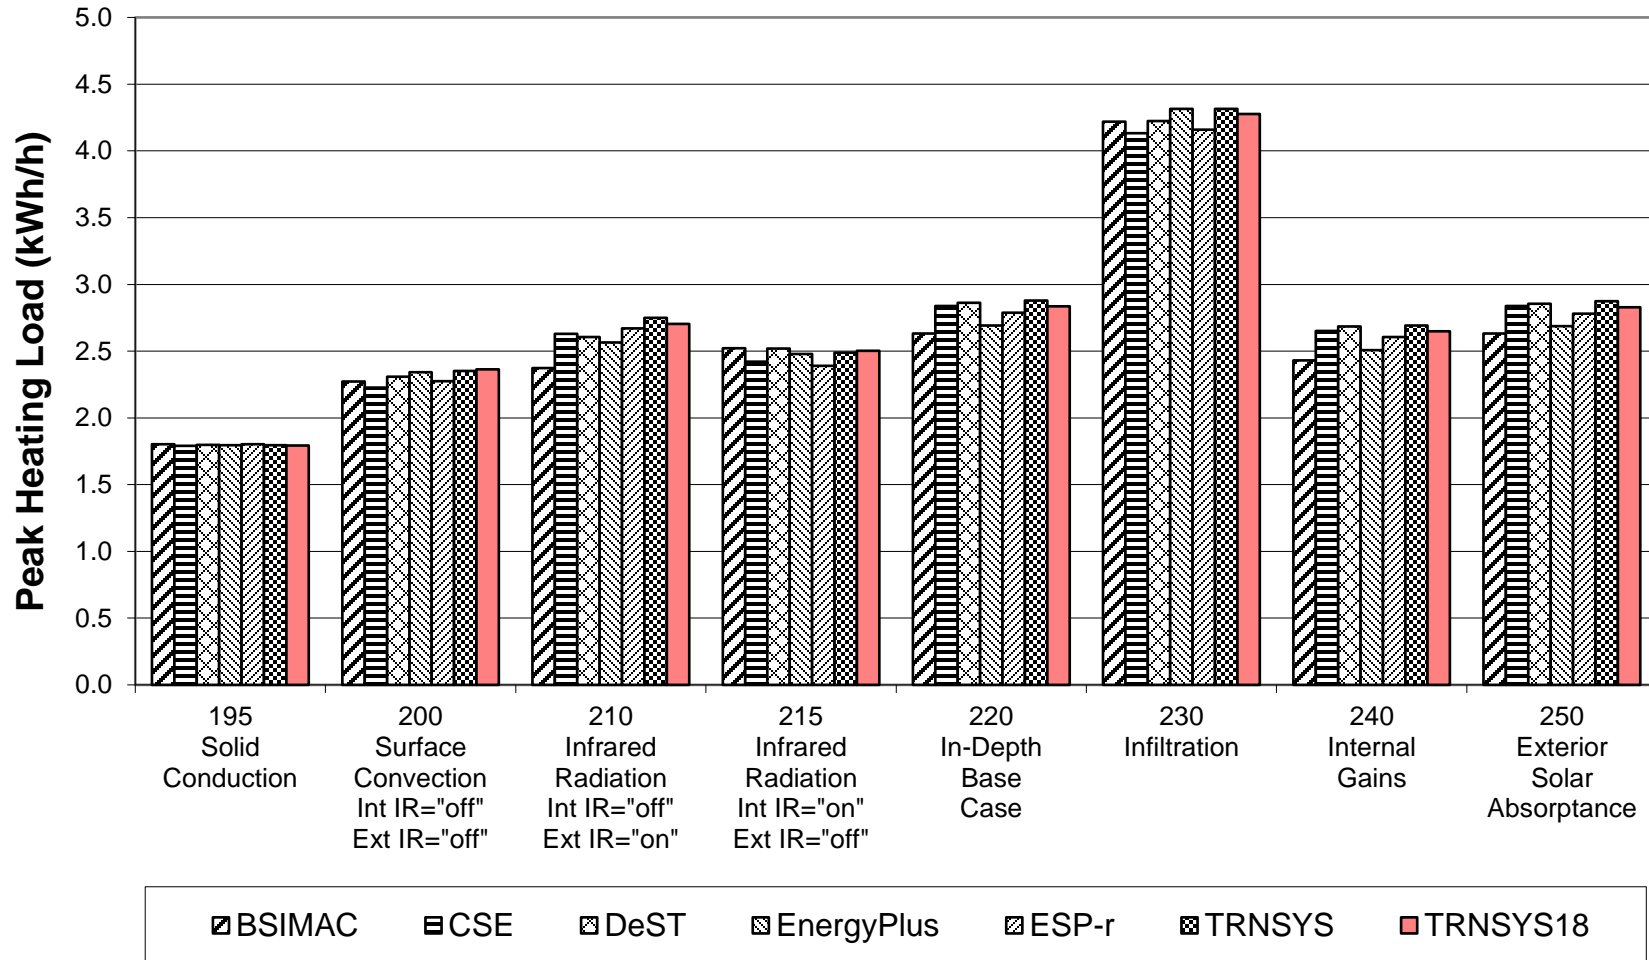


**Figure B8-39. In-Depth:
Low Mass Cases 195 to 250
Peak Sensible Cooling**

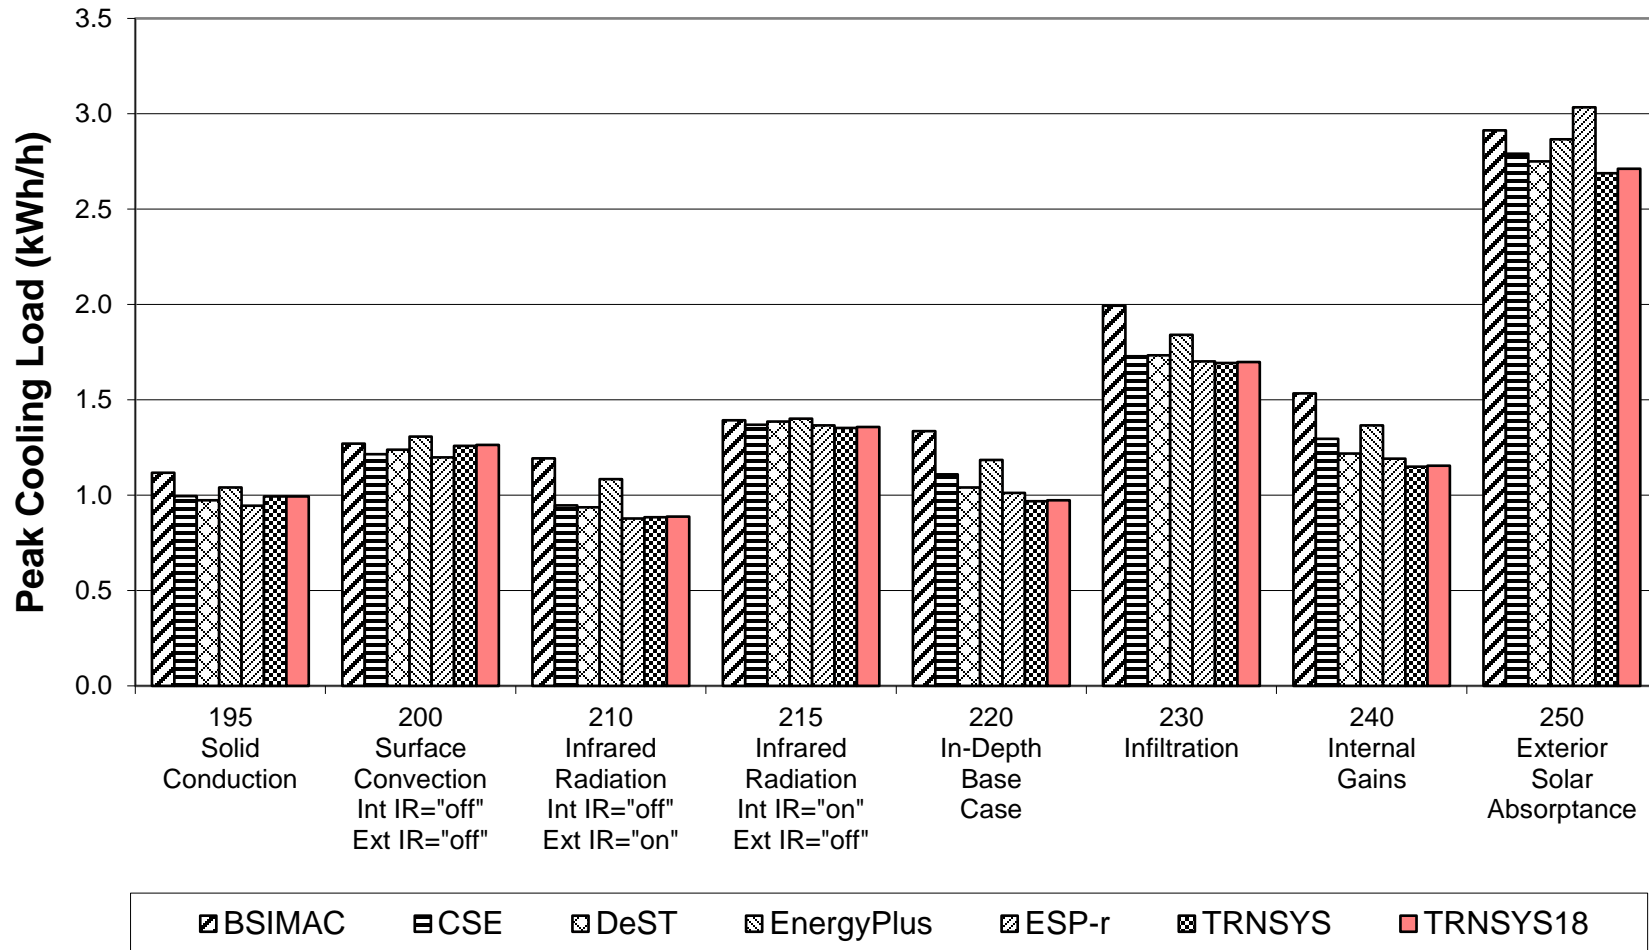


**Figure B8-40. In-Depth:
Low Mass Cases 270 to 320
Annual Heating**

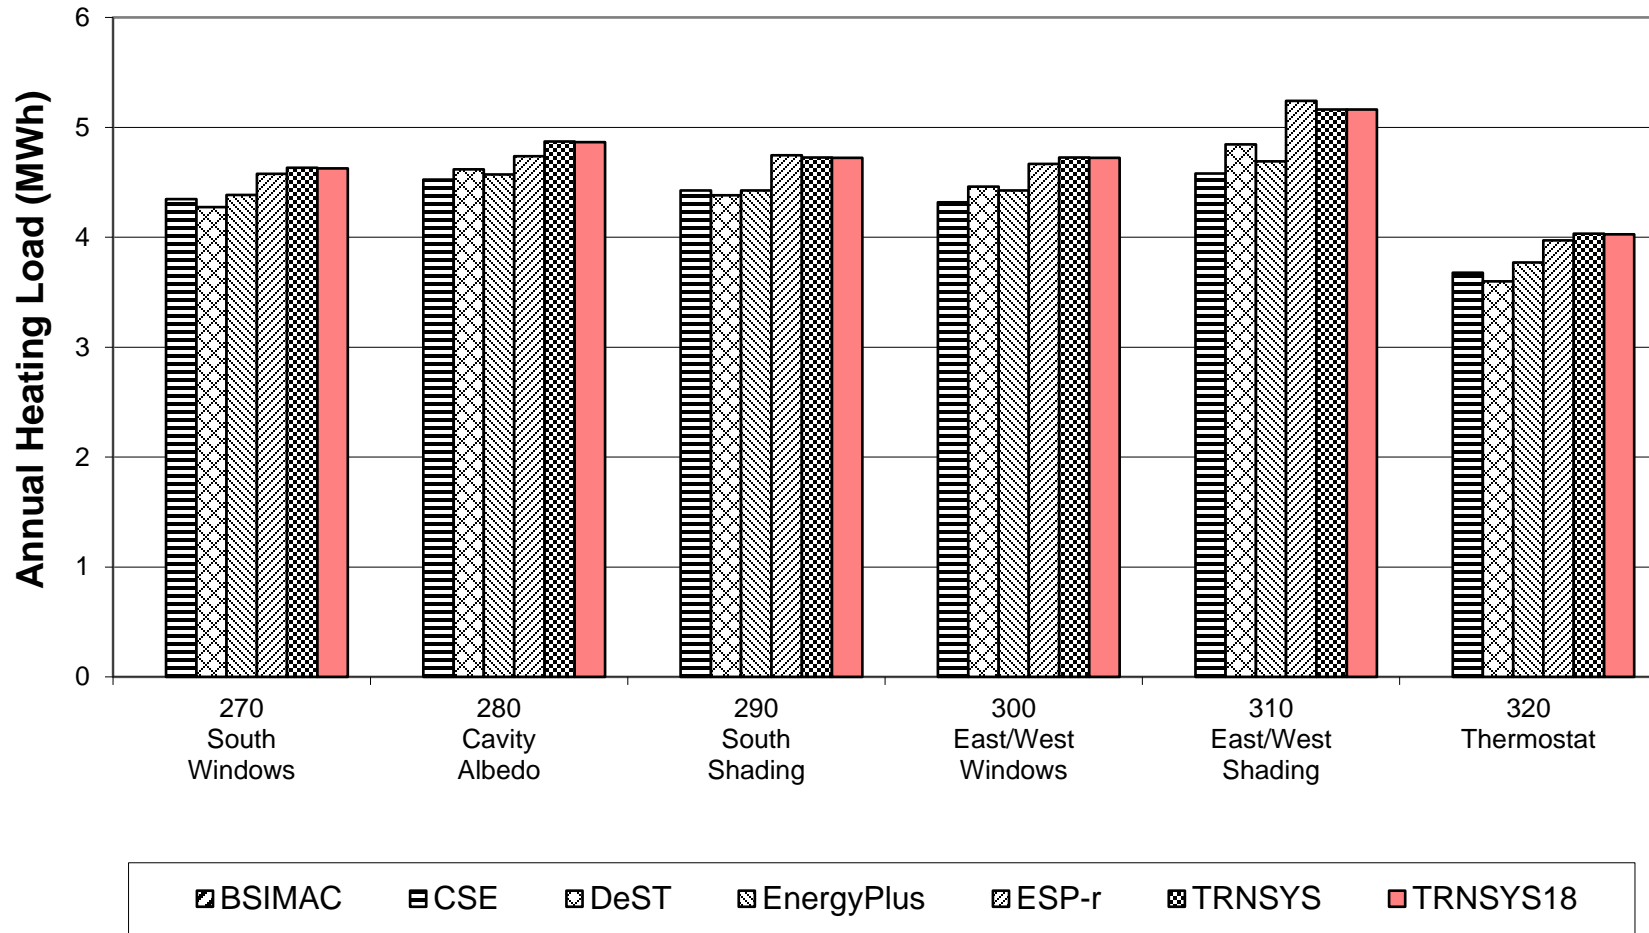


**Figure B8-41. In-Depth:
Low Mass Cases 270 to 320
Annual Sensible Cooling**

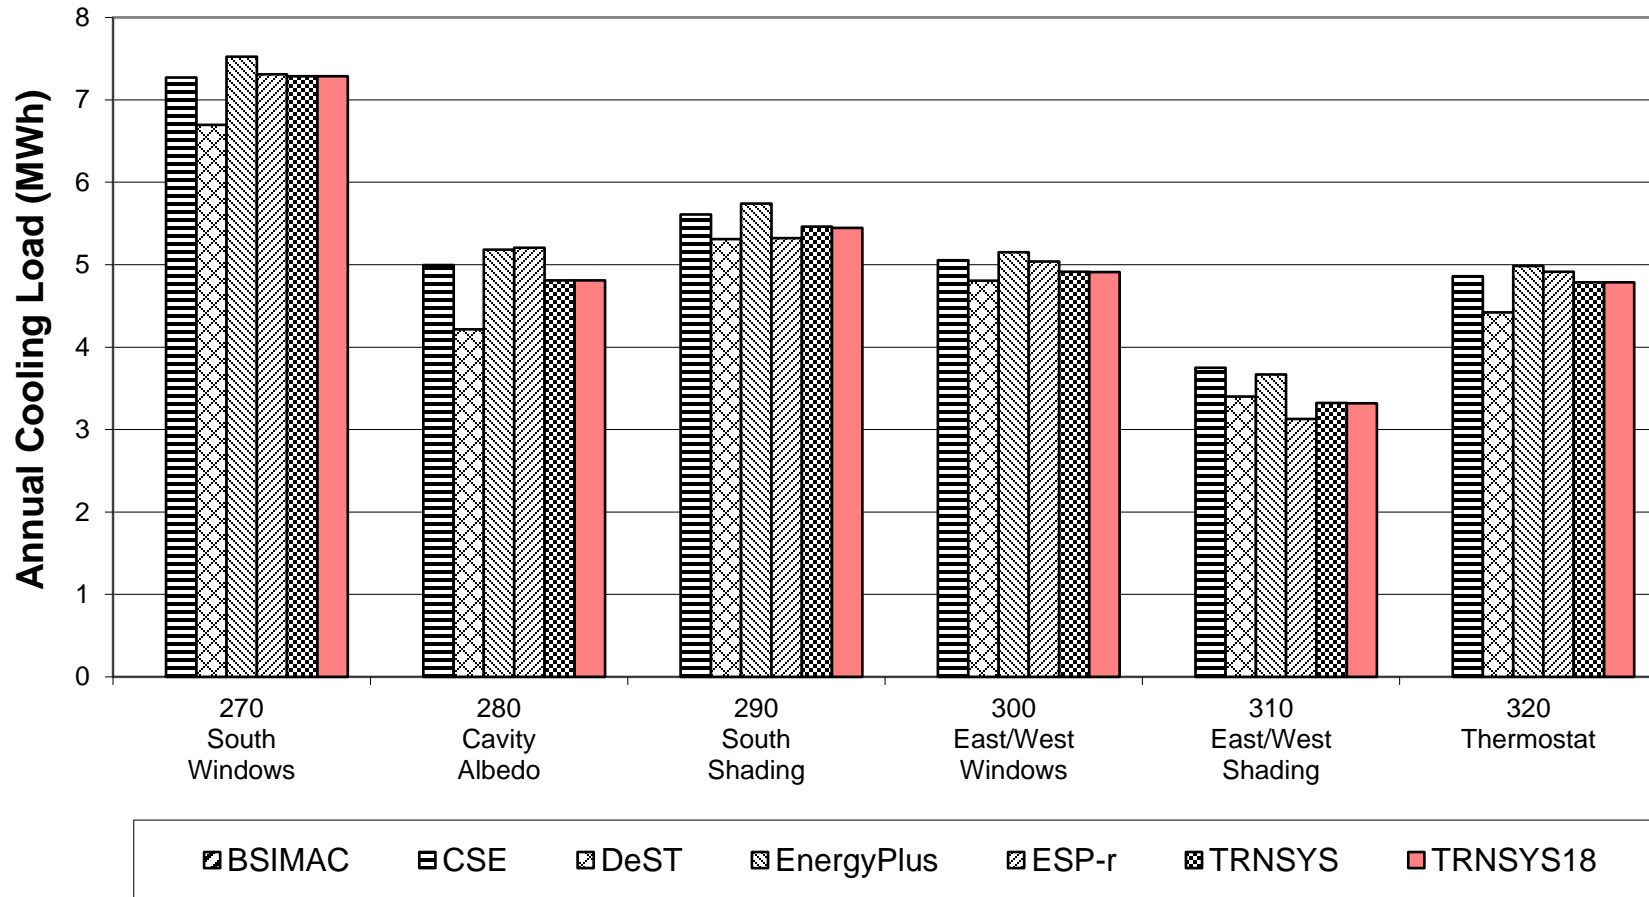


**Figure B8-42. In-Depth:
Low Mass Cases 270 to 320
Peak Heating**

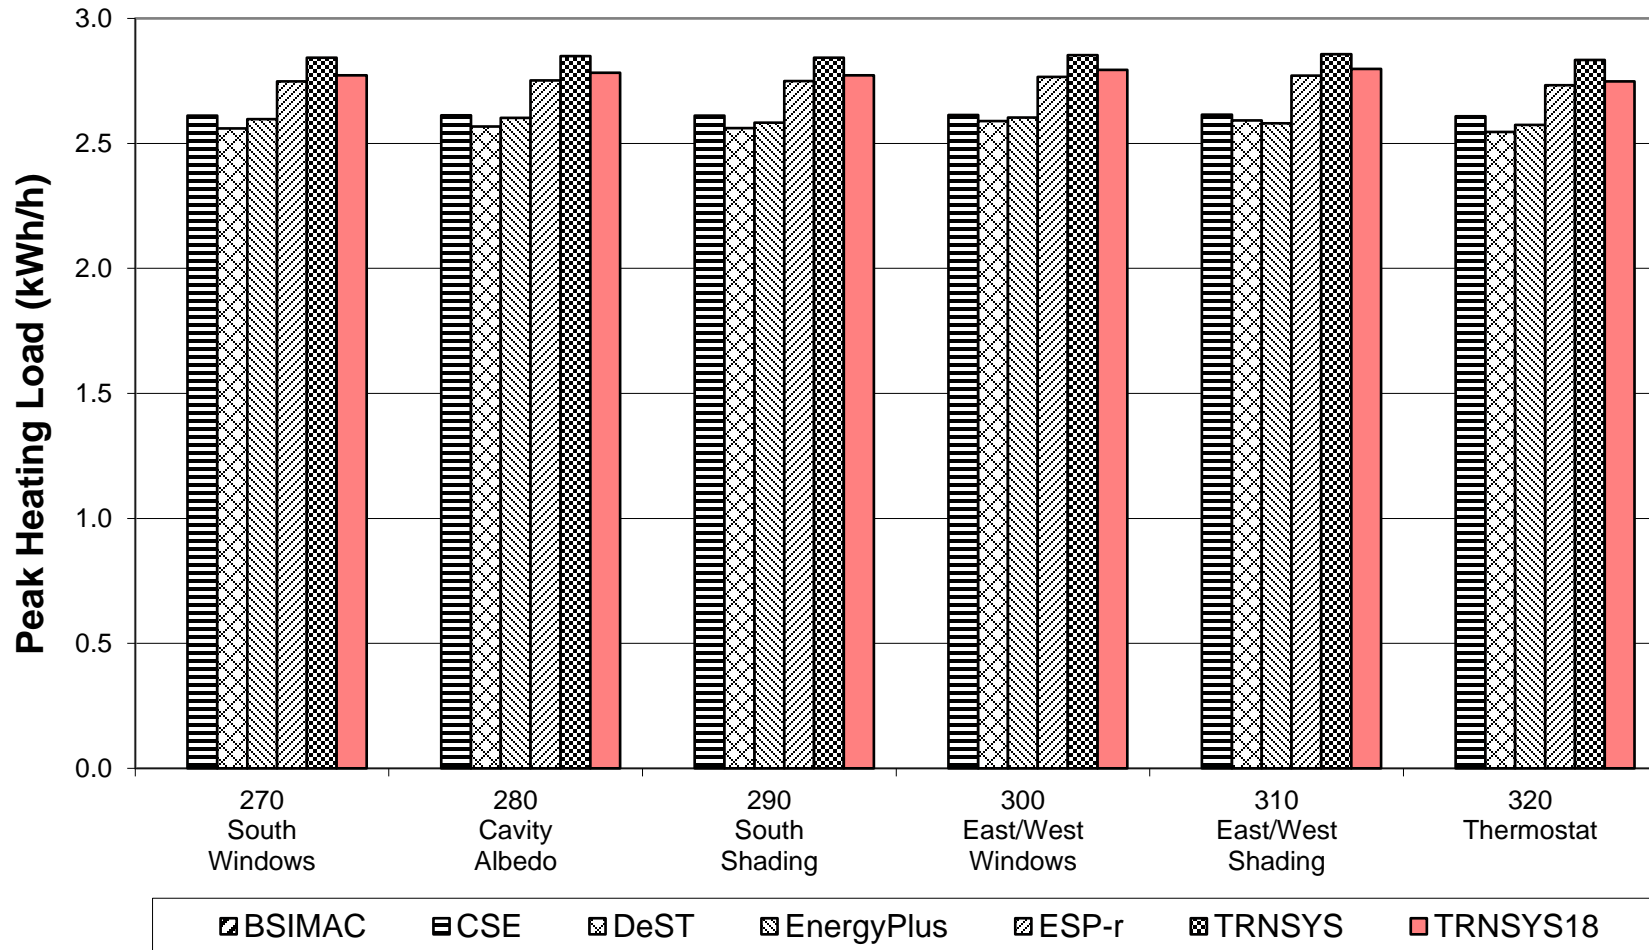


**Figure B8-43. In-Depth:
Low Mass Cases 270 to 320
Peak Sensible Cooling**

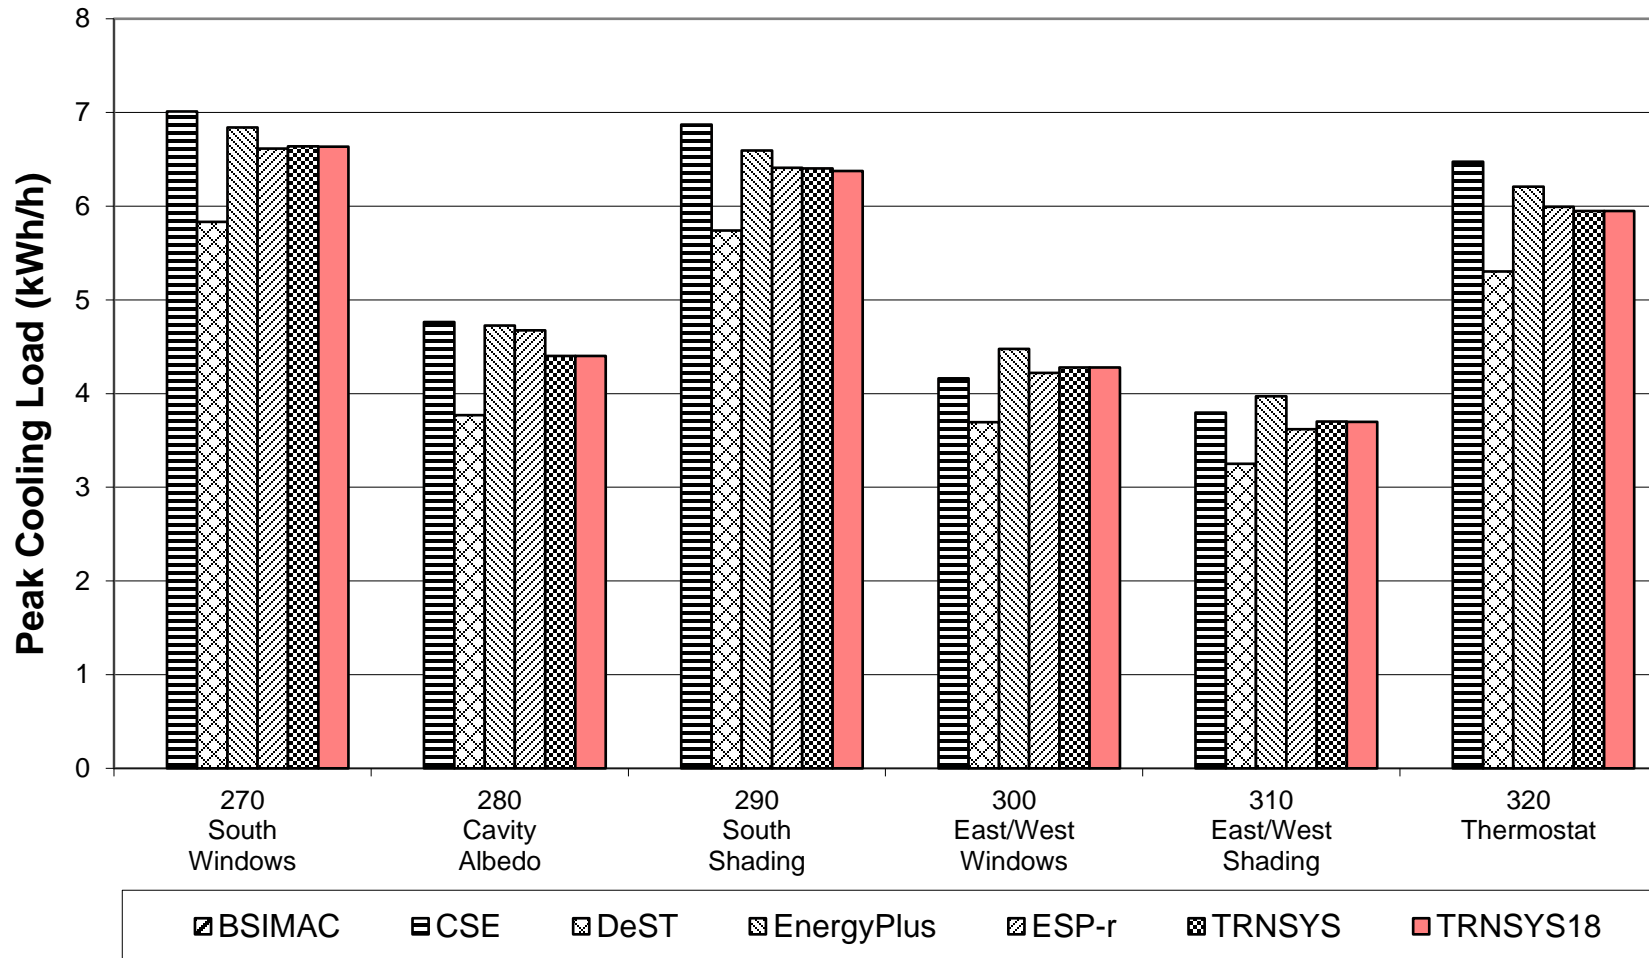


**Figure B8-44. In-Depth:
Cases 195 to 220 (Delta)
Annual Heating and Sensible Cooling**

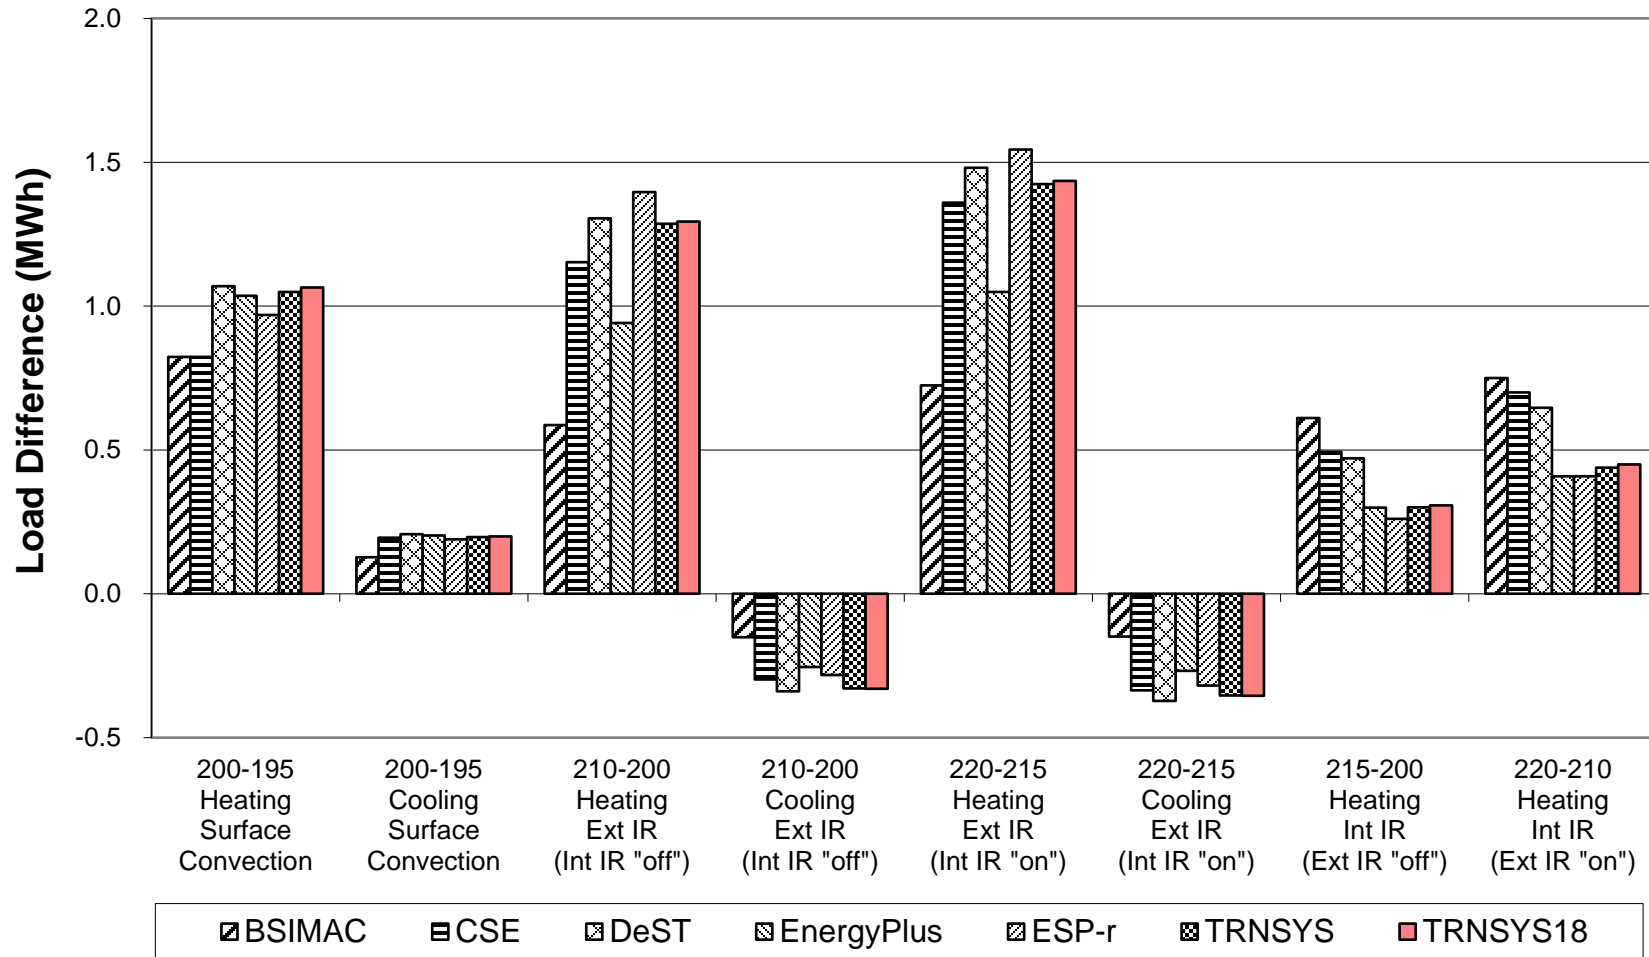


**Figure B8-45. In-Depth:
Cases 195 to 220 (Delta)
Peak Heating and Sensible Cooling**

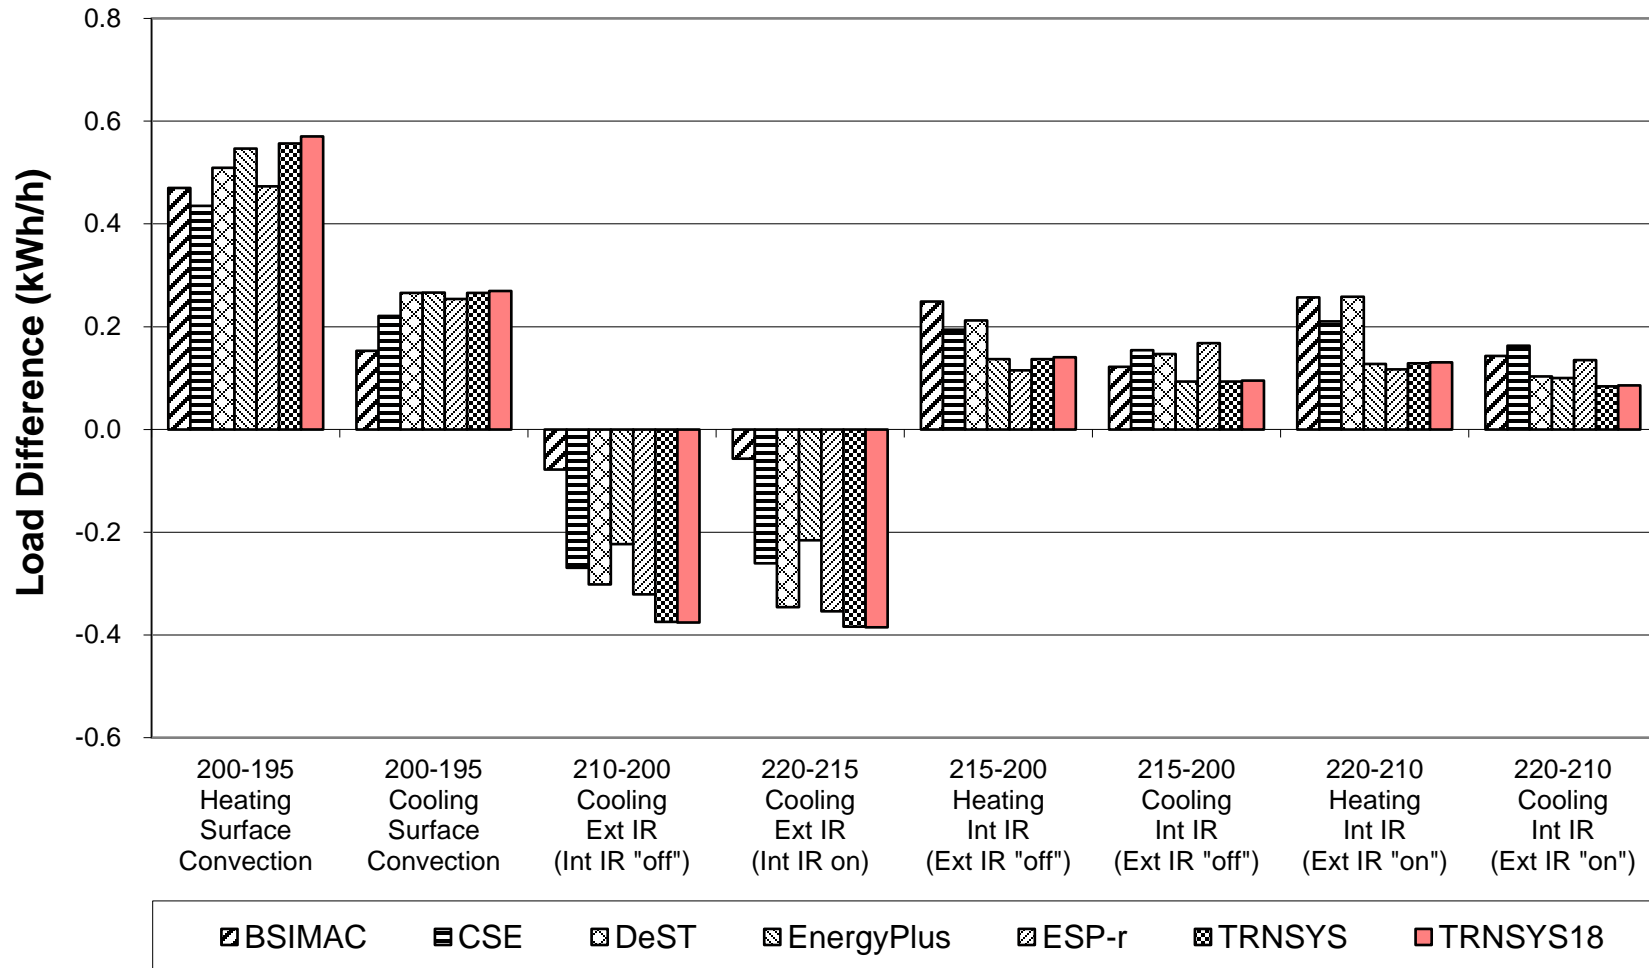


**Figure B8-47. In-Depth:
Cases 220 to 270 (Delta)
Peak Heating and Sensible Cooling**

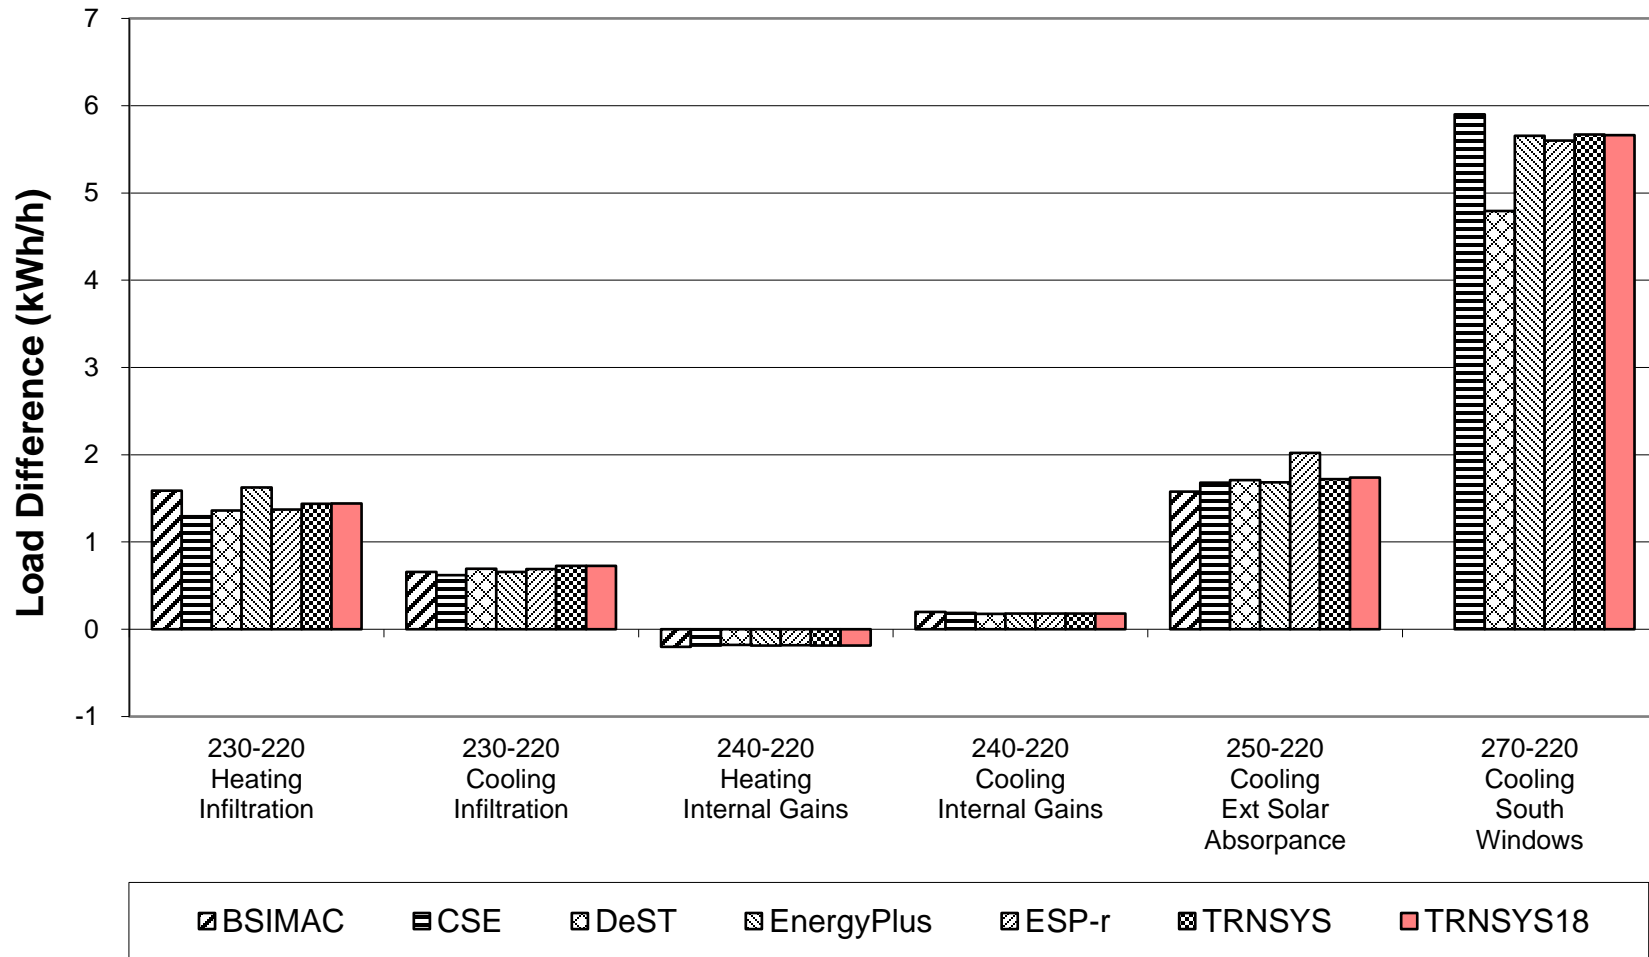


**Figure B8-48. In-Depth:
Cases 270 to 320 (Delta)
Annual Heating and Sensible Cooling**

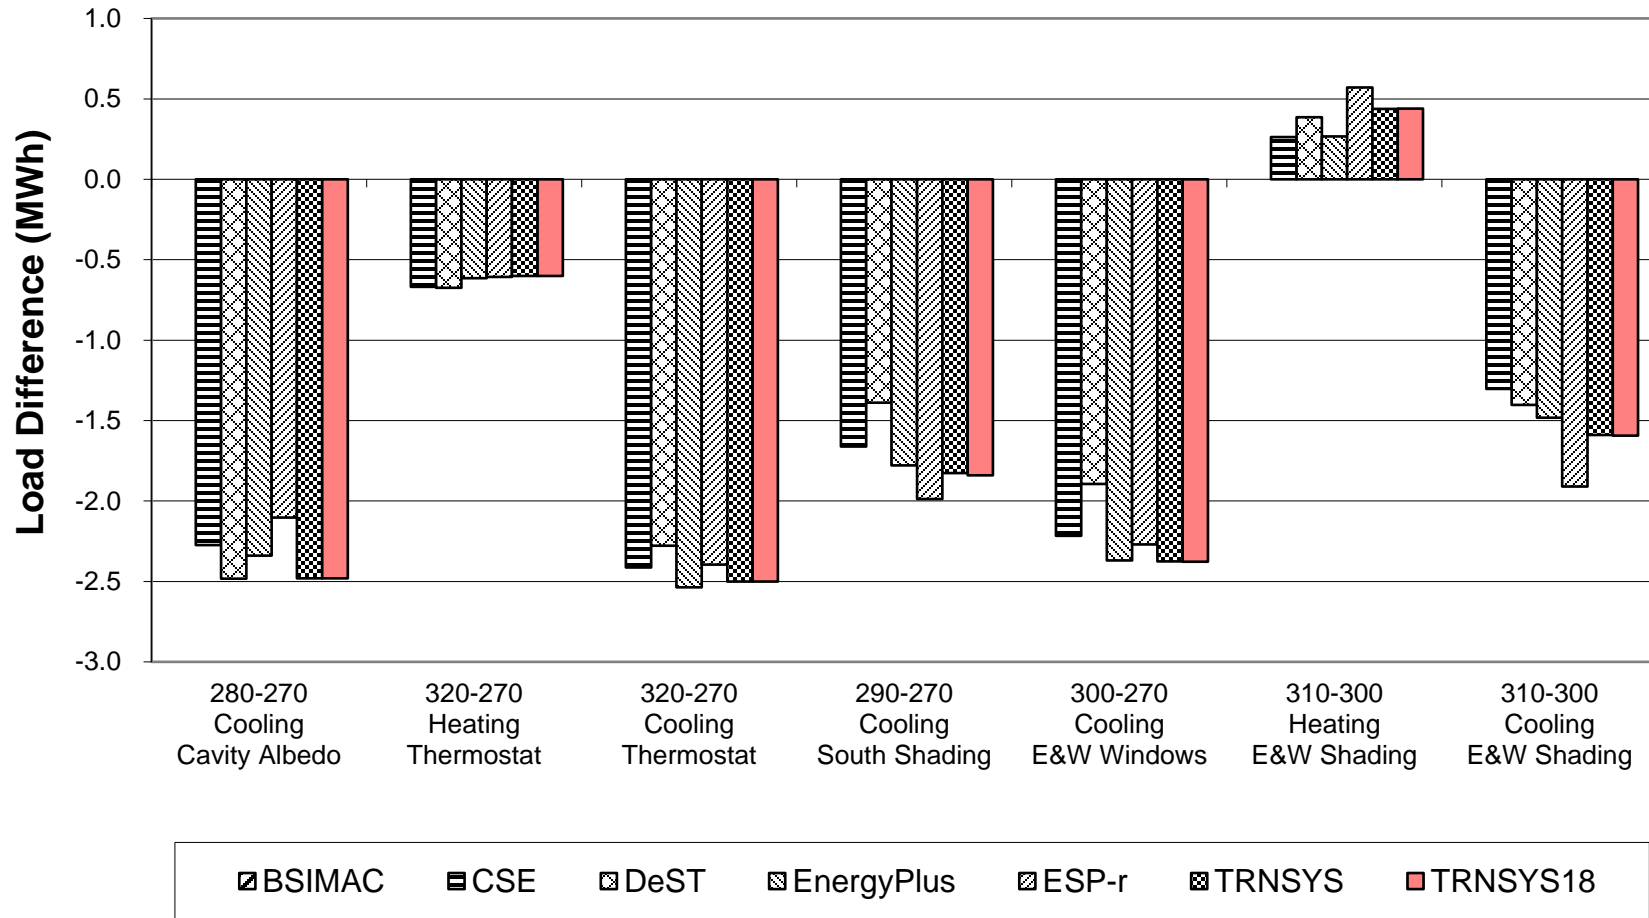

**Figure B8-49. In-Depth:
Cases 270 to 320 (Delta)
Peak Sensible Cooling**

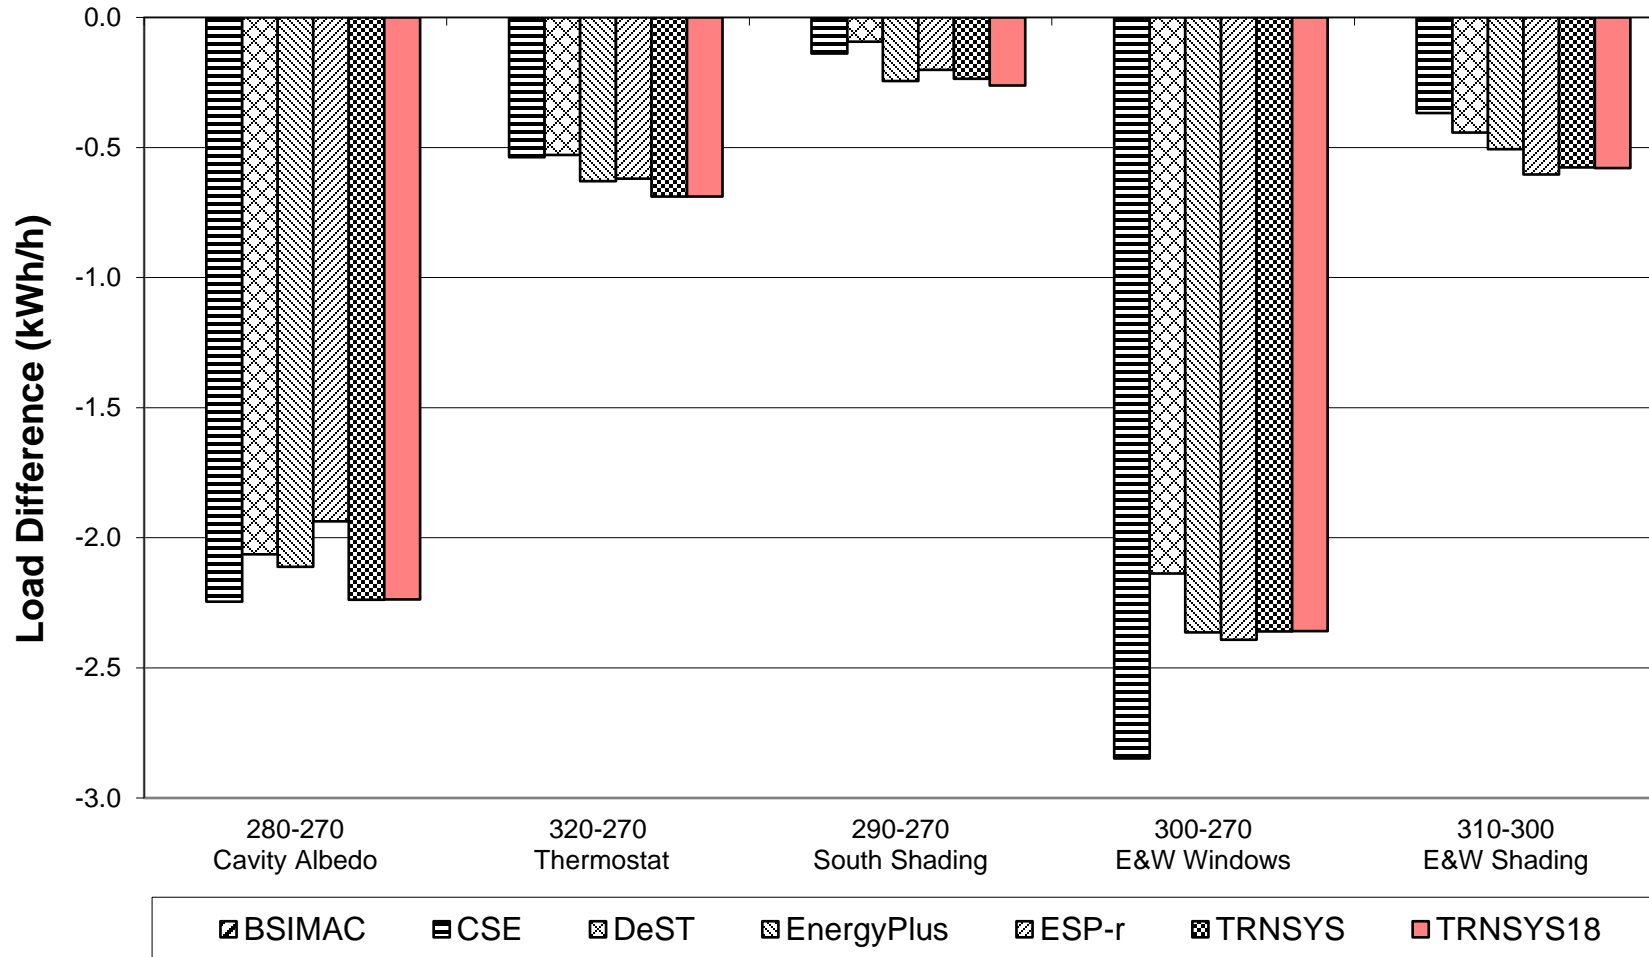


**Figure B8-50. In-Depth:
Cases 395 to 440, 800, 810
Annual Heating**

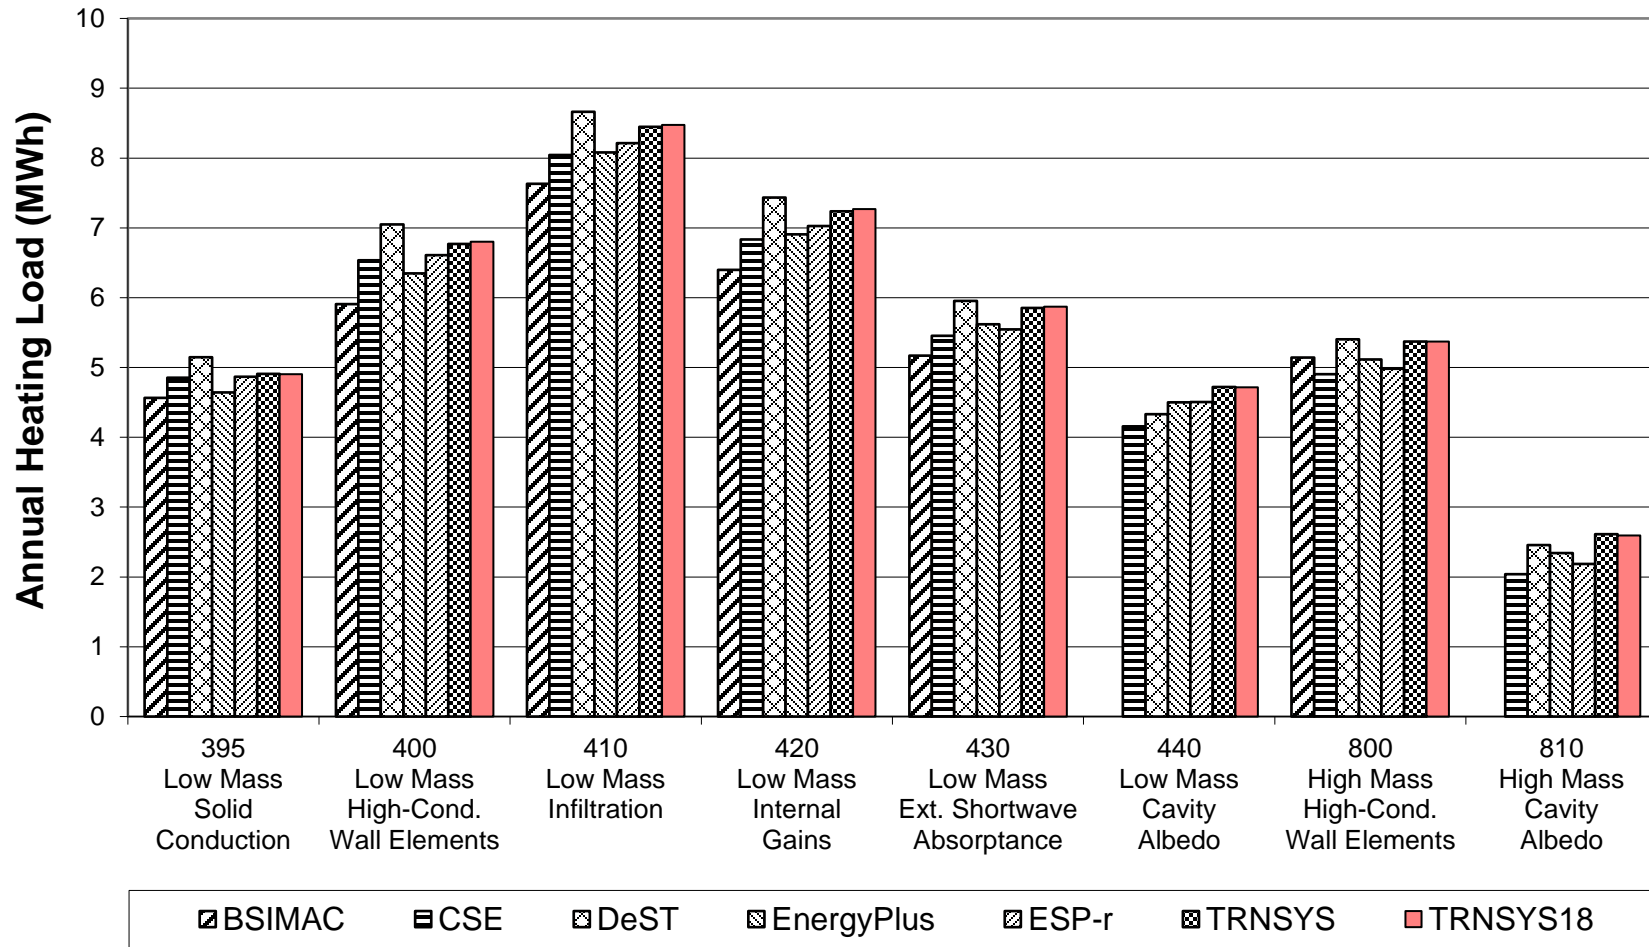


ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF (TRNSYS18) vs. Annex B8, Section B8.1 Example Results, by Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024


**Figure B8-51. In-Depth:
Cases 395 to 440, 800, 810
Annual Sensible Cooling**

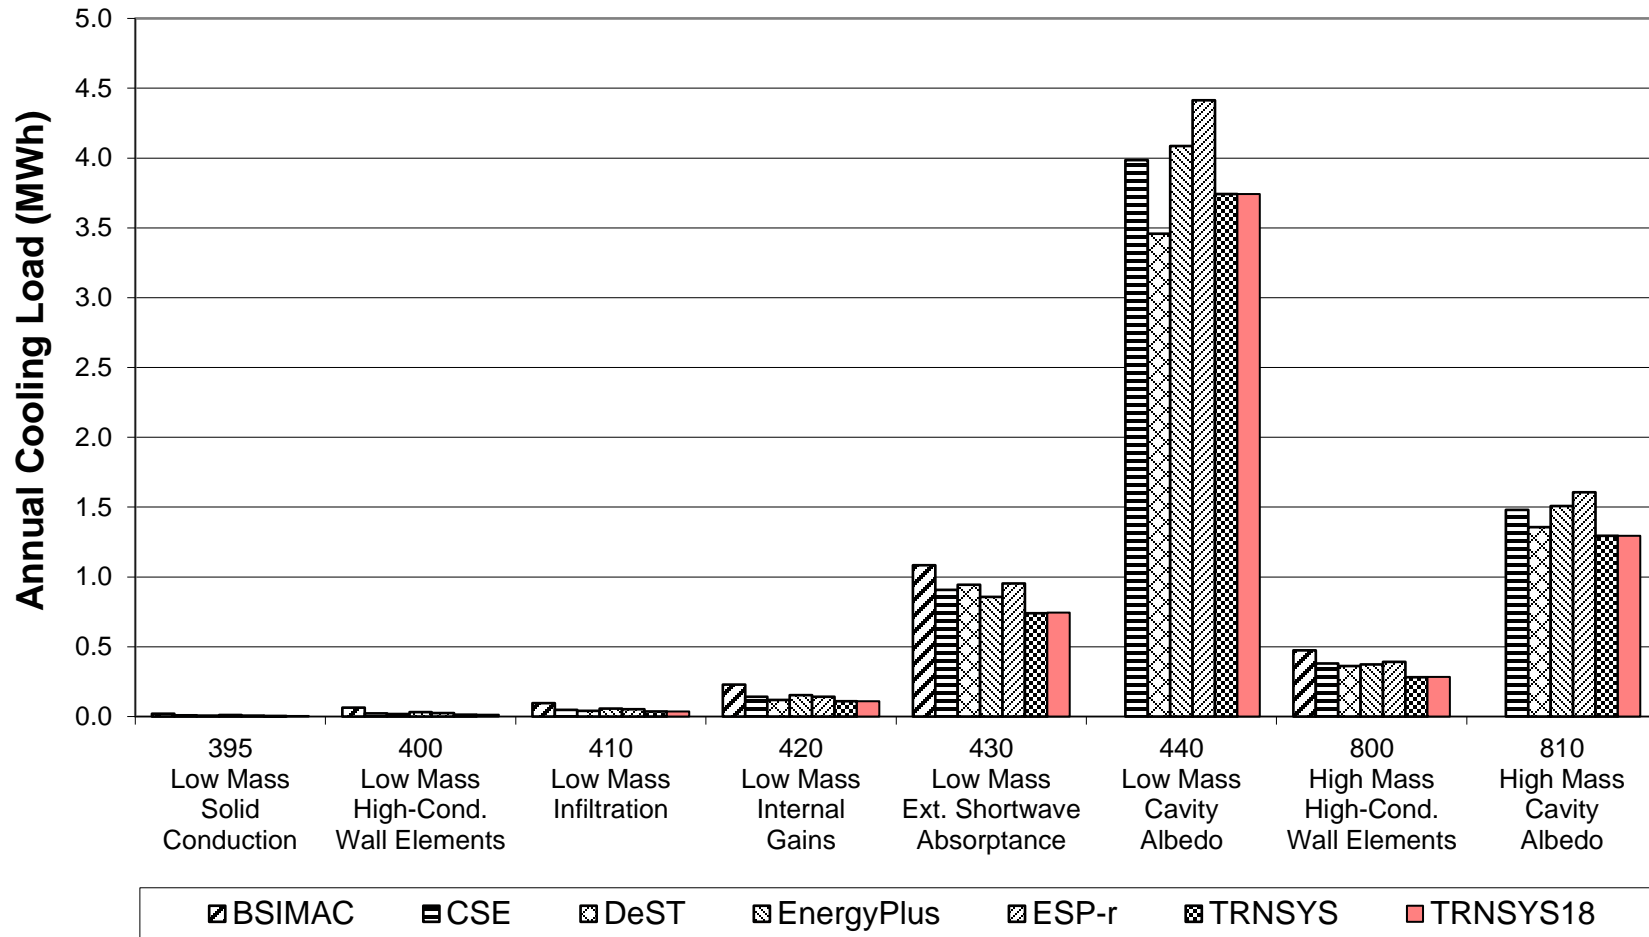


**Figure B8-52. In-Depth:
Cases 395 to 440, 800, 810
Peak Heating**

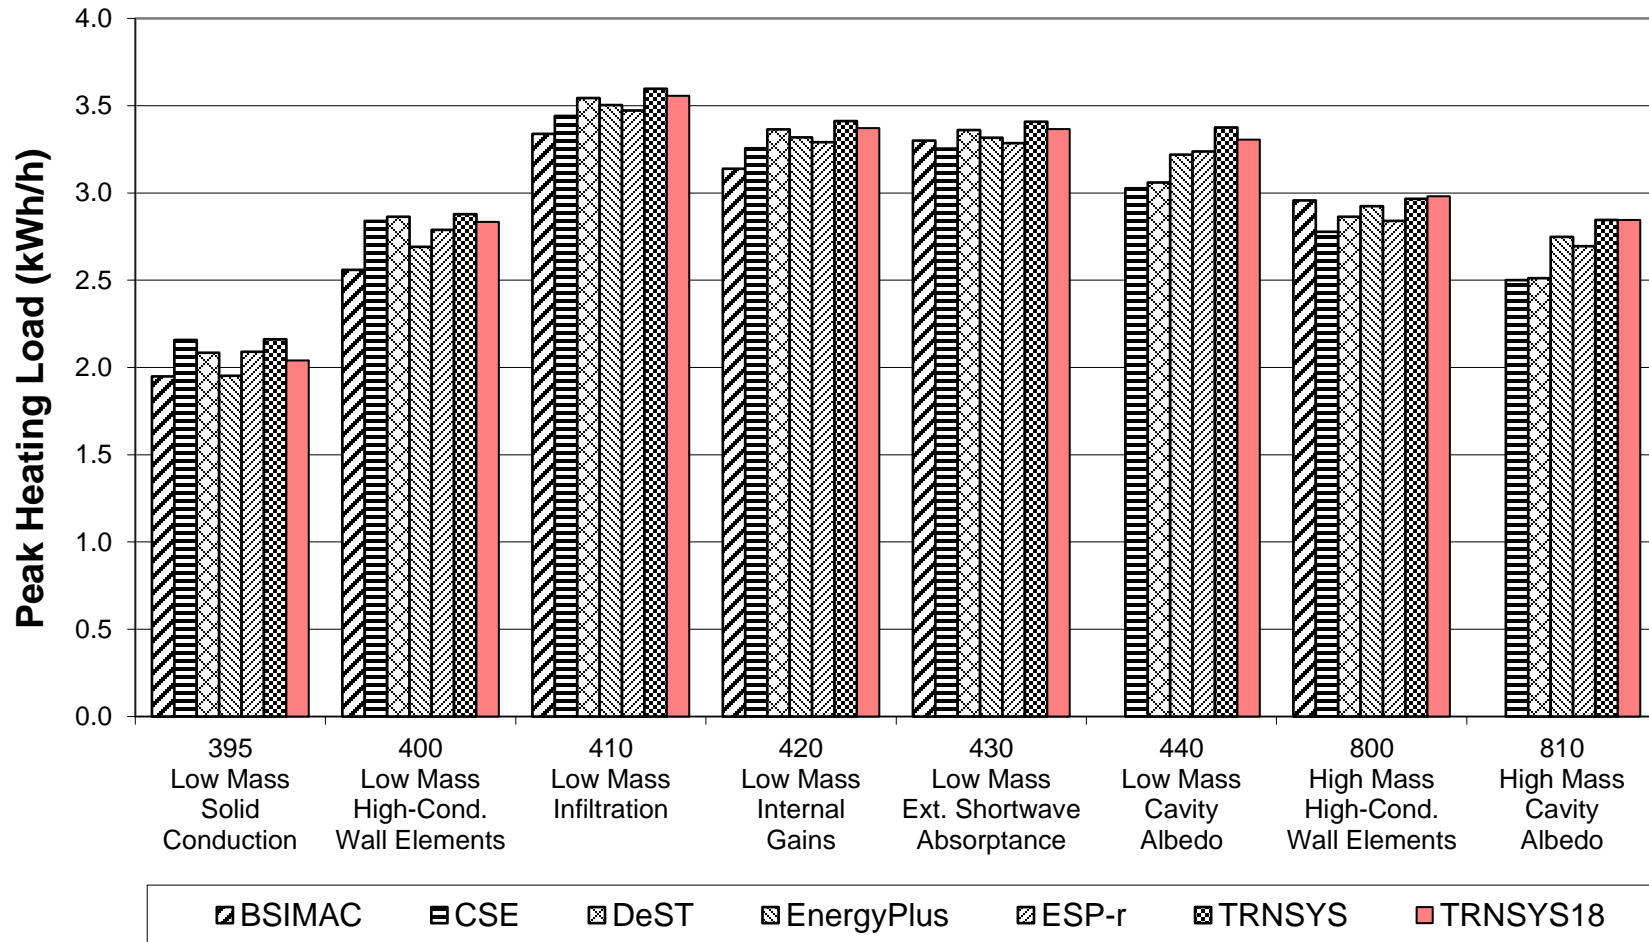


**Figure B8-53. In-Depth:
Cases 395 to 440, 800, 810
Peak Sensible Cooling**

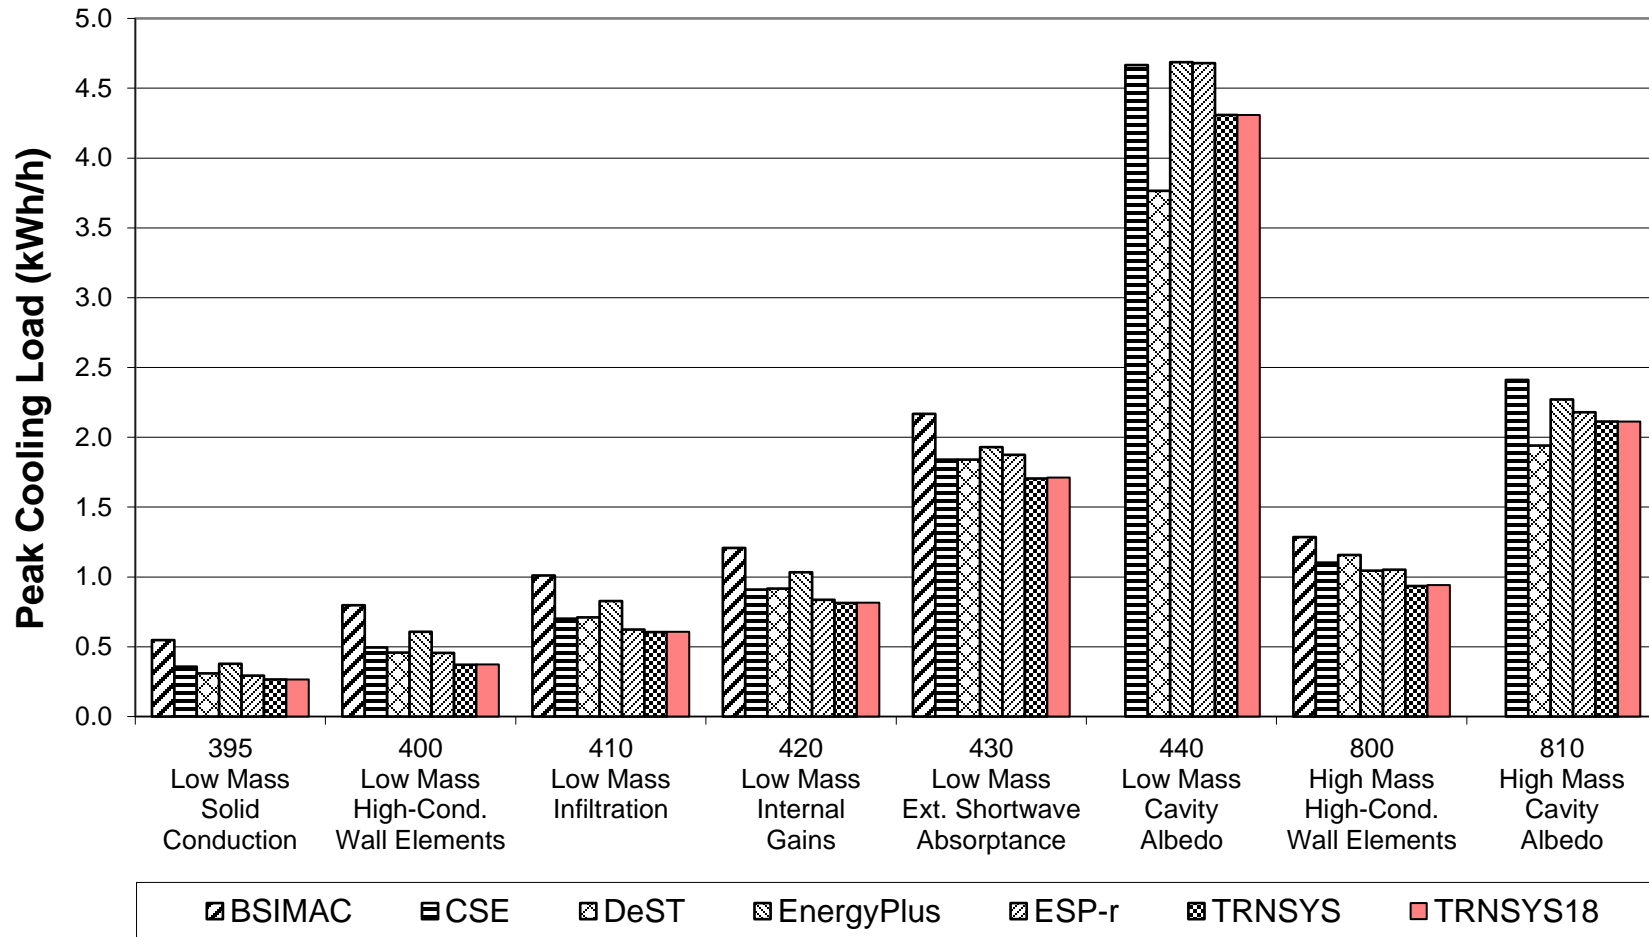


**Figure B8-56. In-Depth: Surface Heat Transfer
Cases 600, 450, 460, 470
Annual Heating and Sensible Cooling**

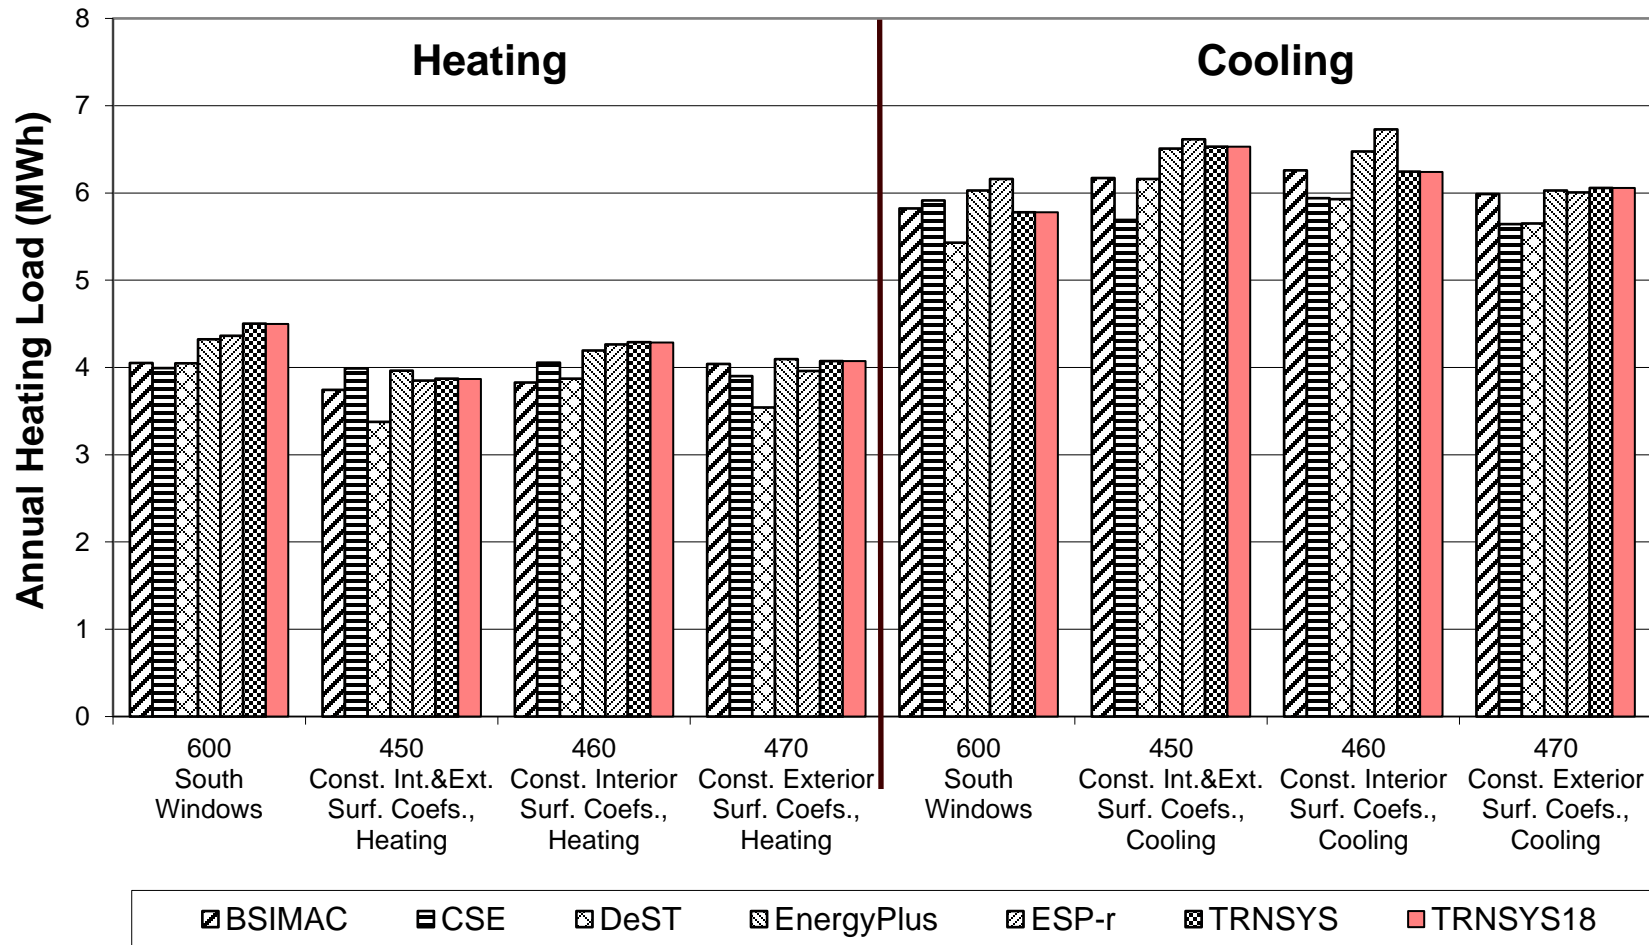


**Figure B8-57. In-Depth: Surface Heat Transfer
Cases 600, 450, 460, 470
Peak Heating and Sensible Cooling**

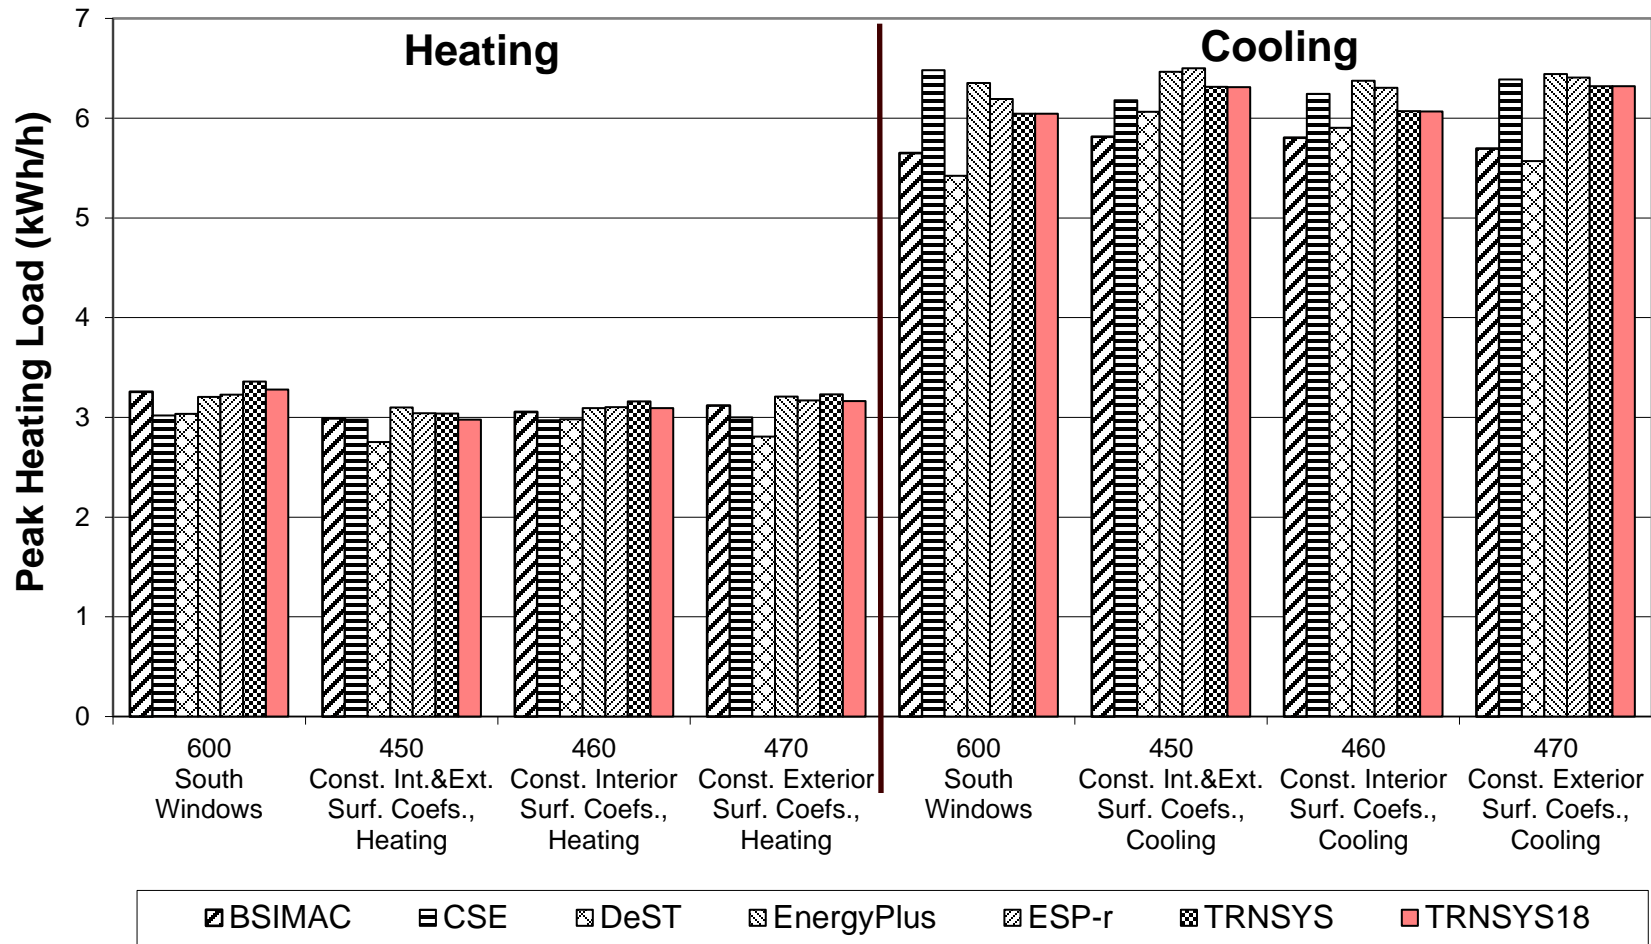

**Figure B8-58. In-Depth: Surface Heat Transfer
Cases 450 to 600 (Delta)
Annual Heating and Sensible Cooling**

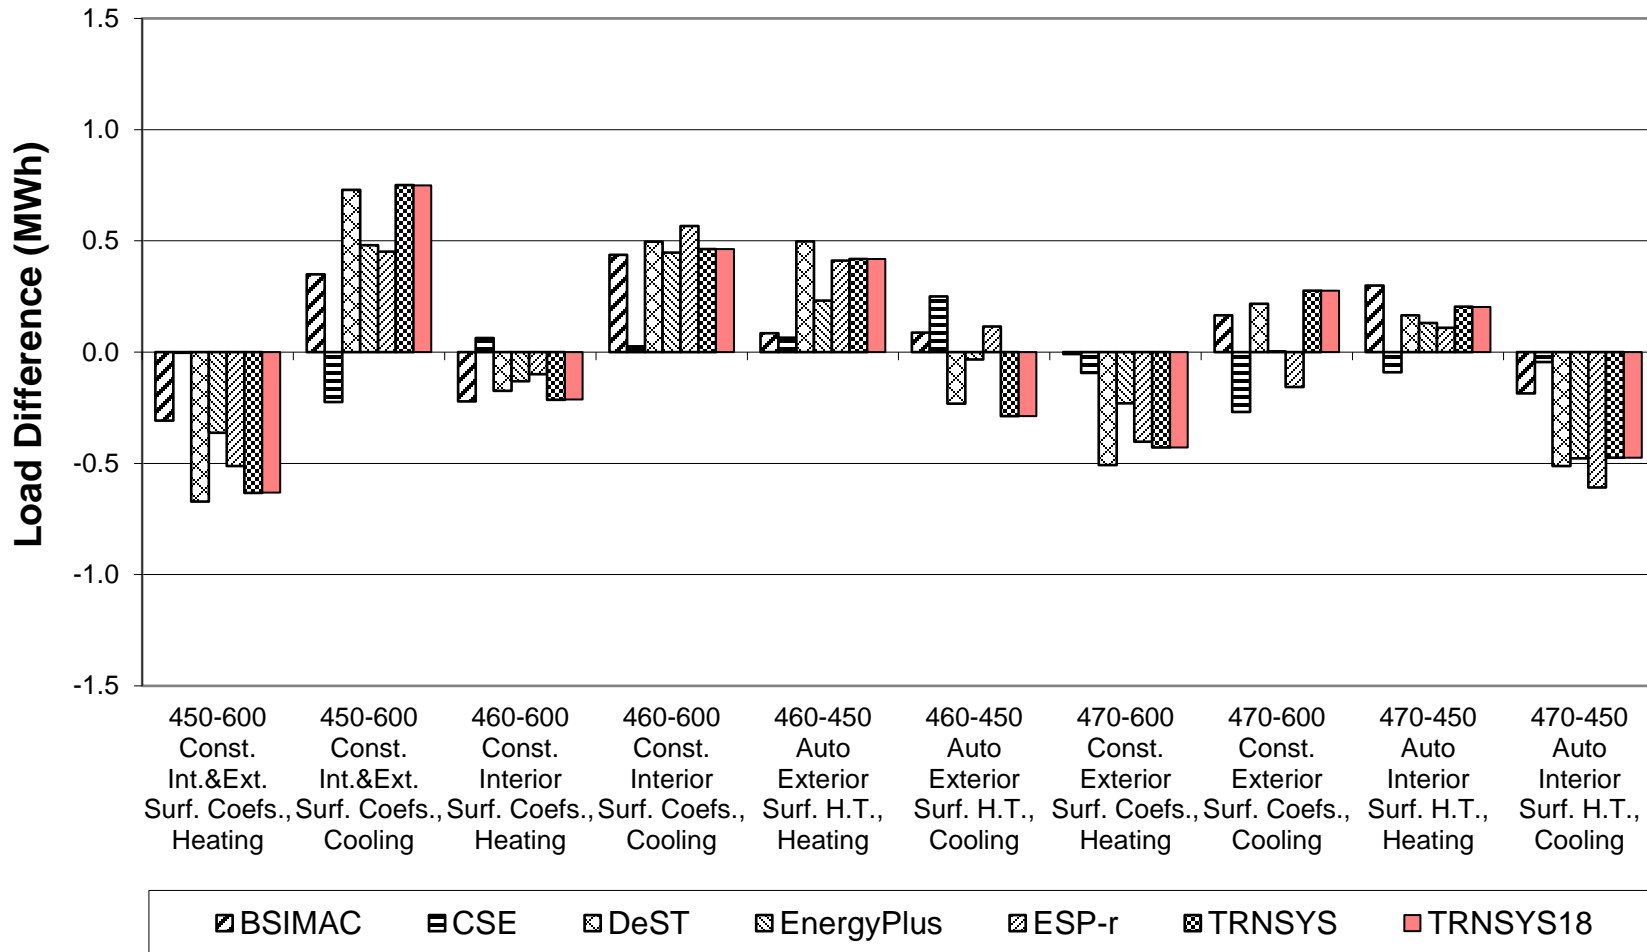


**Figure B8-59. In-Depth: Surface Heat Transfer
Cases 450 to 600 (Delta)
Peak Heating and Sensible Cooling**

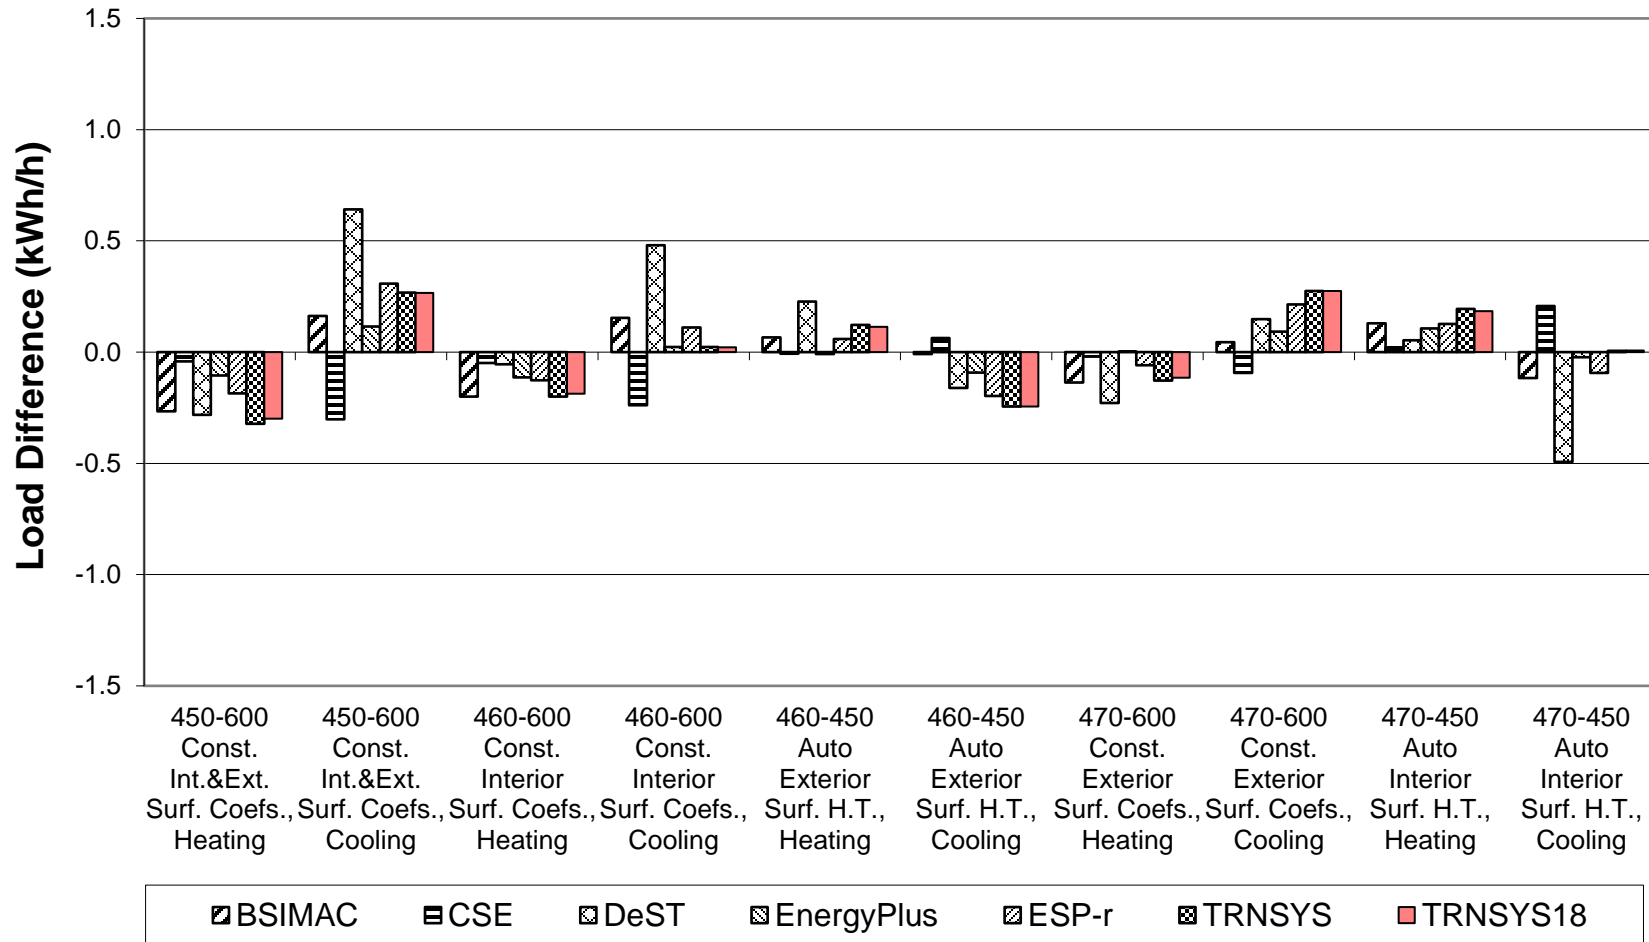


ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF (TRNSYS18) vs. Annex B8, Section B8.1 Example Results, by Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

**Figure B8-M1.
Monthly Heating
Case 600**

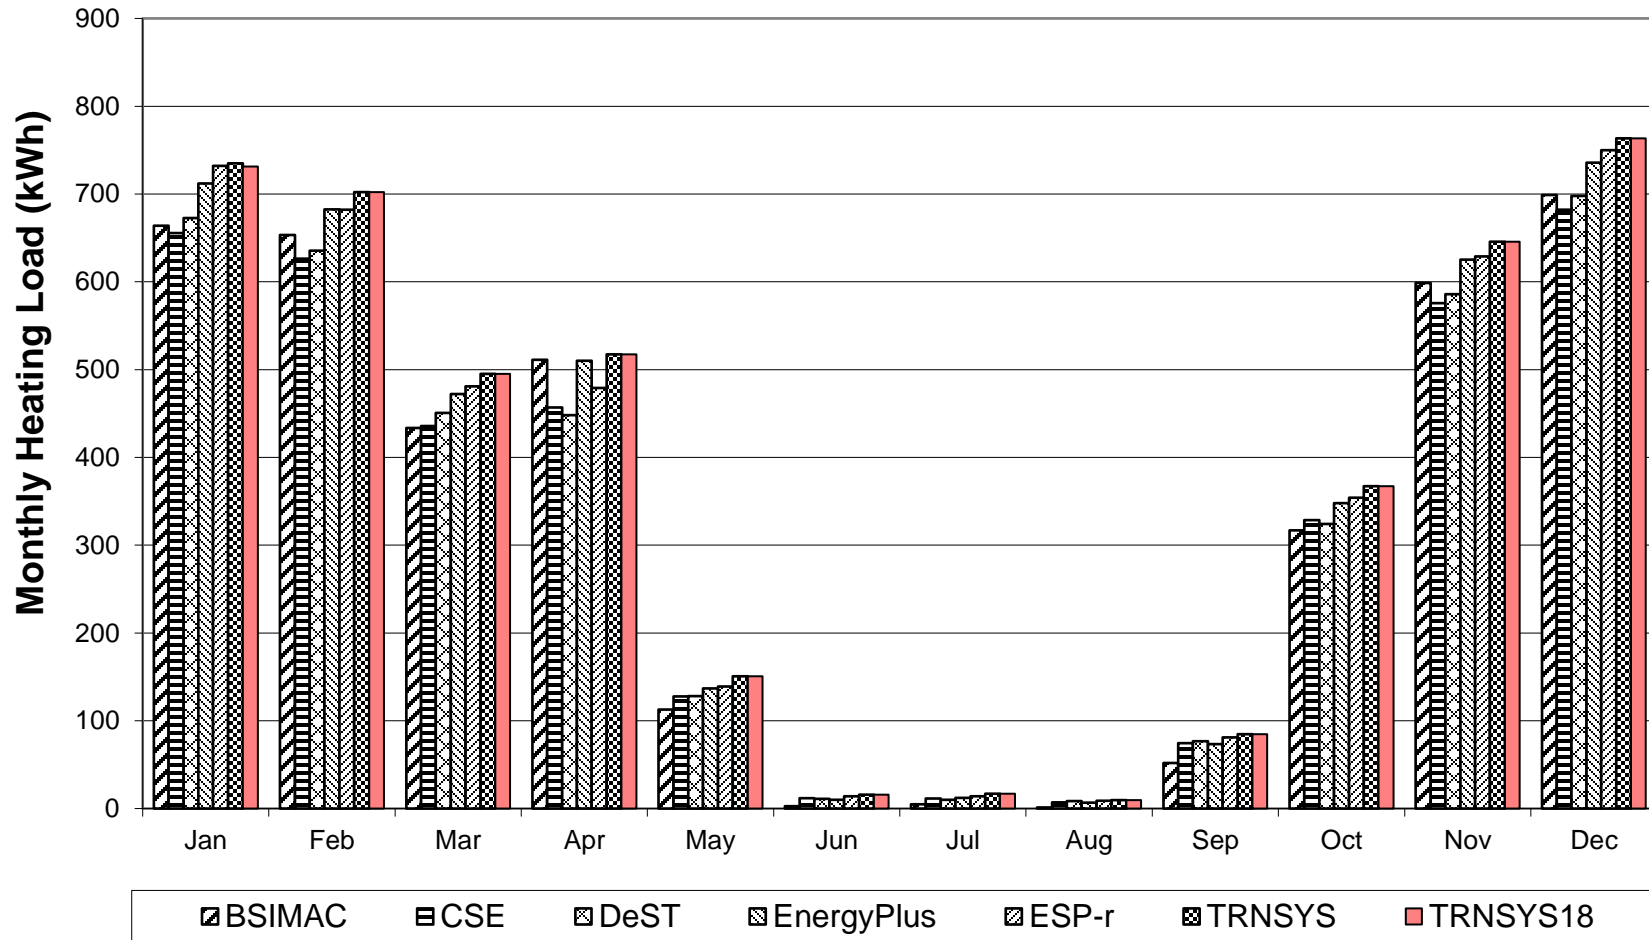


ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF (TRNSYS18) vs. Annex B8, Section B8.1 Example Results, by Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

Figure B8-M2.
Monthly Sensible Cooling
Case 600

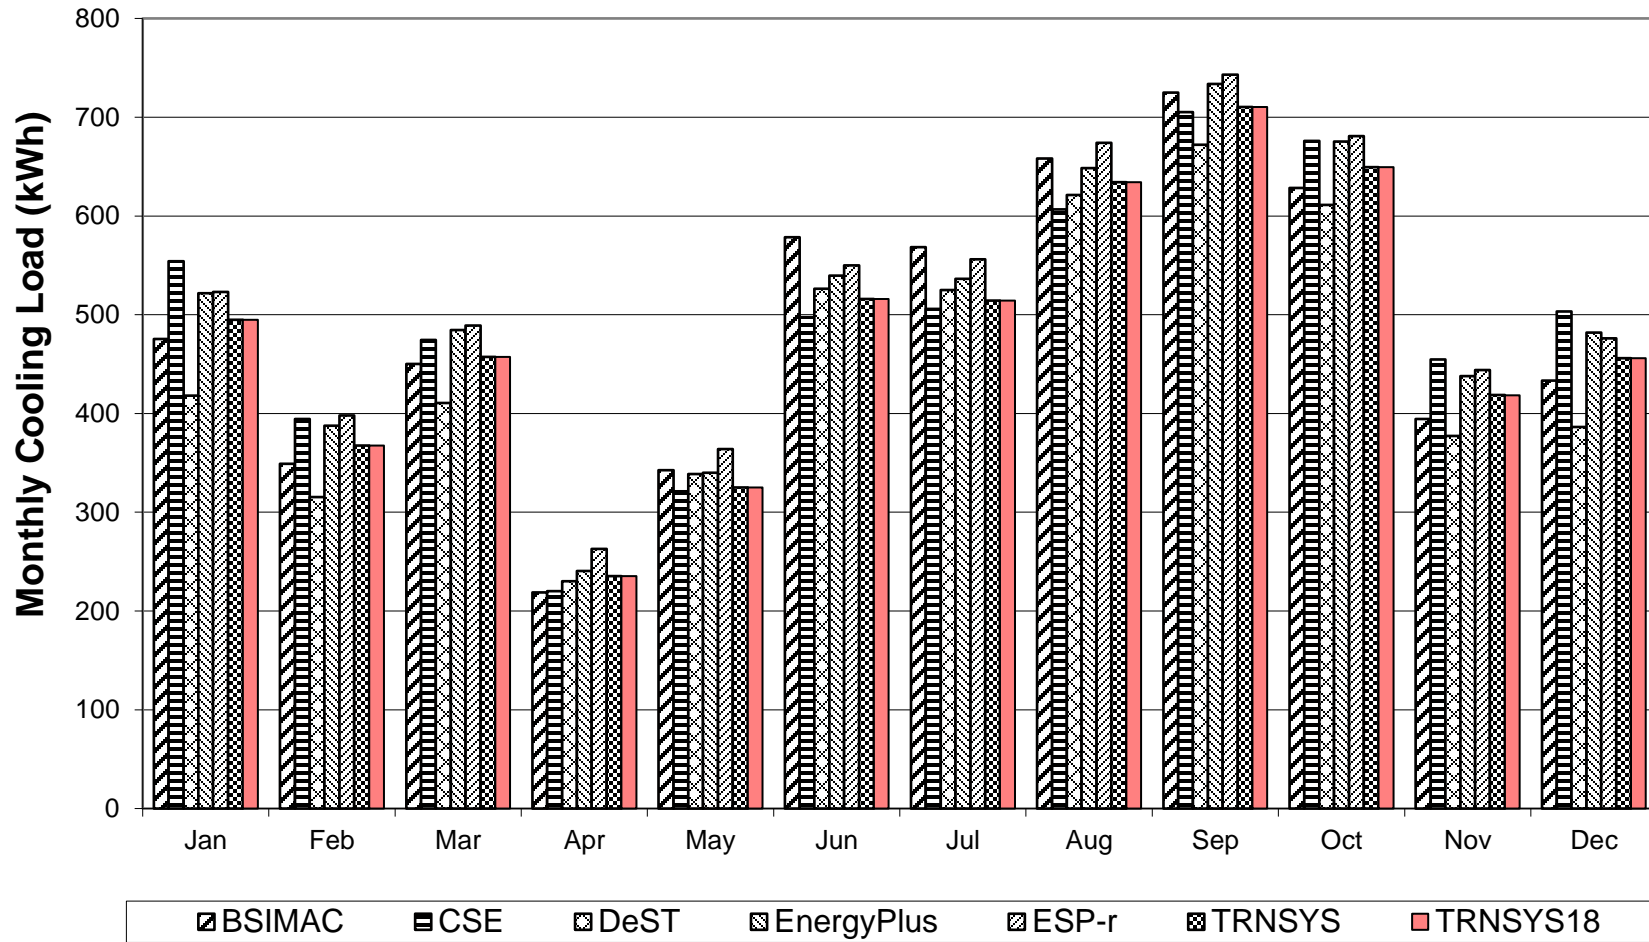


ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF (TRNSYS18) vs. Annex B8, Section B8.1 Example Results, by Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

**Figure B8-M3.
Monthly Peak Heating
Case 600**

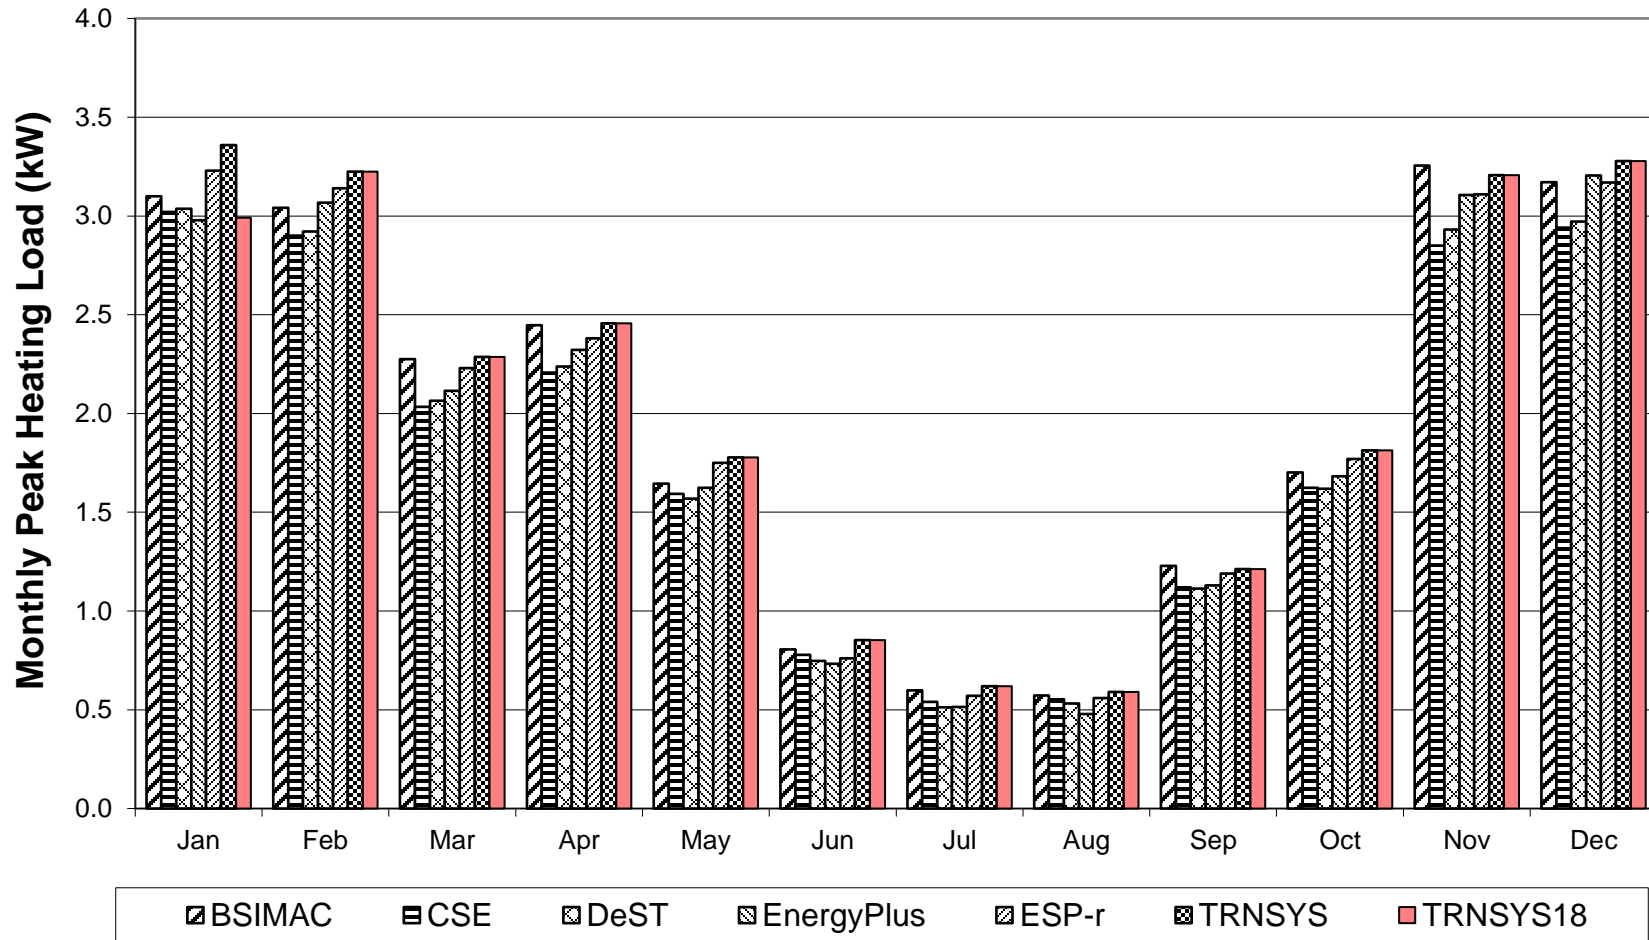


ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF (TRNSYS18) vs. Annex B8, Section B8.1 Example Results, by Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

Figure B8-M4.
Monthly Peak Sensible Cooling
Case 600

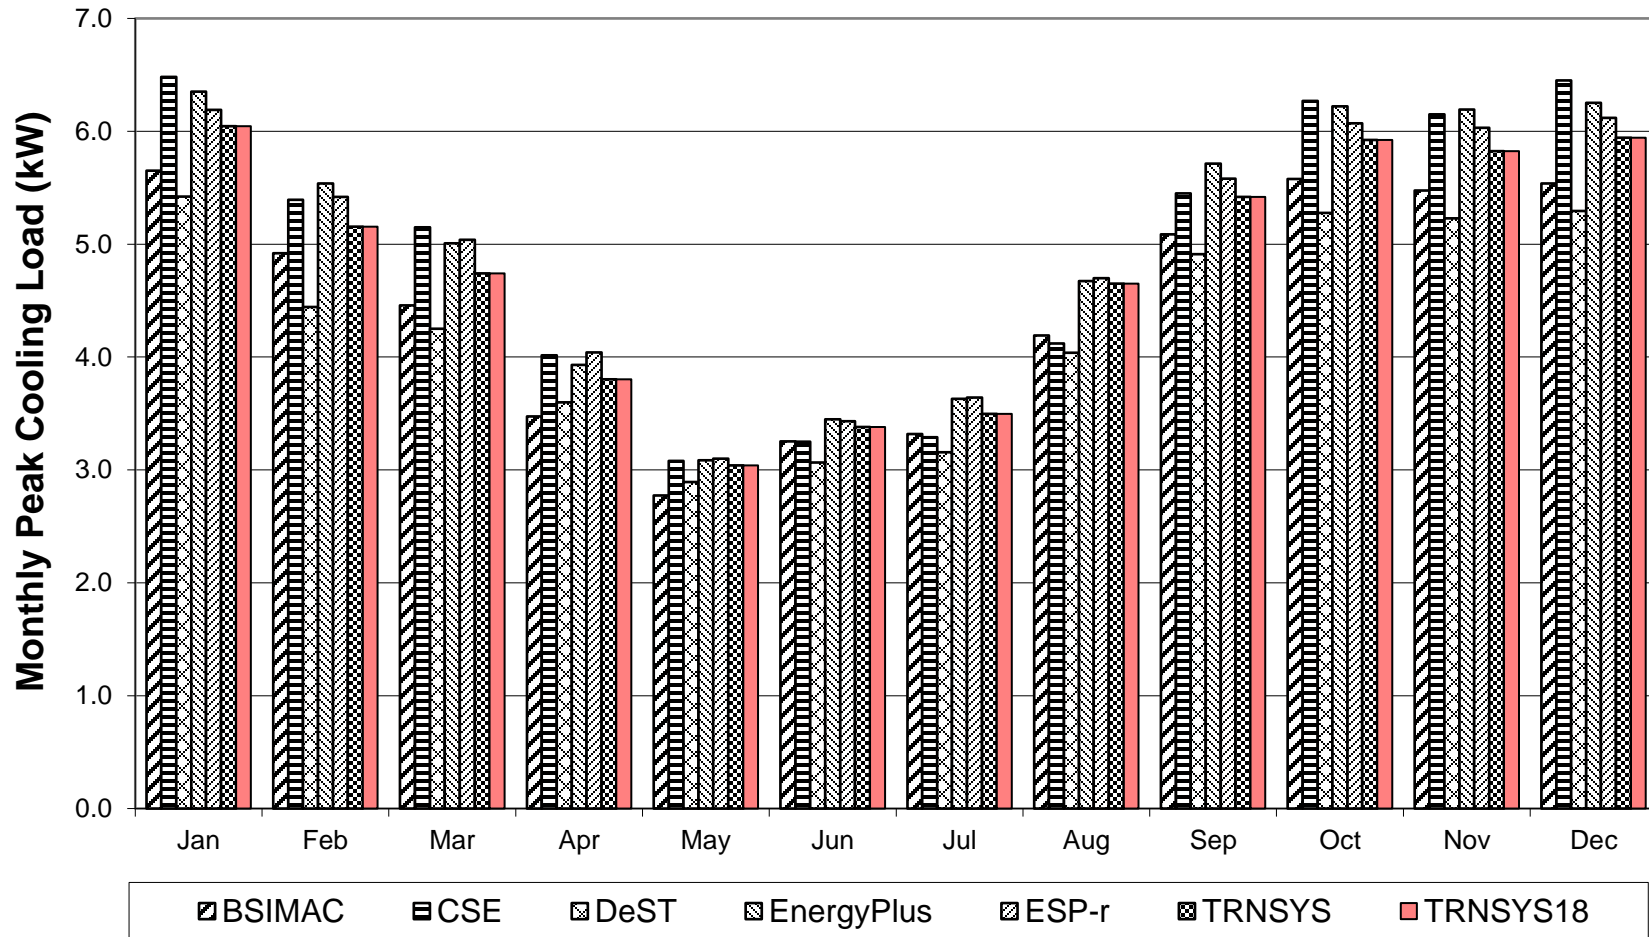

**Figure B8-M5.
Monthly Heating
Case 900**

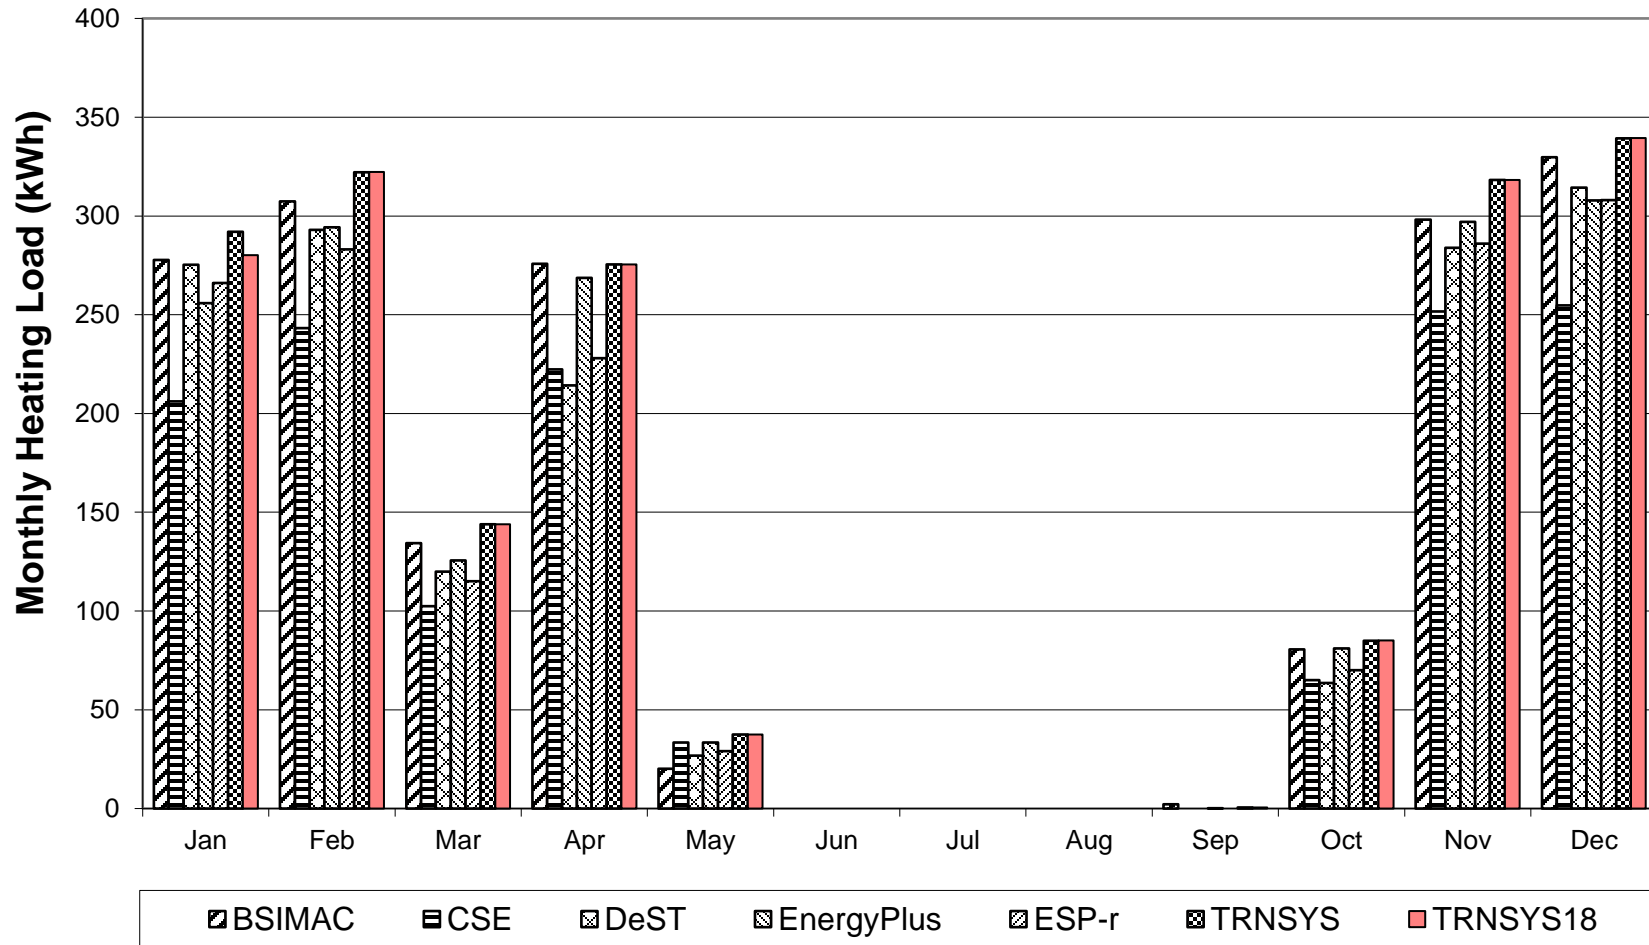

ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF (TRNSYS18) vs. Annex B8, Section B8.1 Example Results, by Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

Figure B8-M6.
Monthly Sensible Cooling
Case 900


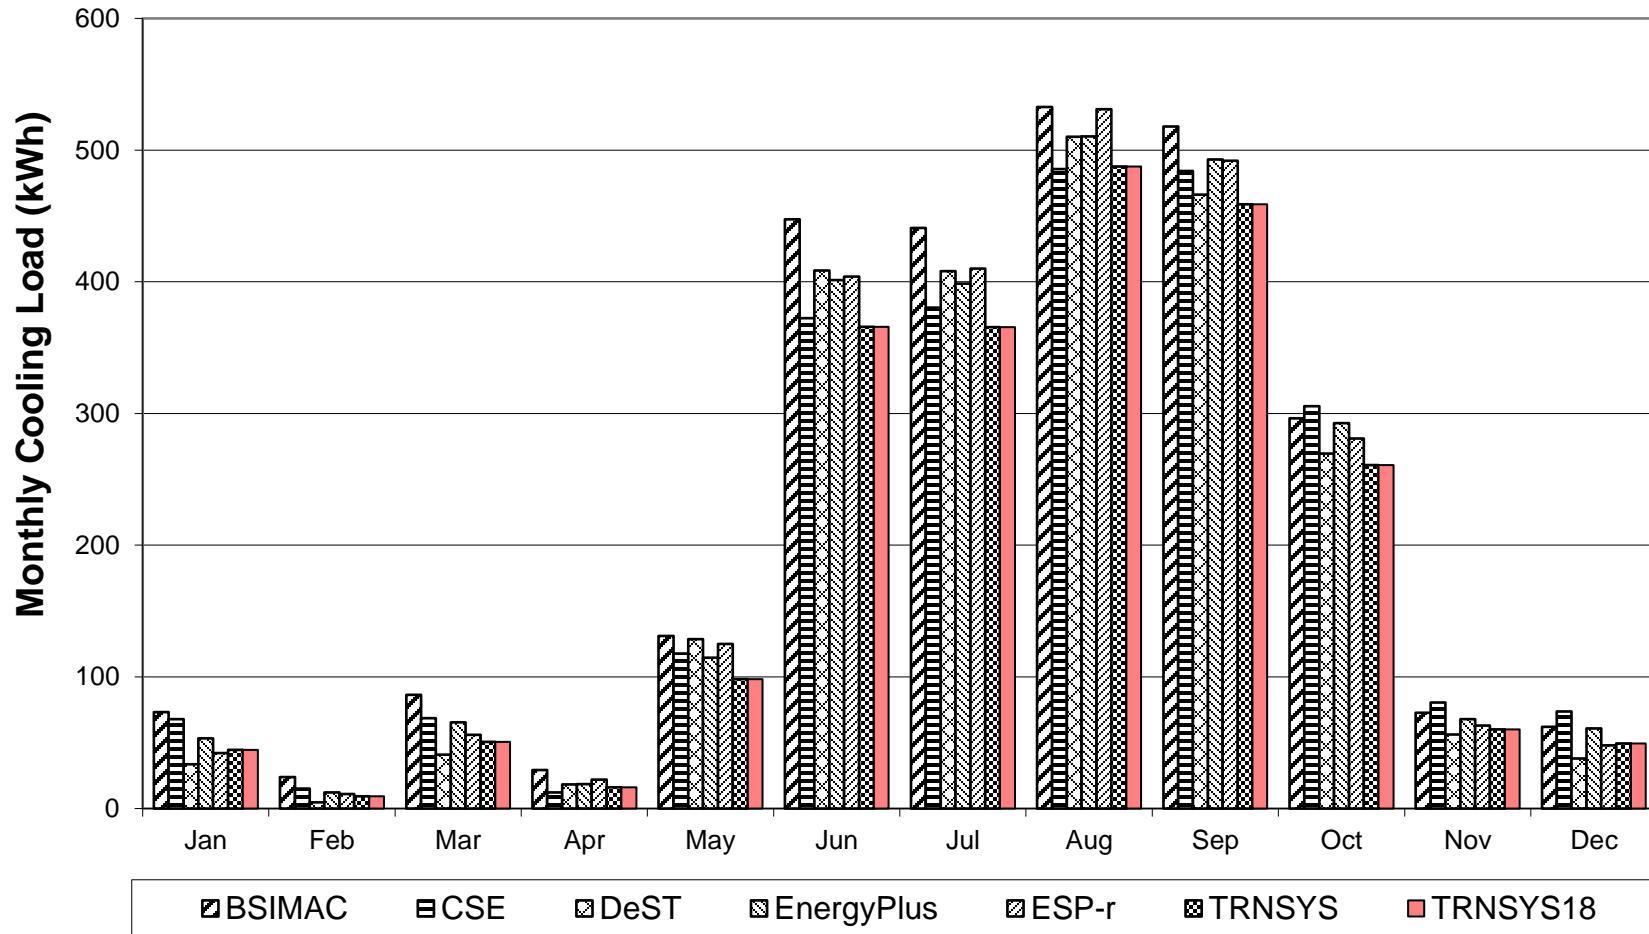


Figure B8-M7.
Monthly Peak Heating
Case 900

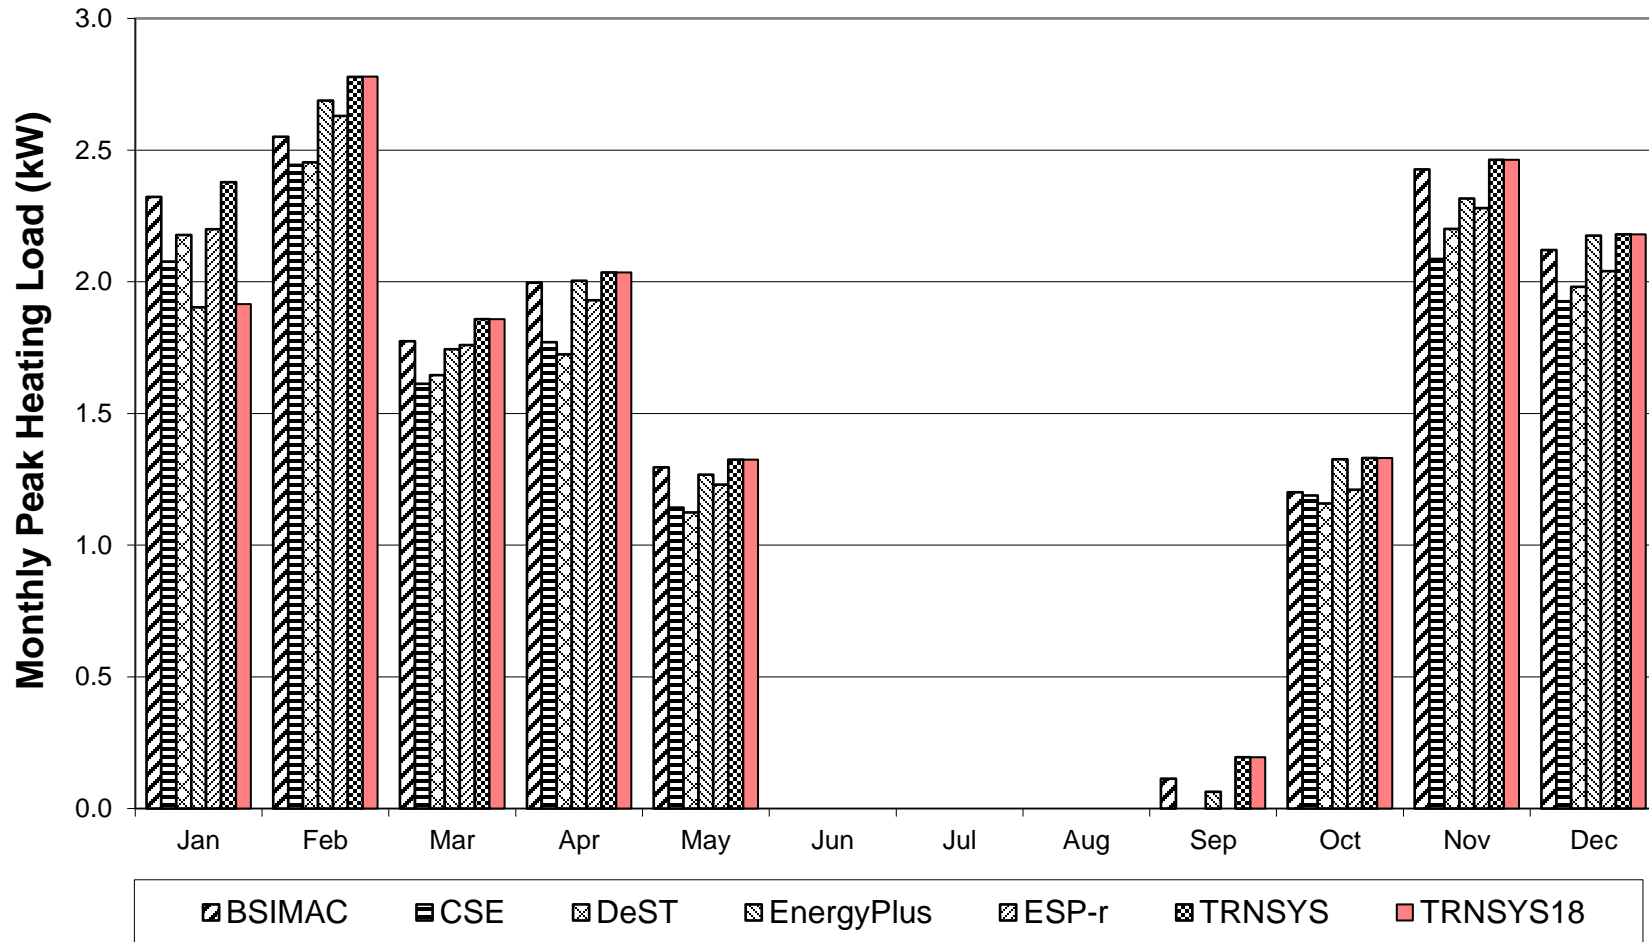

ASHRAE Standard 140-2023, Test Results Comparison for Section 7 - Building Thermal Envelope and Fabric Load Cases 195-995 & 600FF-980FF (TRNSYS18) vs. Annex B8, Section B8.1 Example Results, by Thermal Energy System Specialists, LLC (TESS), 19-Aug-2024

Figure B8-M8.
Monthly Peak Sensible Cooling
Case 900

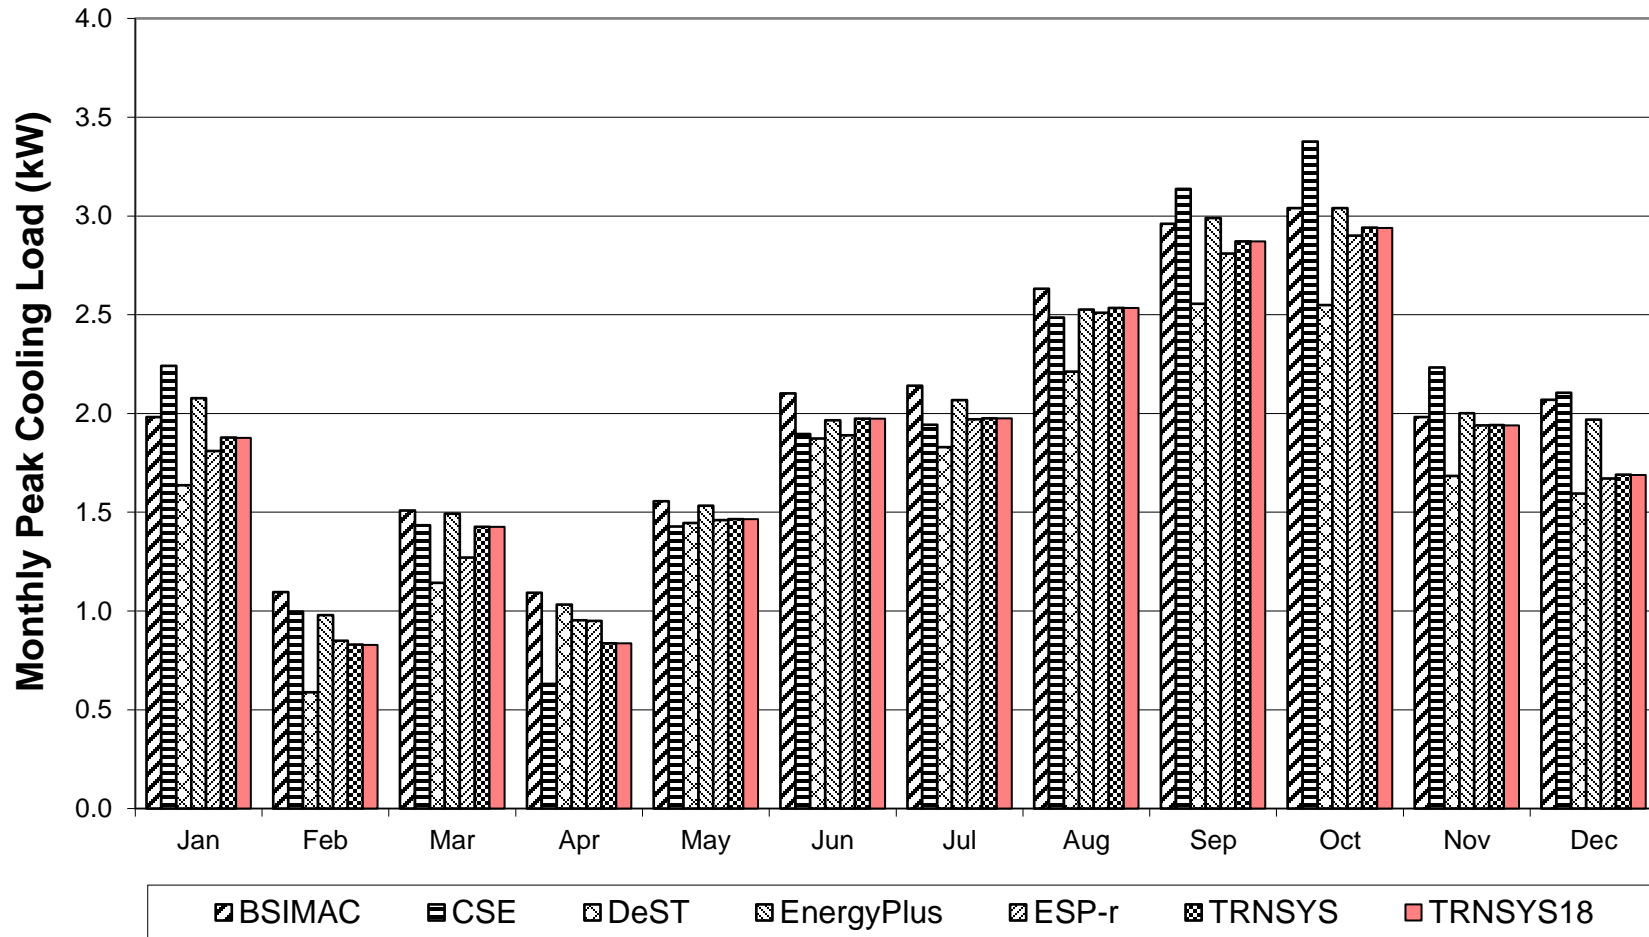


Figure B8-M9.
Monthly Heating Sensitivity (Delta)
Case 600-900

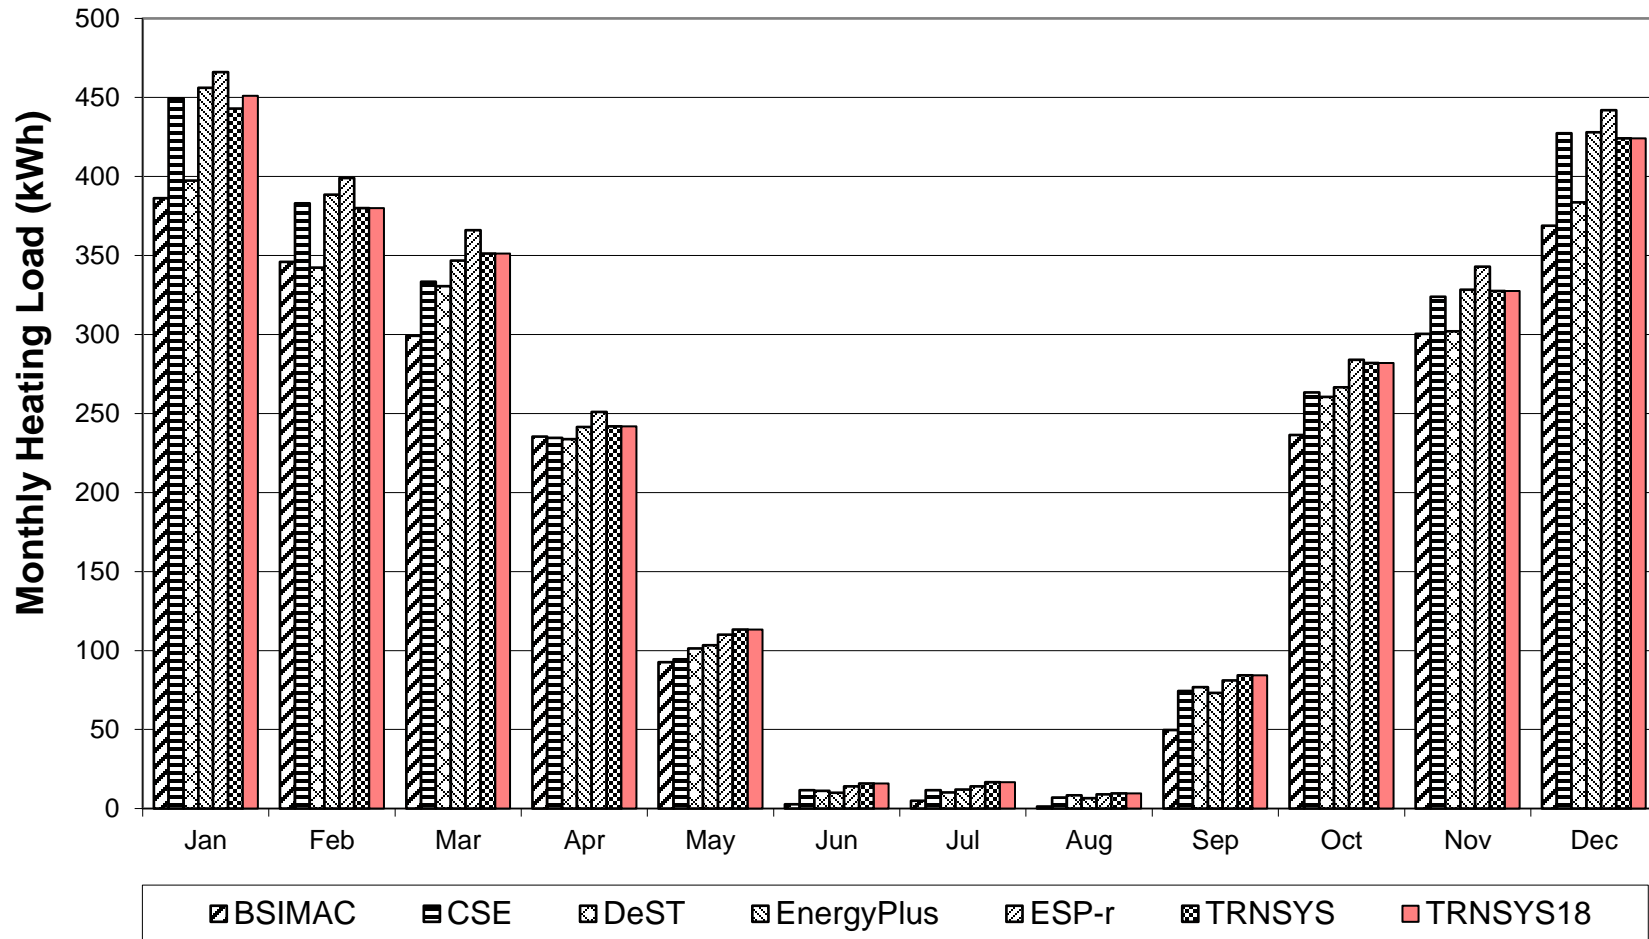


Figure B8-M10.
Monthly Cooling Sensitivity (Delta)
Case 600-900

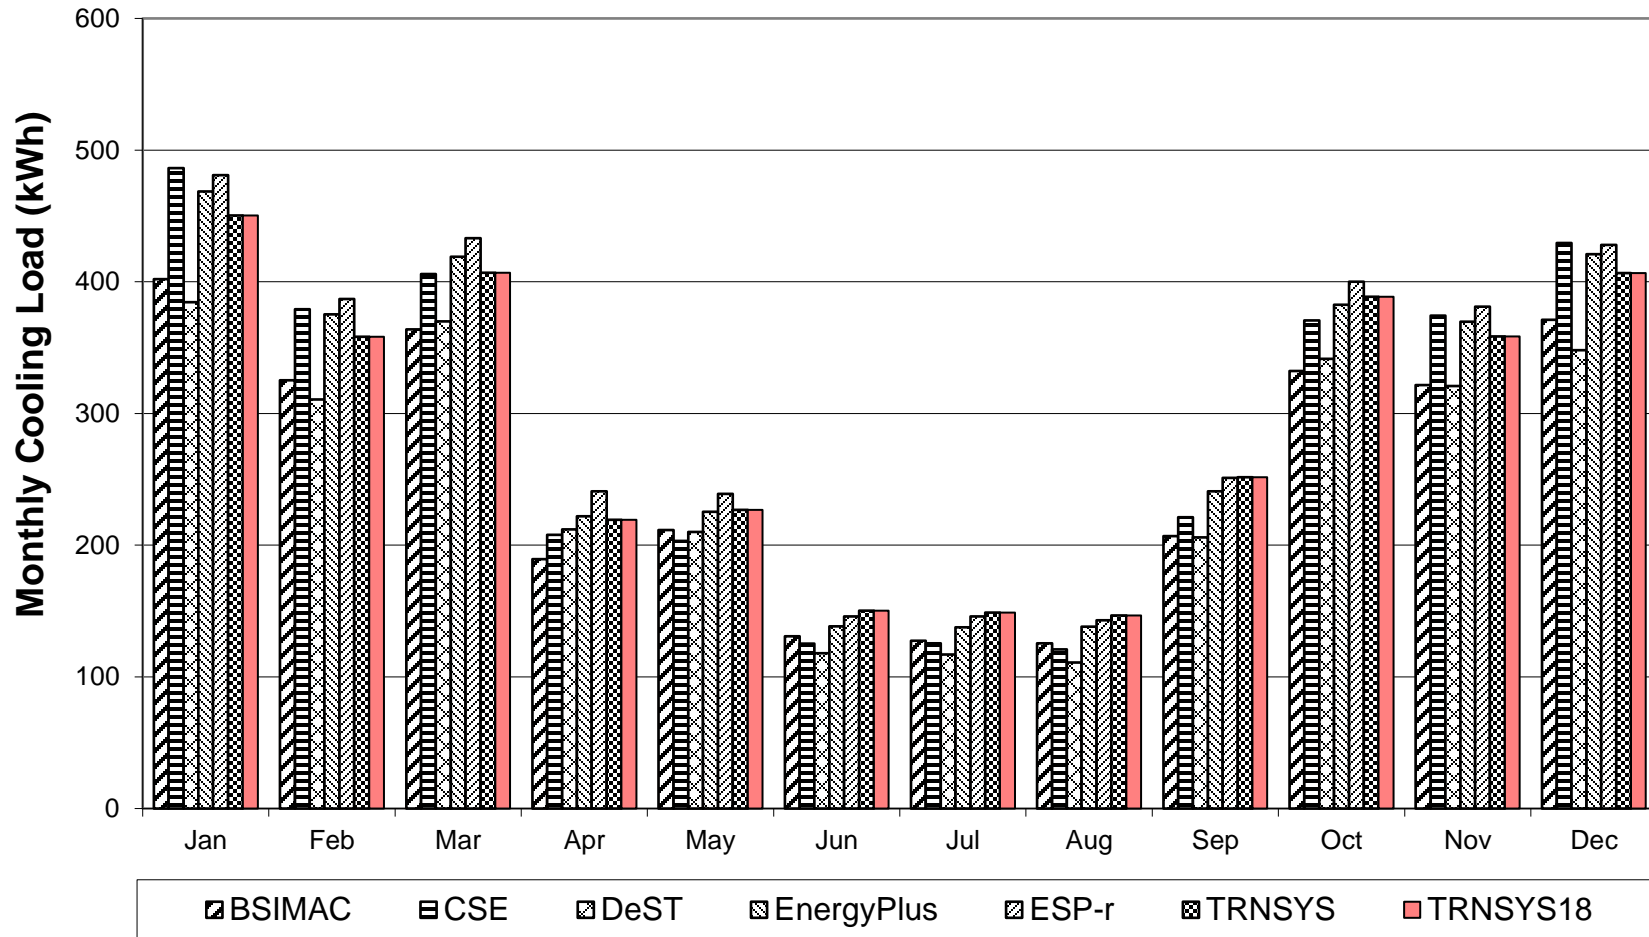


Figure B8-M11.
Monthly Peak Heating Sensitivity (Delta)
Case 600-900

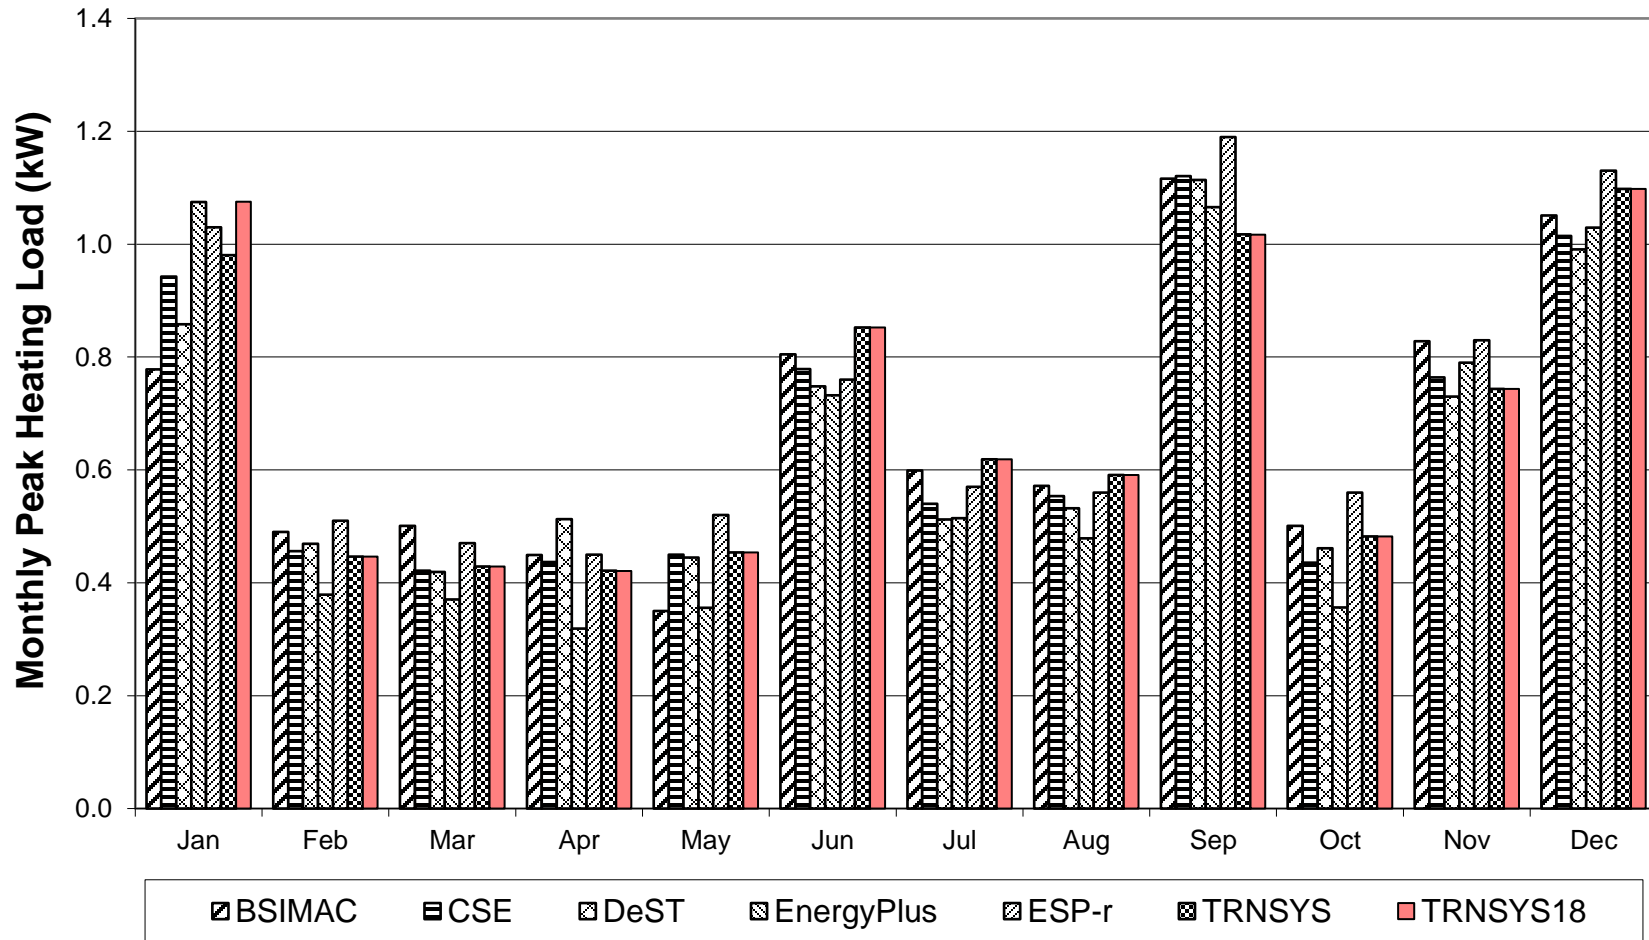


Figure B8-M12.
Monthly Peak Cooling Sensitivity (Delta)
Case 600-900

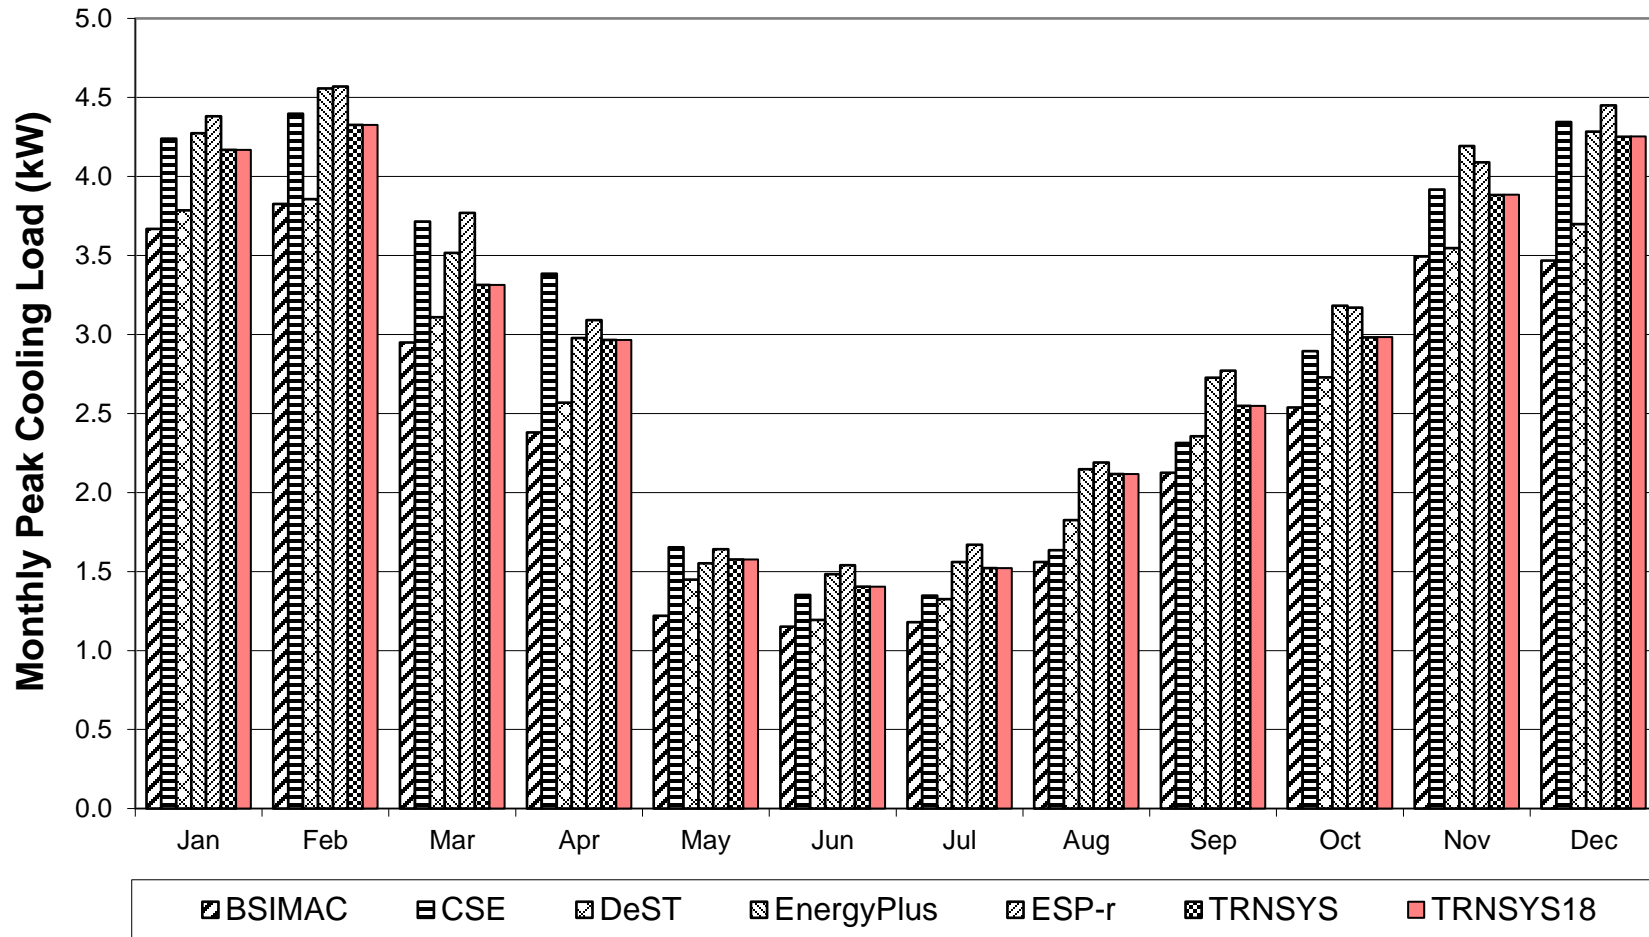


Figure B8-H1. Case 900FF Annual Hourly Zone Air Temperature Frequency

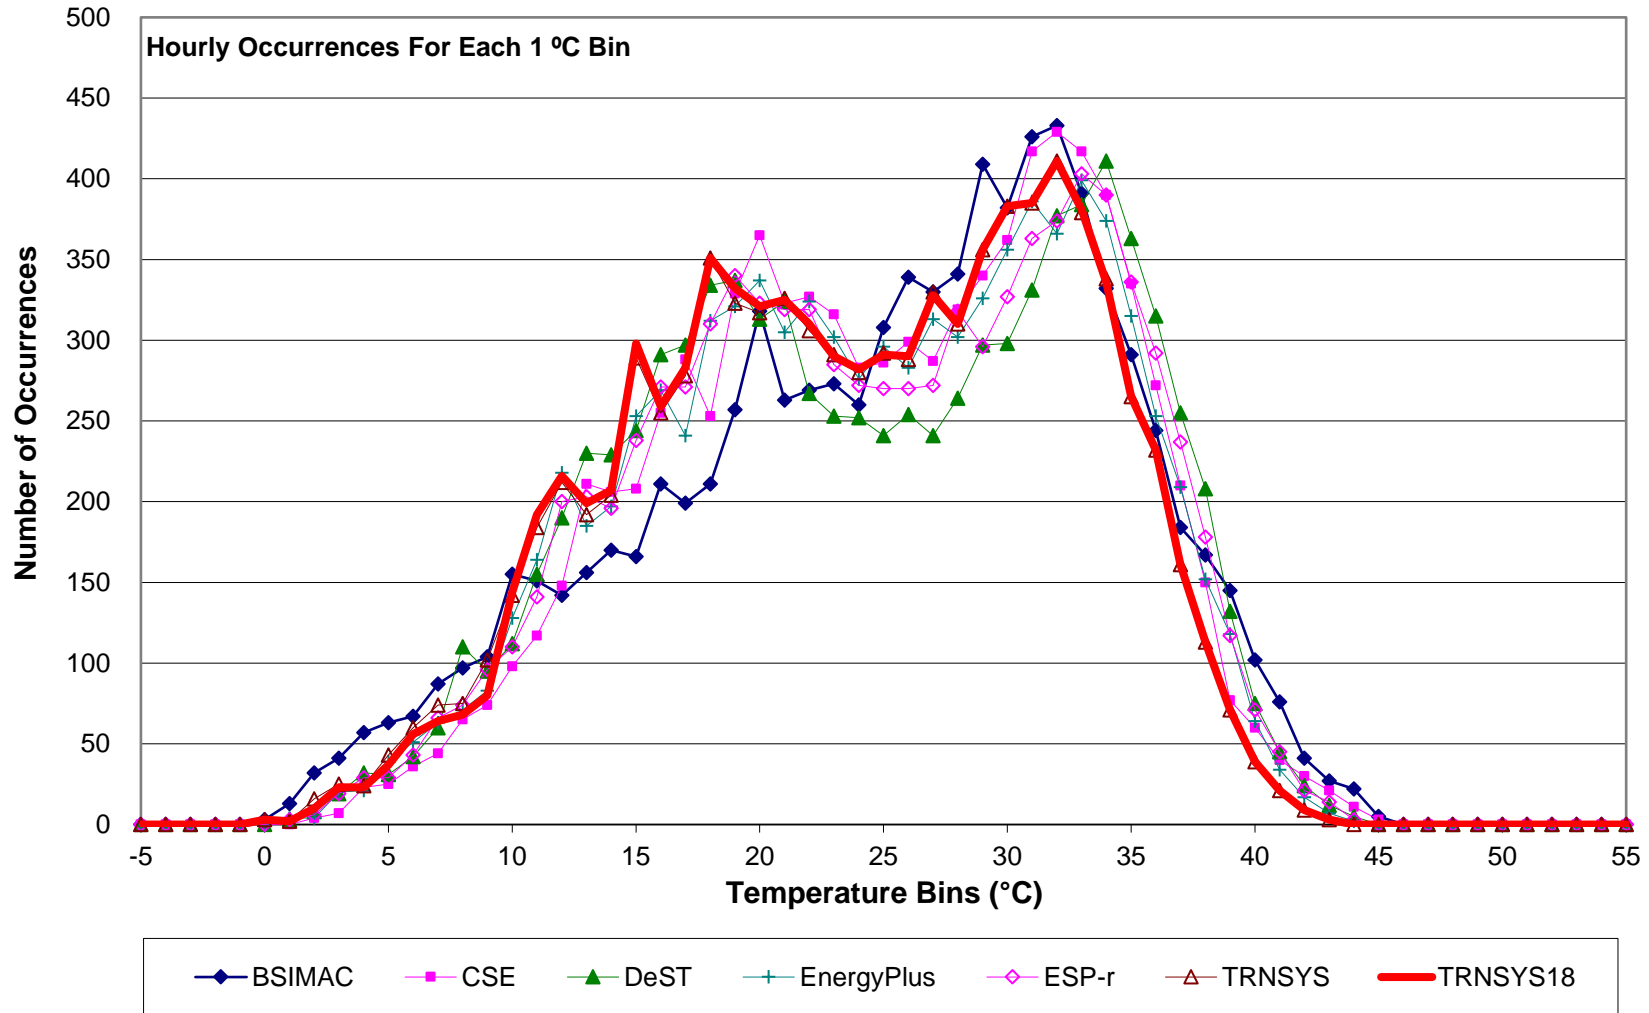


Figure B8-H2. Case 600
Cloudy & Clear Day Hourly Incident Solar
Horizontal (Upward) Facing Surface

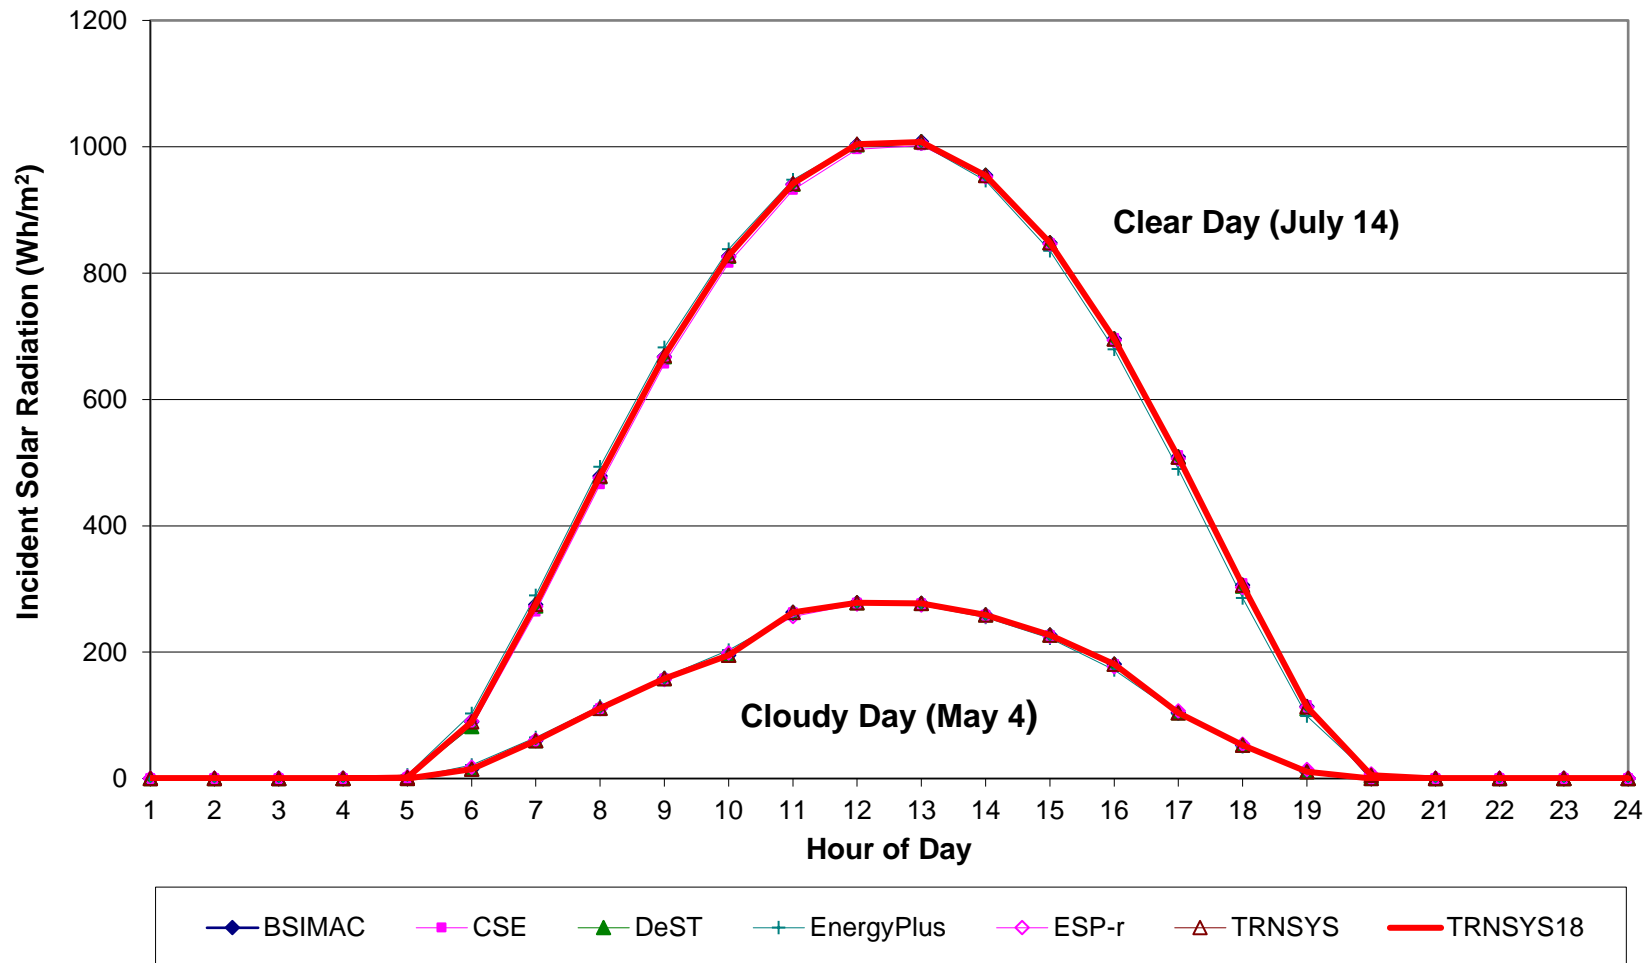


Figure B8-H3. Case 600
Cloudy & Clear Day Hourly Incident Solar
South Facing Surface

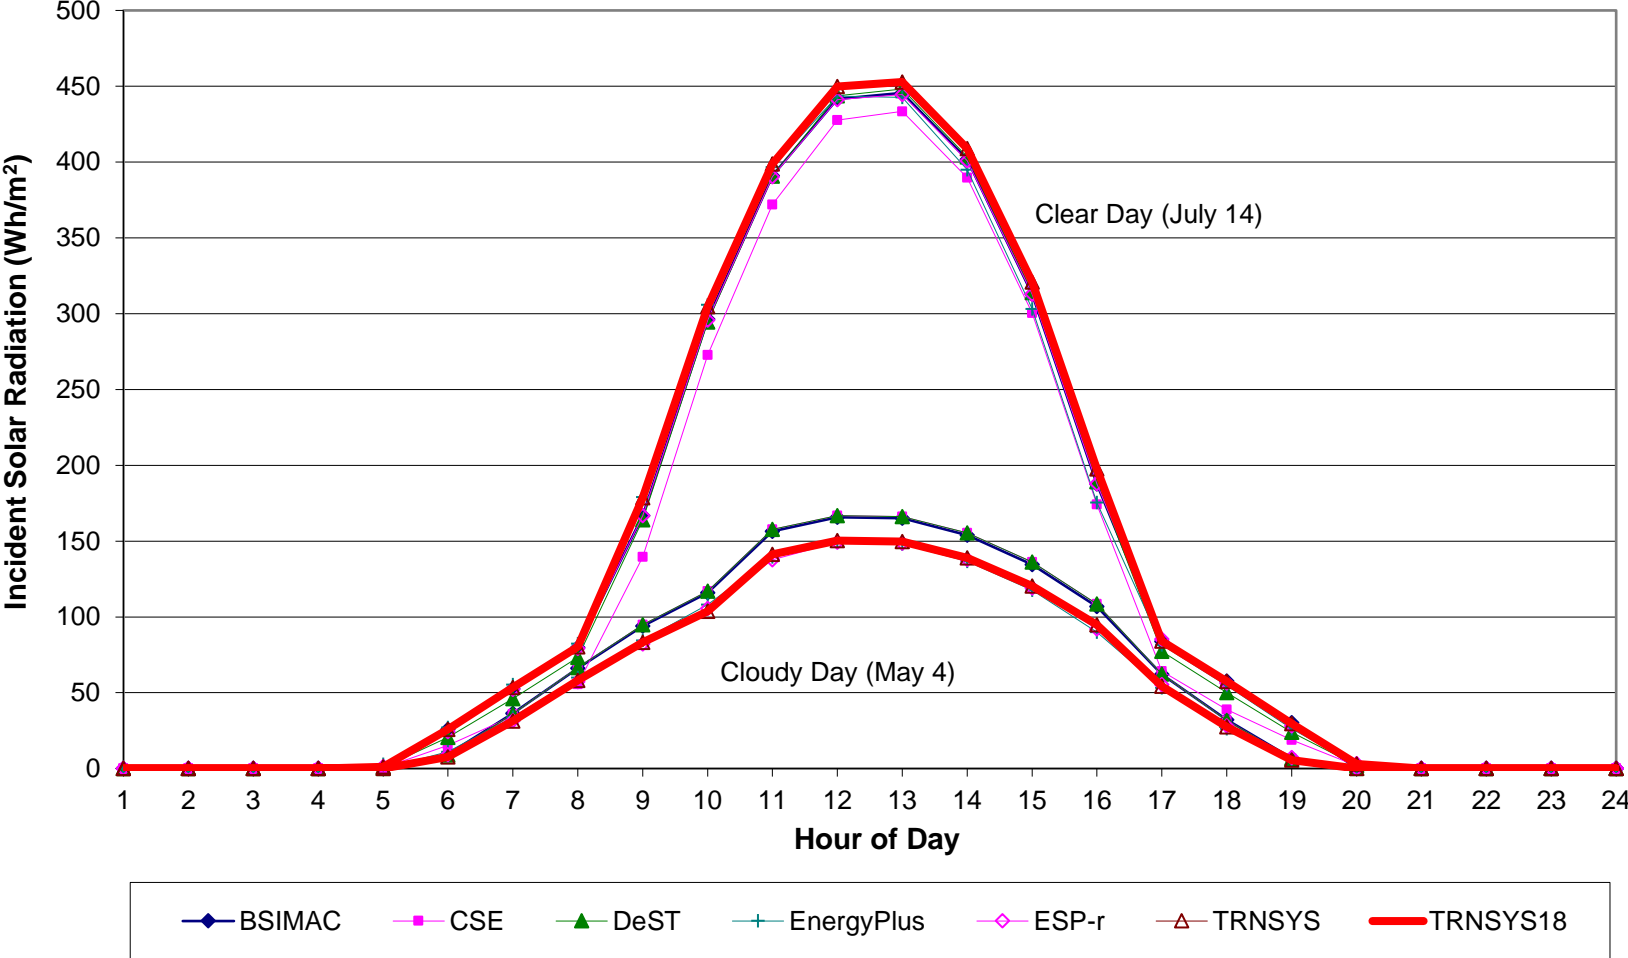


Figure B8-H4. Case 600
Cloudy & Clear Day Hourly Incident Solar
West Facing Surface

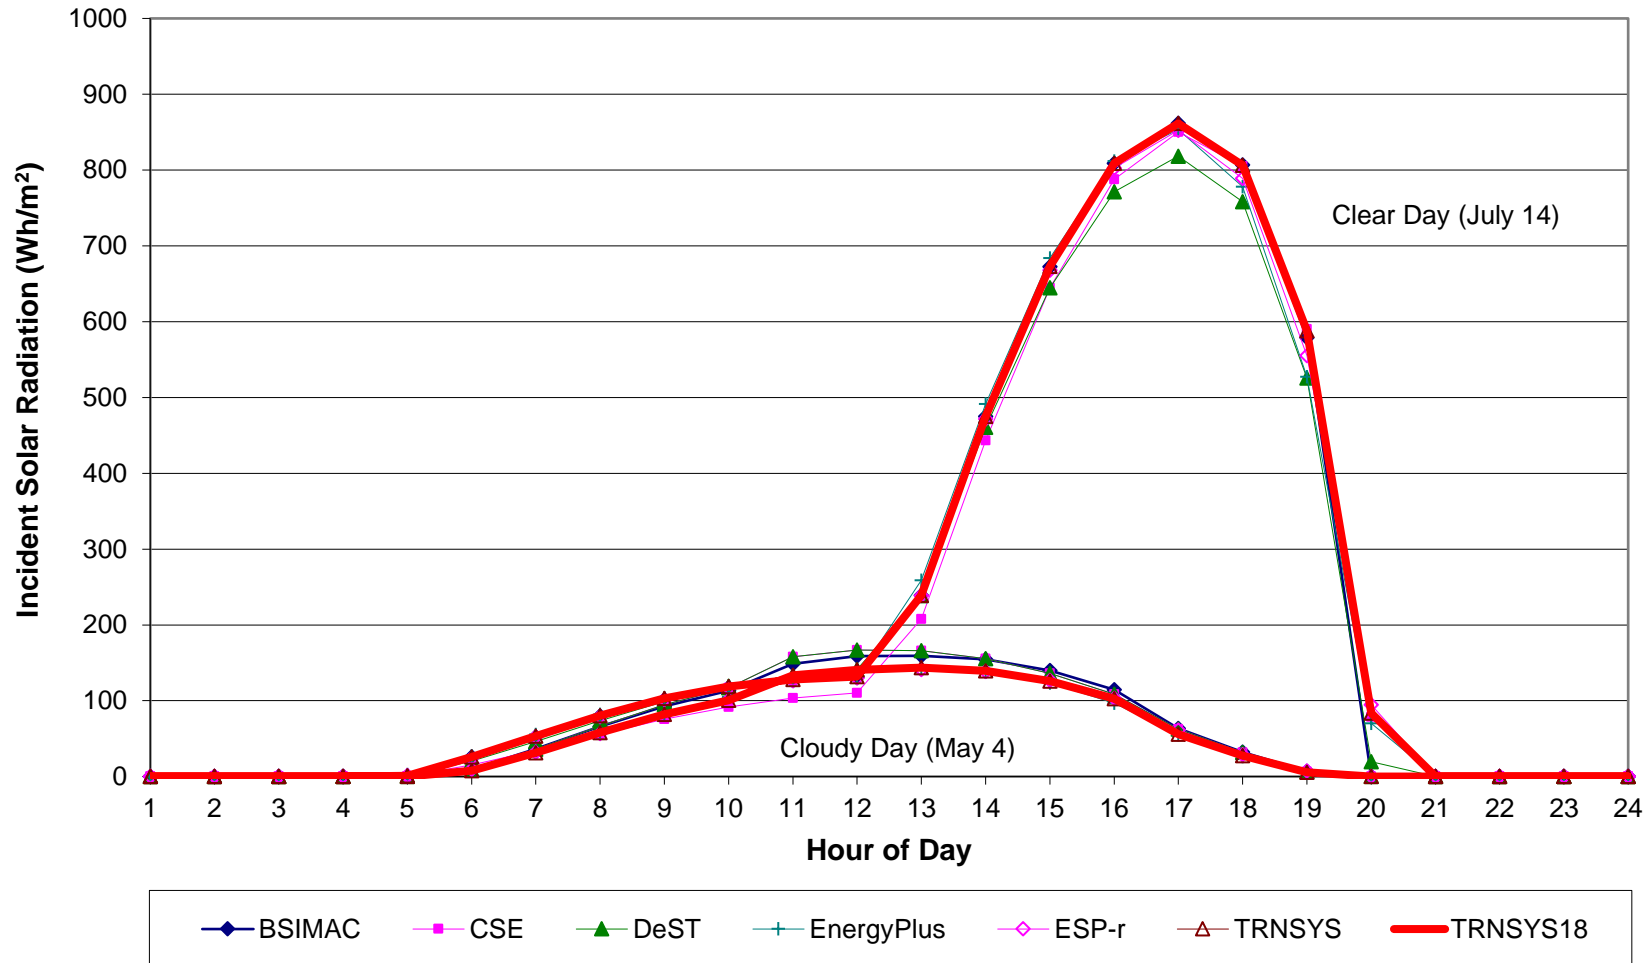


Figure B8-H5. Cases 600, 660, 670
Hourly Transmitted Solar, Clear/Cold Day (Feb 1)
Double-Pane, Low-E, Single-Pane Windows

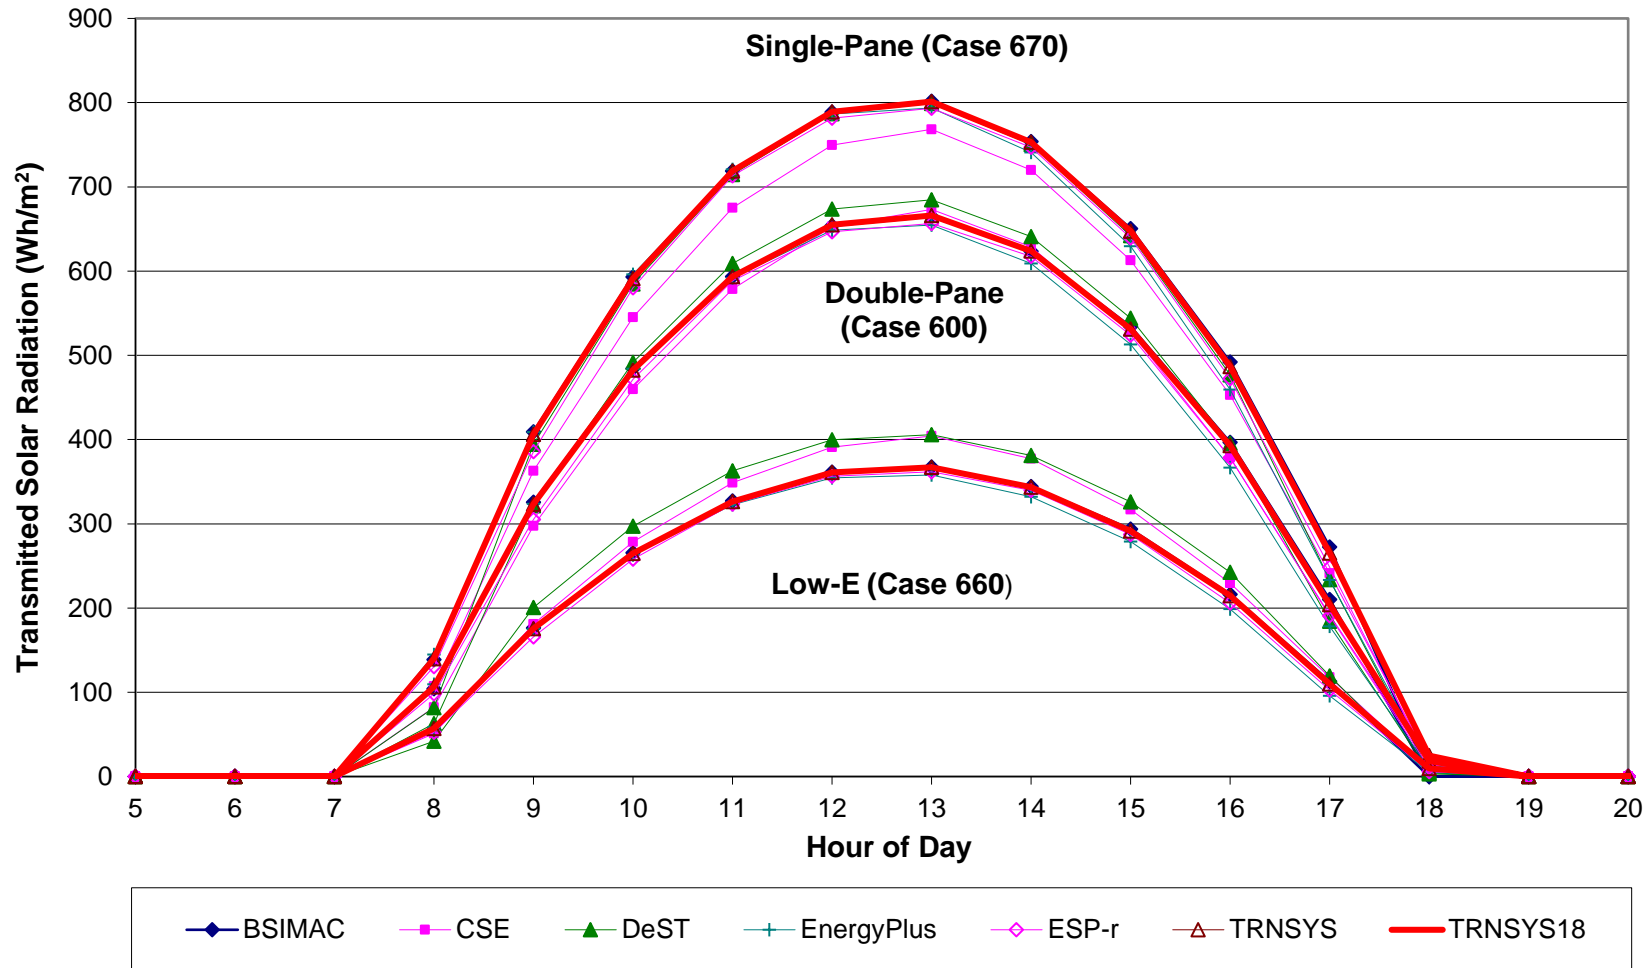


Figure B8-H6. Case 600
Hourly Transmitted Solar, Cloudy Day (May 4)
Double-Pane Windows

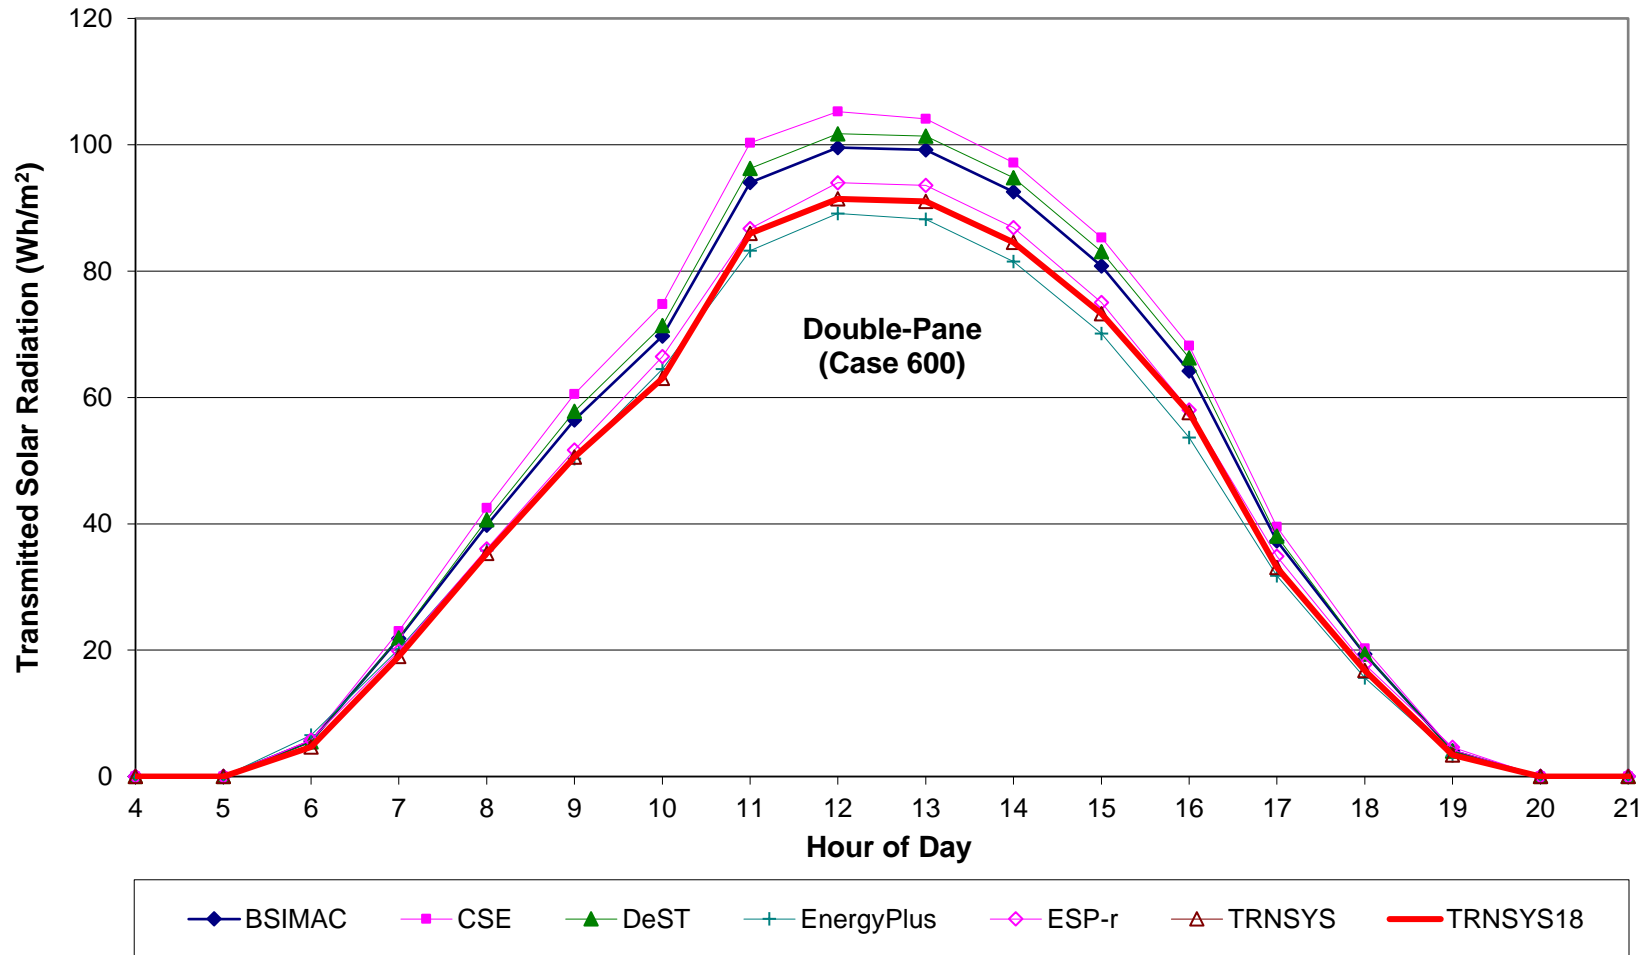


Figure B8-H8. Case 600
Hourly Transmitted Solar, Clear/Hot Day (Jul 14)
Double-Pane Windows

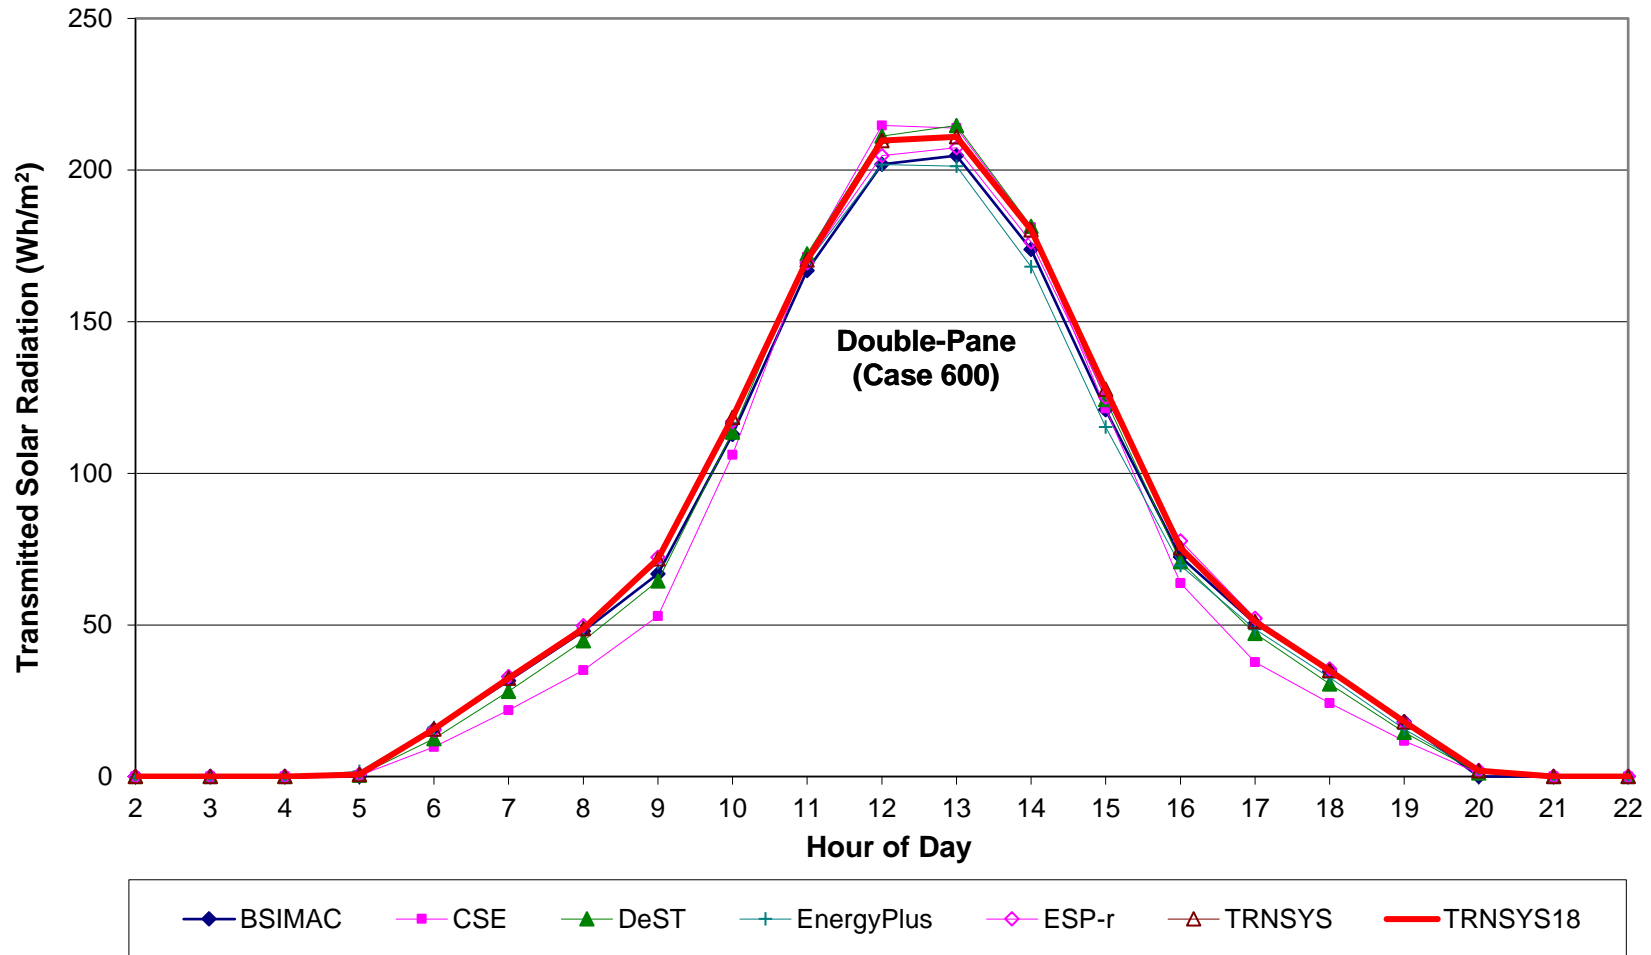


Figure B8-H9. Cases 660, 670
Hourly Transmitted Solar, Clear/Hot Day (Jul 14)
Low-E and Single-Pane Windows

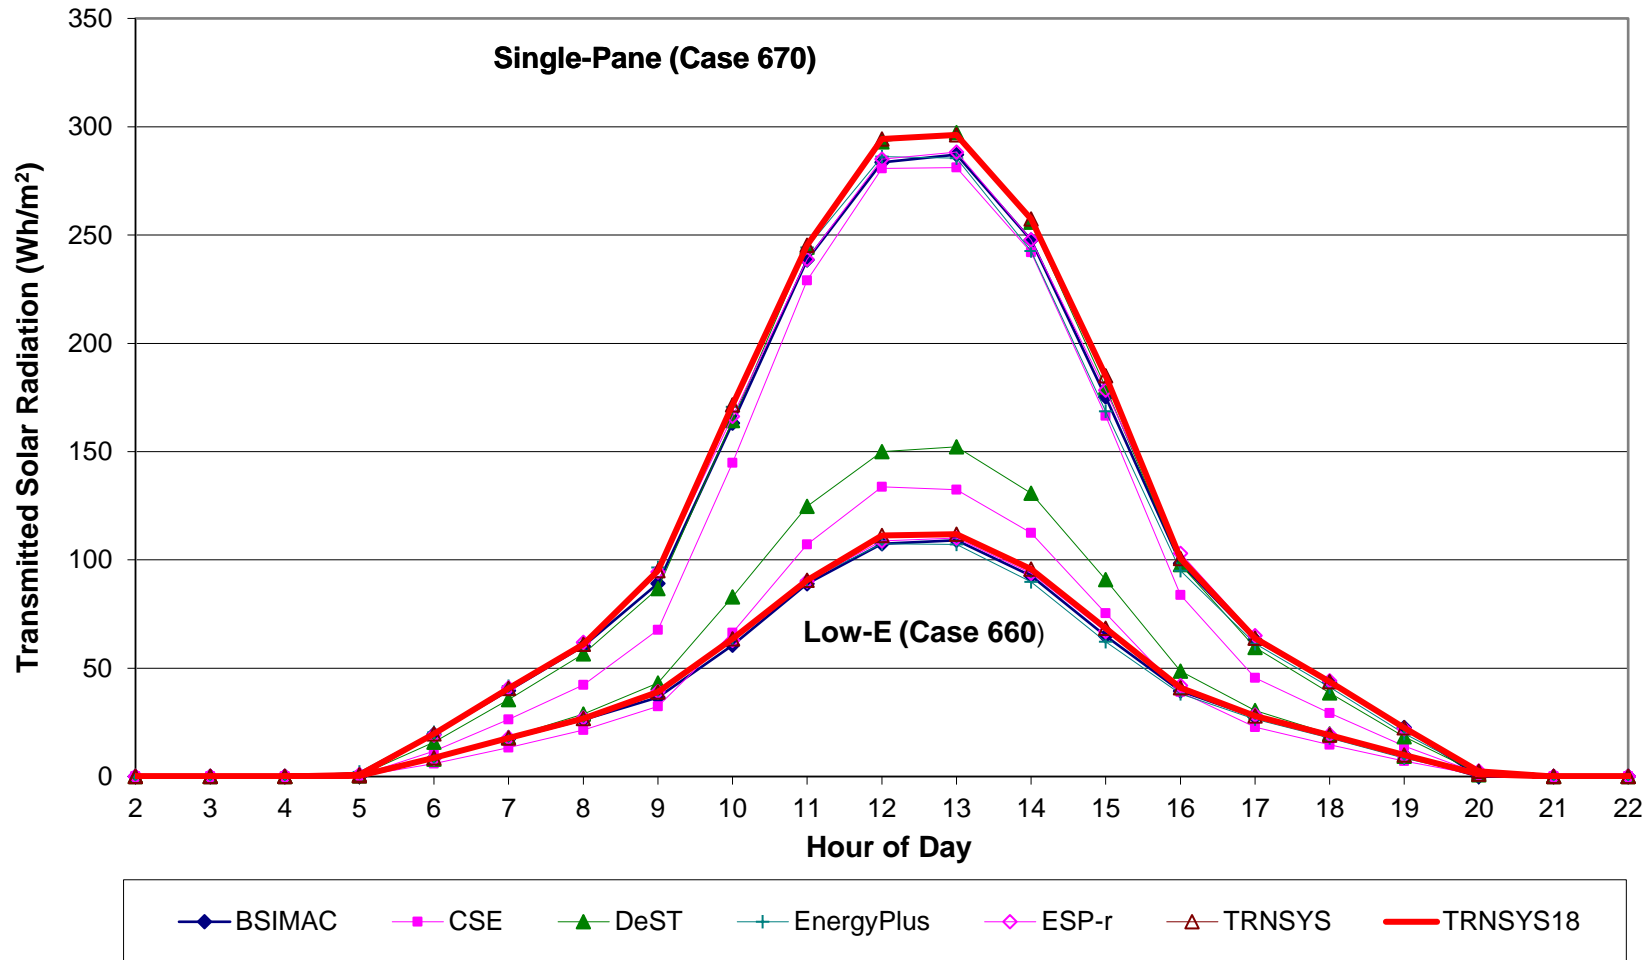


Figure B8-H10.
Hourly Sky Temperatures
Case 600: Clear/Cold, Cloudy Days

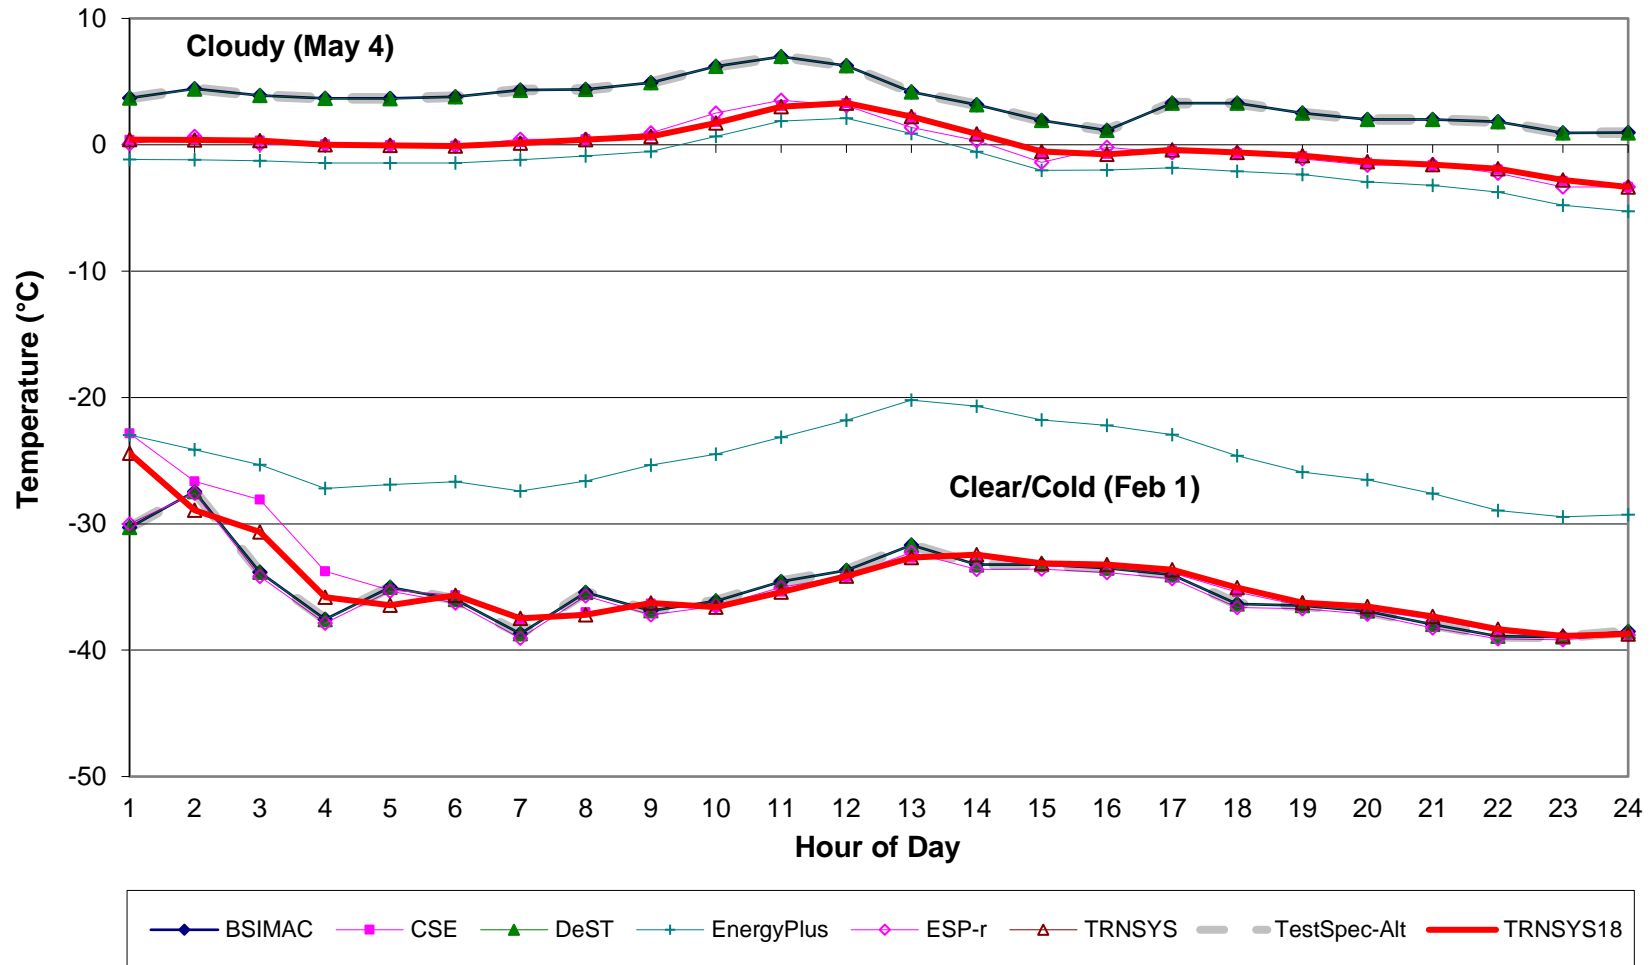


Figure B8-H12.
Hourly Free-Float Temperatures
Clear Cold Day (Feb 1), Cases 600FF and 900FF

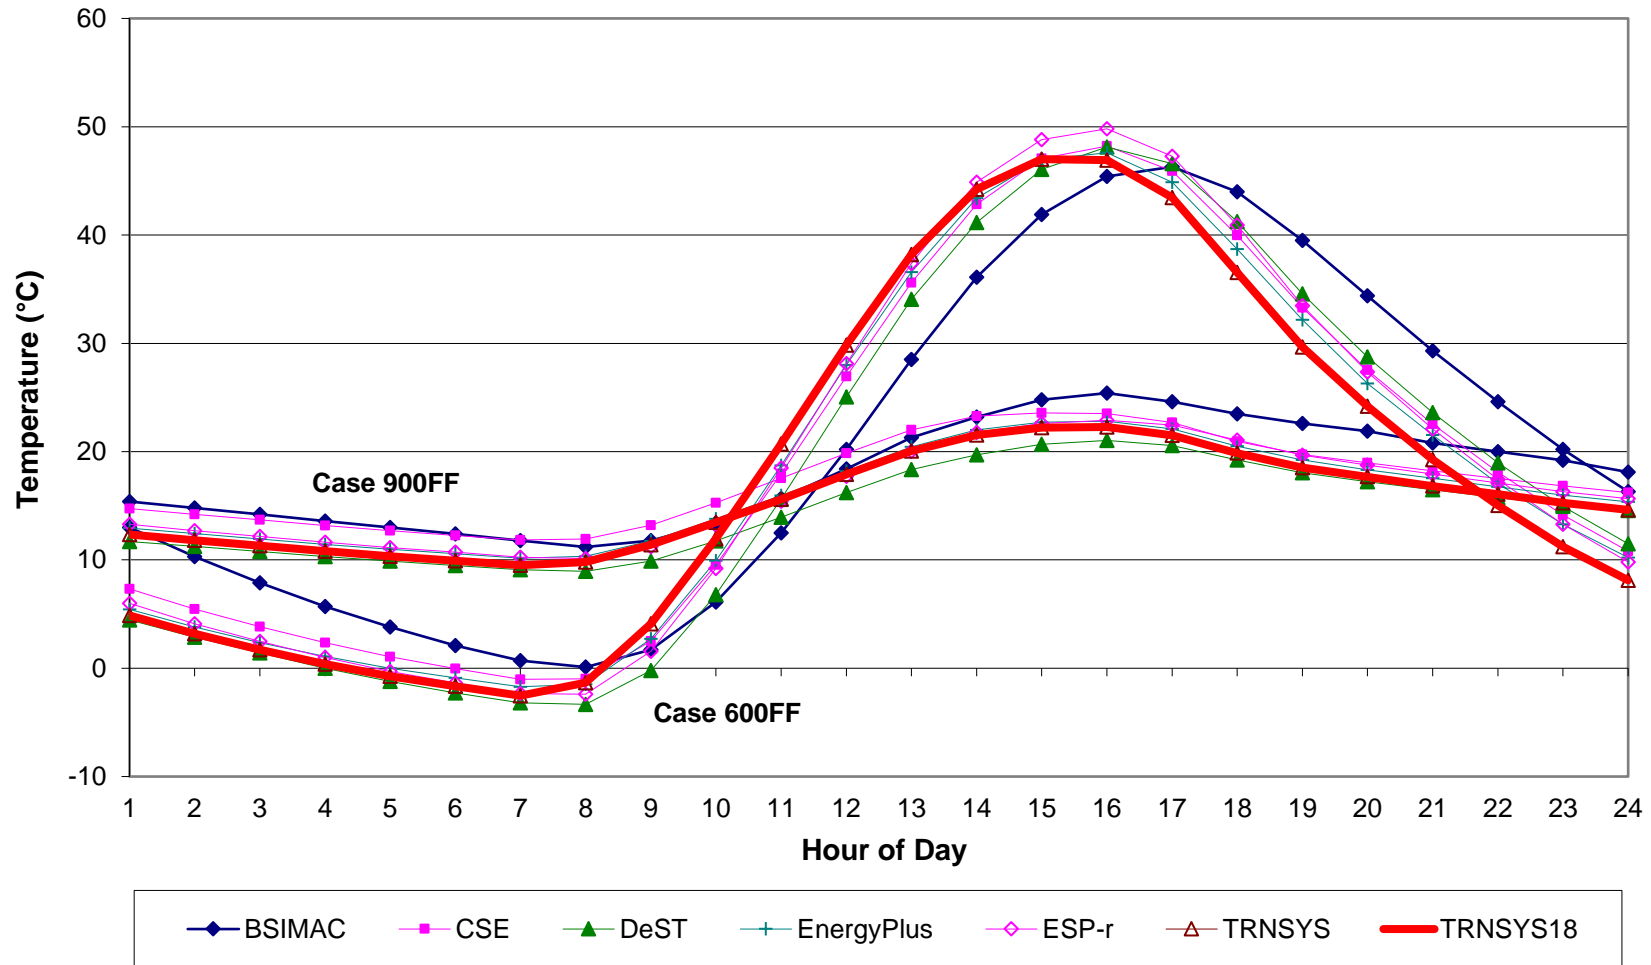


Figure B8-H13.
Hourly Free-Float Temperatures
Clear Hot Day (Jul 14), Cases 650FF and 950FF

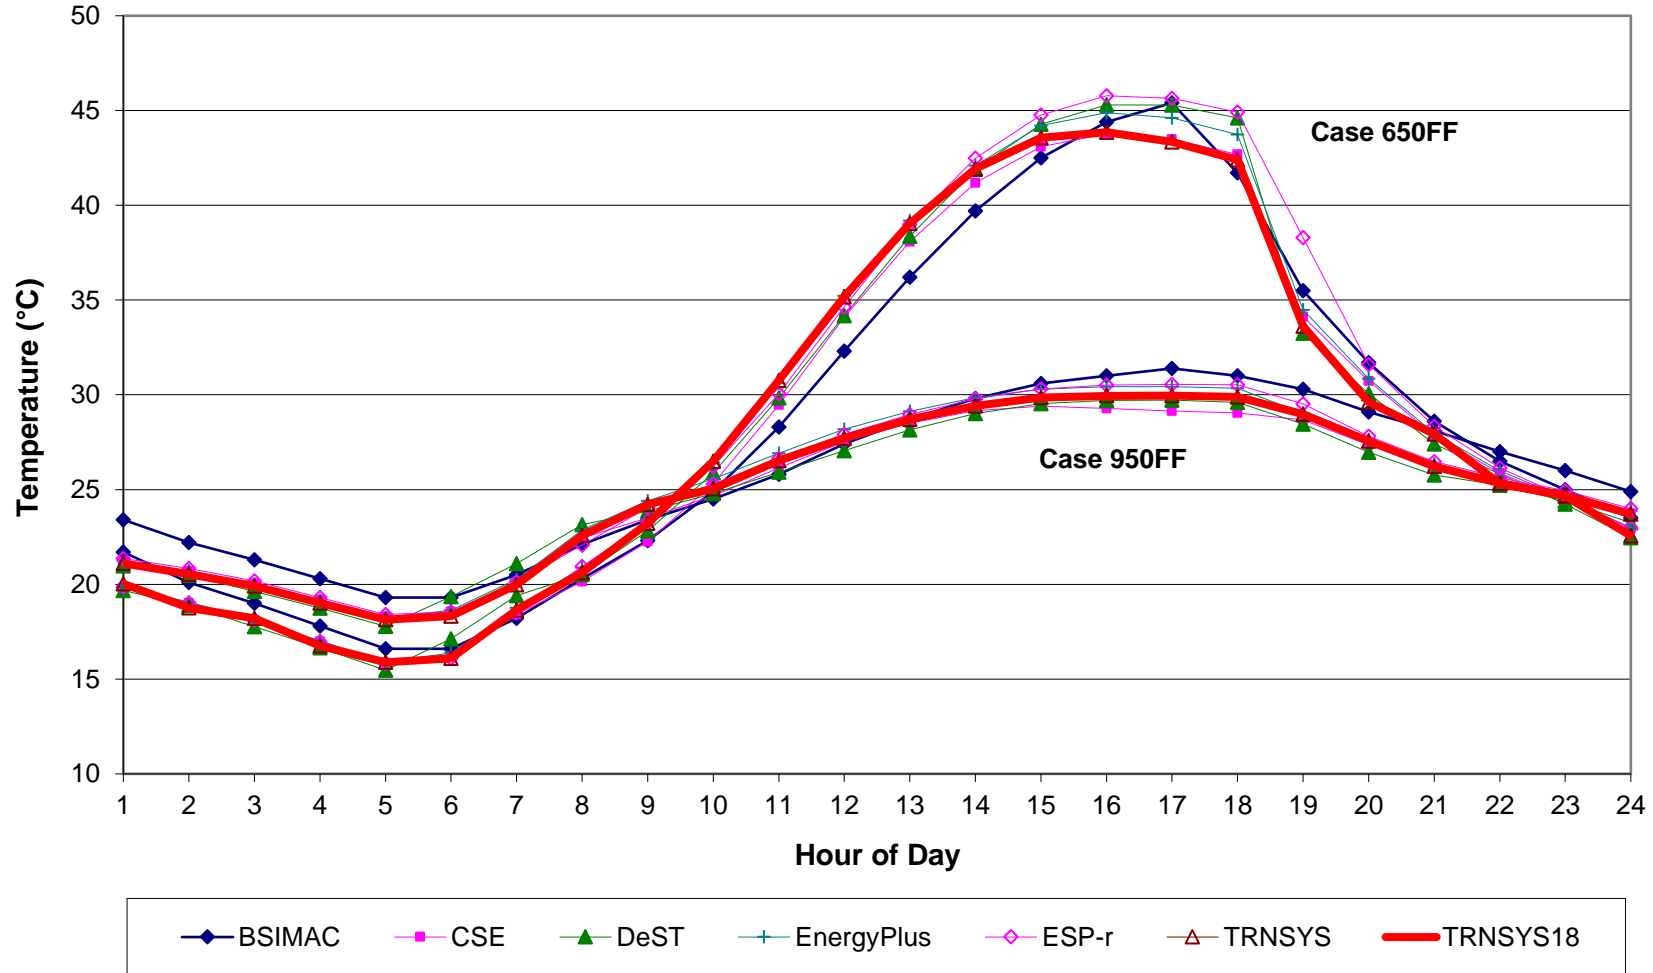


Figure B8-H14.
Hourly Free-Float Temperatures
Clear Cold Day (Feb1), Cases 680FF and 980FF

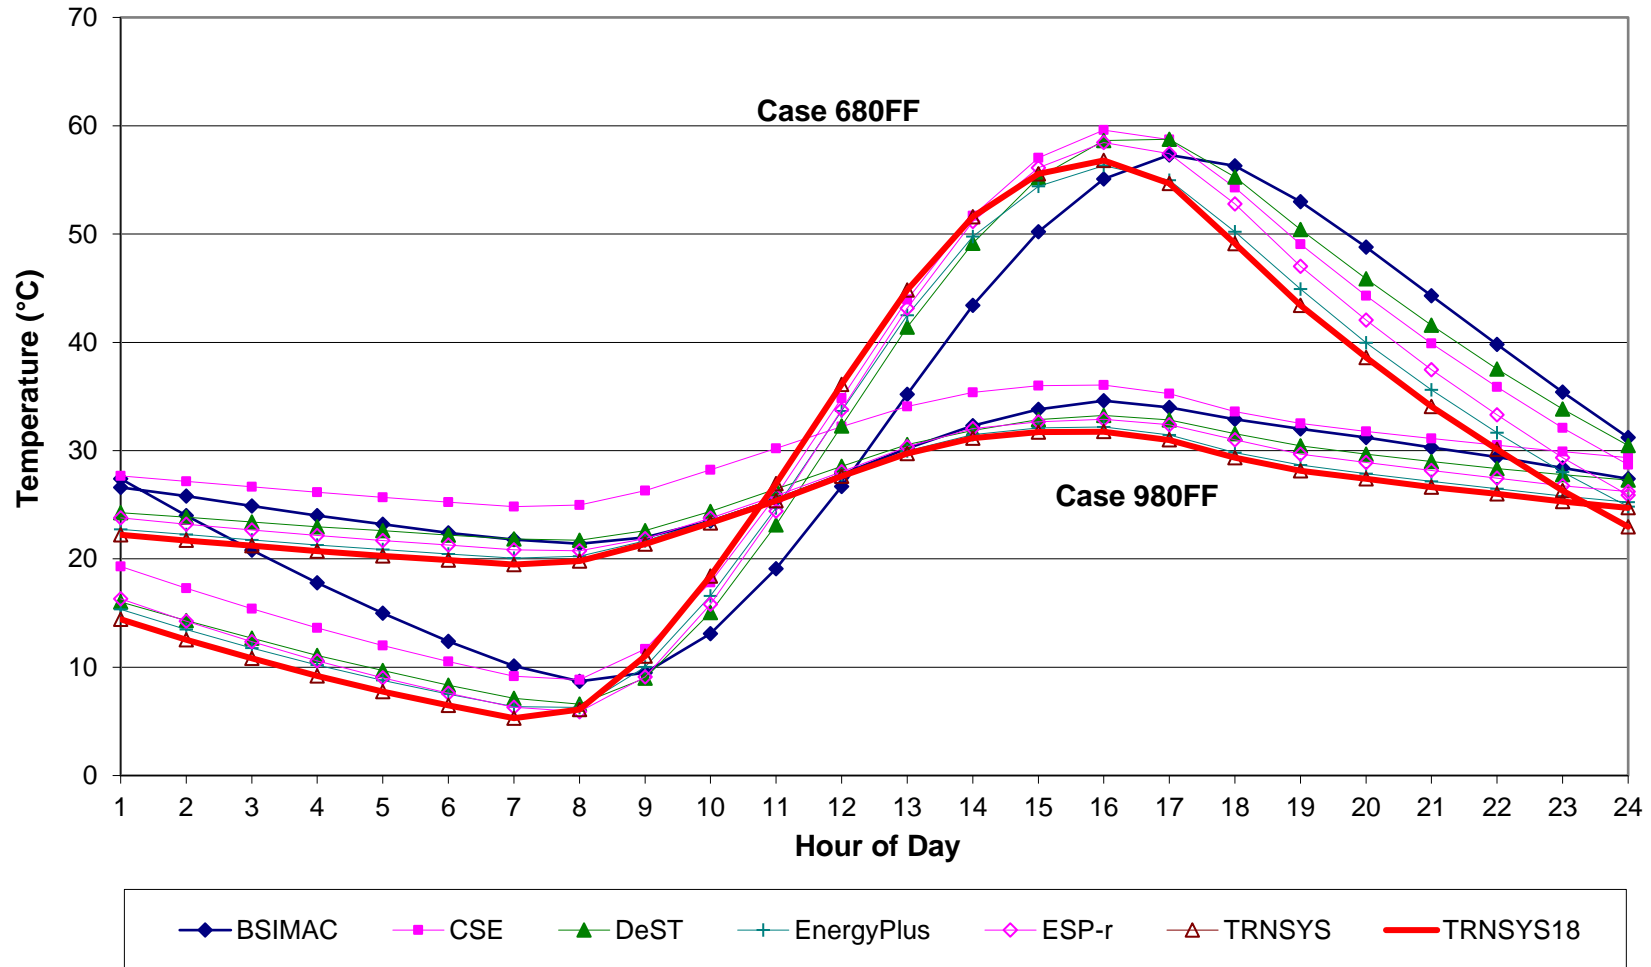


Figure B8-H15. Hourly Loads
Clear Cold Day, Case 600 (Low Mass, Double-Clear Window)
Heating (+), Sensible Cooling (-)

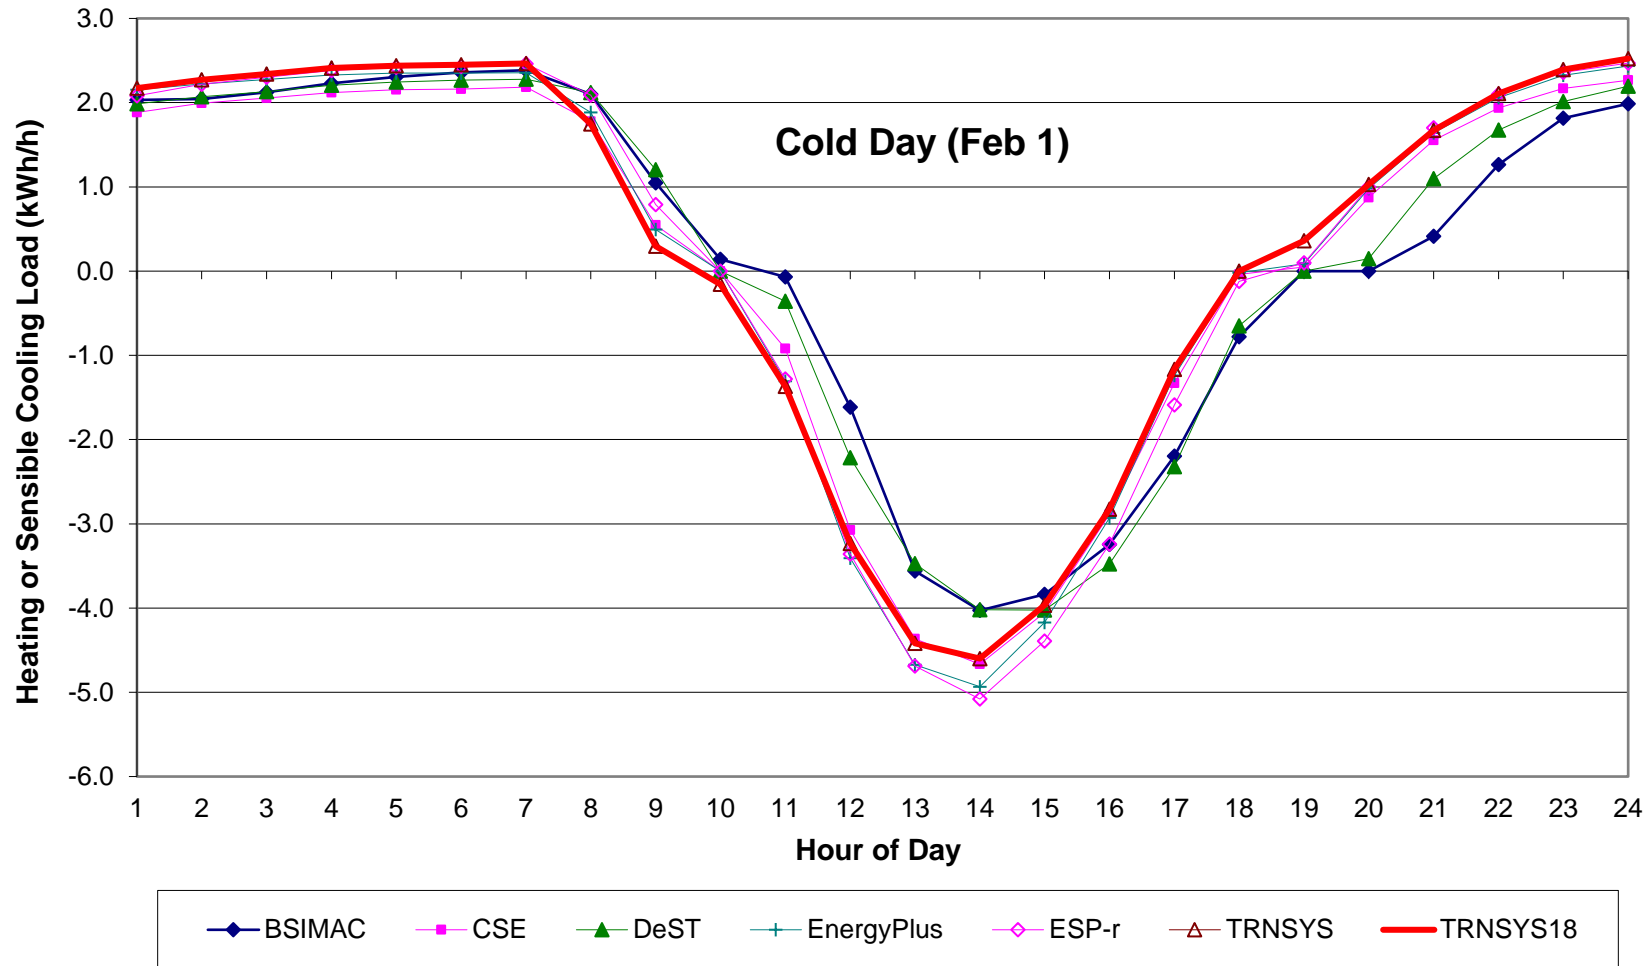


Figure B8-H16. Hourly Loads
Clear Hot Day, Case 600 (Low Mass, Double-Clear Window)
Heating (+), Sensible Cooling (-)

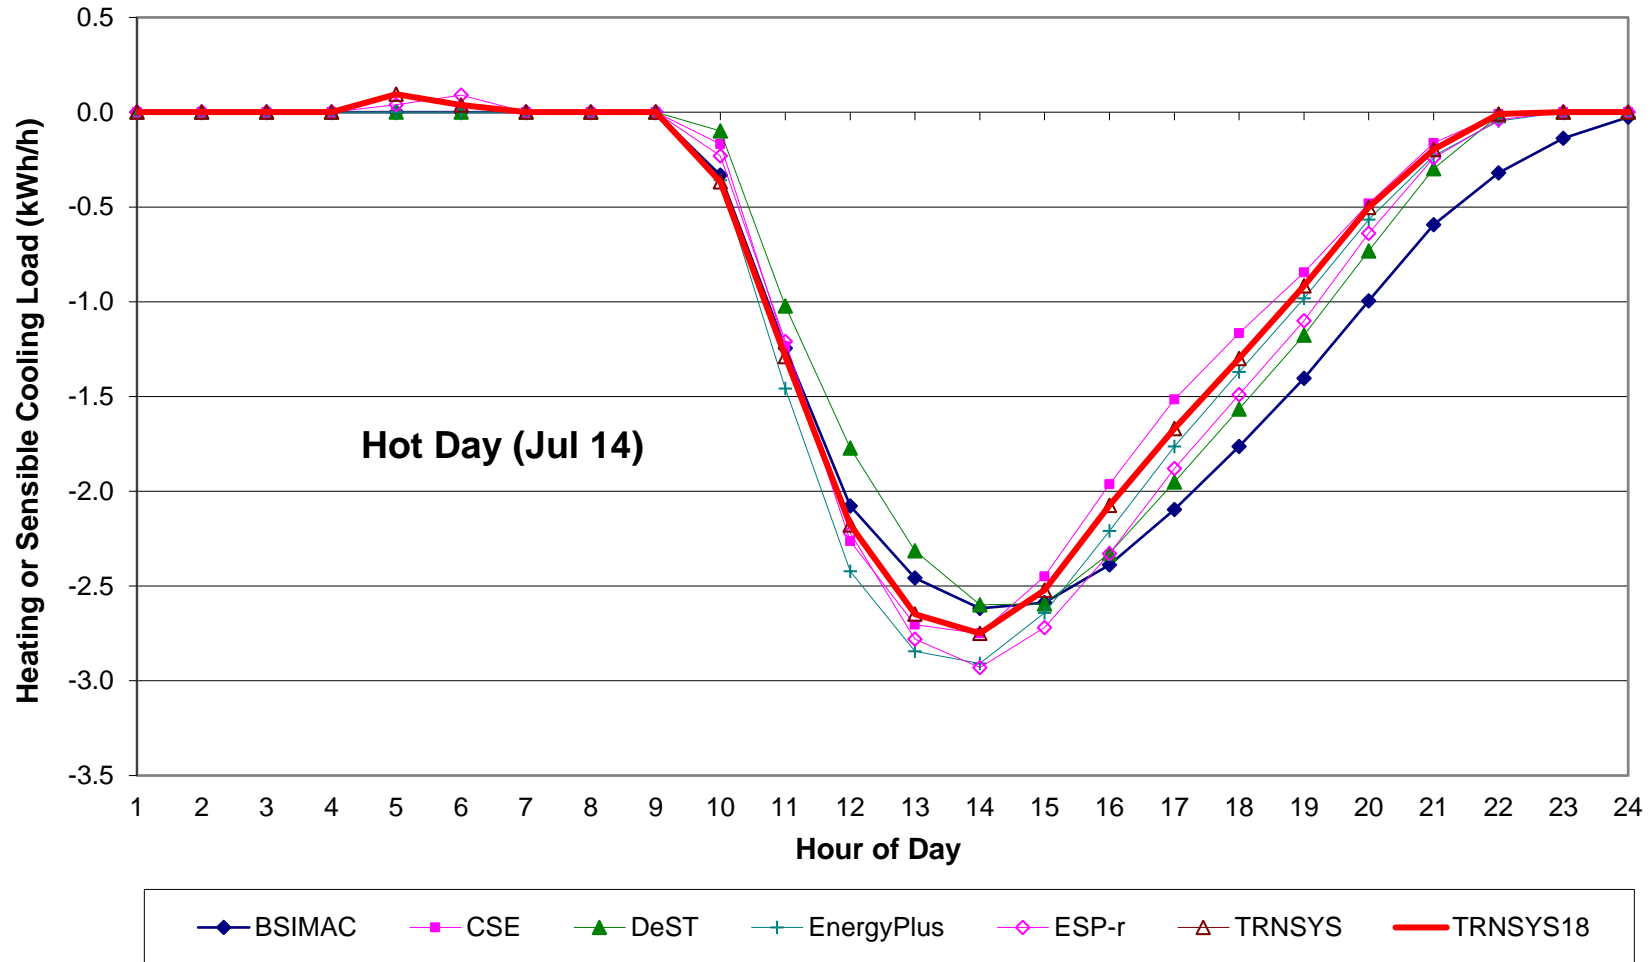


Figure B8-H17. Hourly Loads
Clear Cold Day, Case 640 (Low Mass, Night Setback)
Heating (+), Sensible Cooling (-)

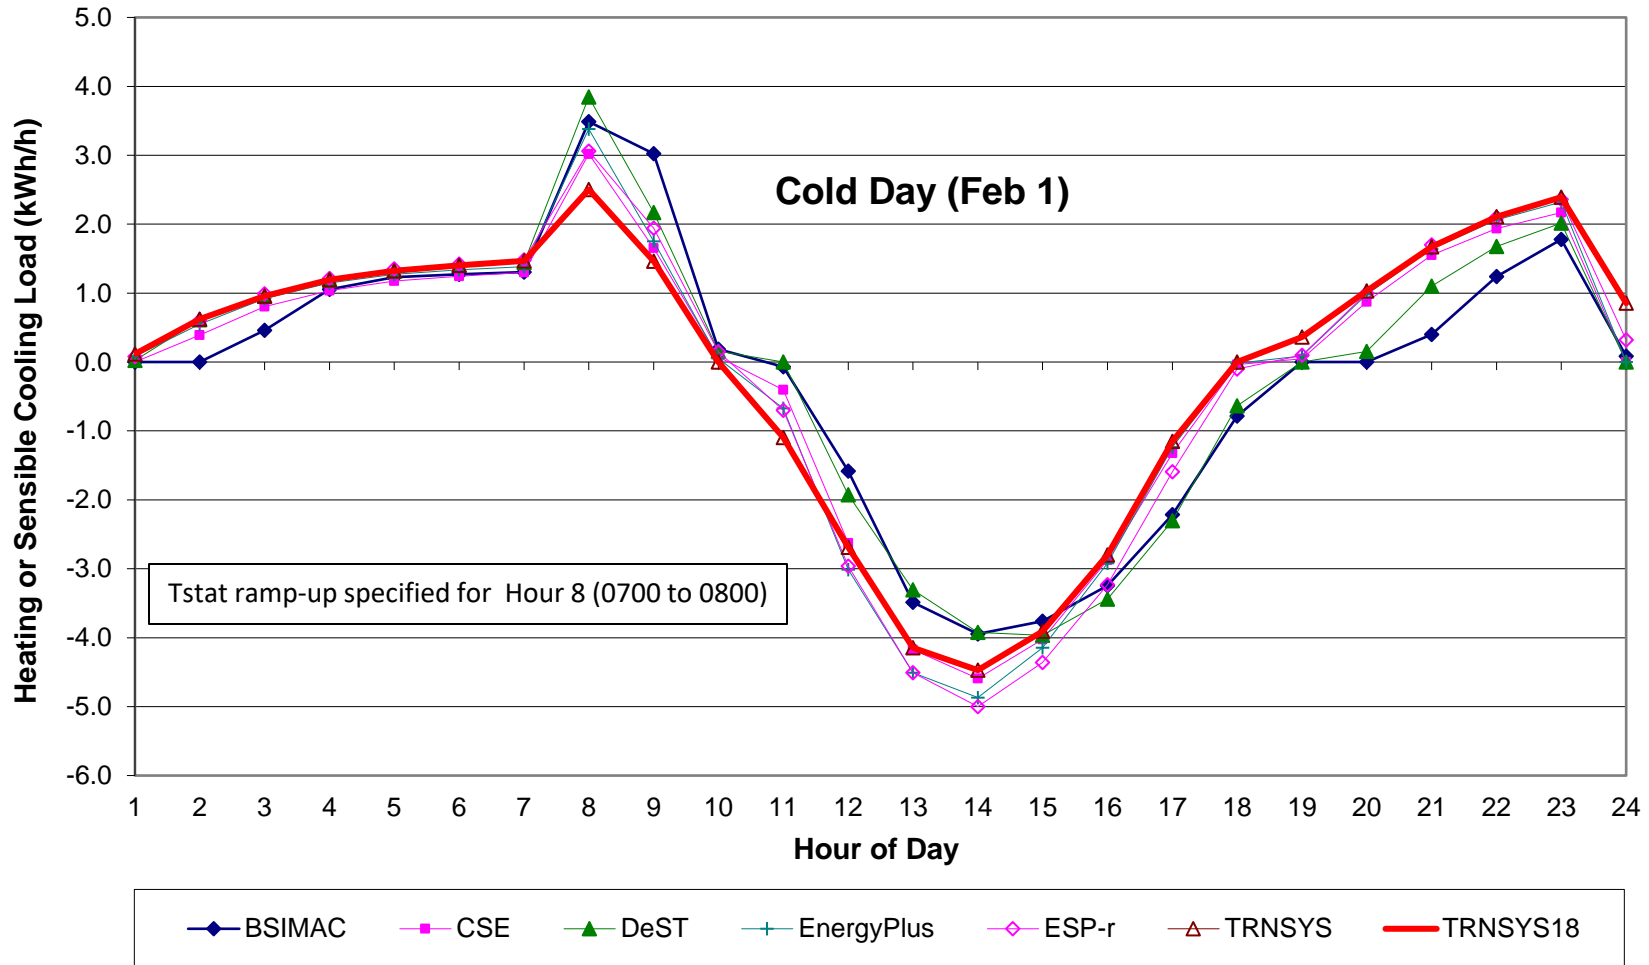


Figure B8-H18.
Hourly Conditioned Zone Temperatures
Clear Cold Day, Case 640

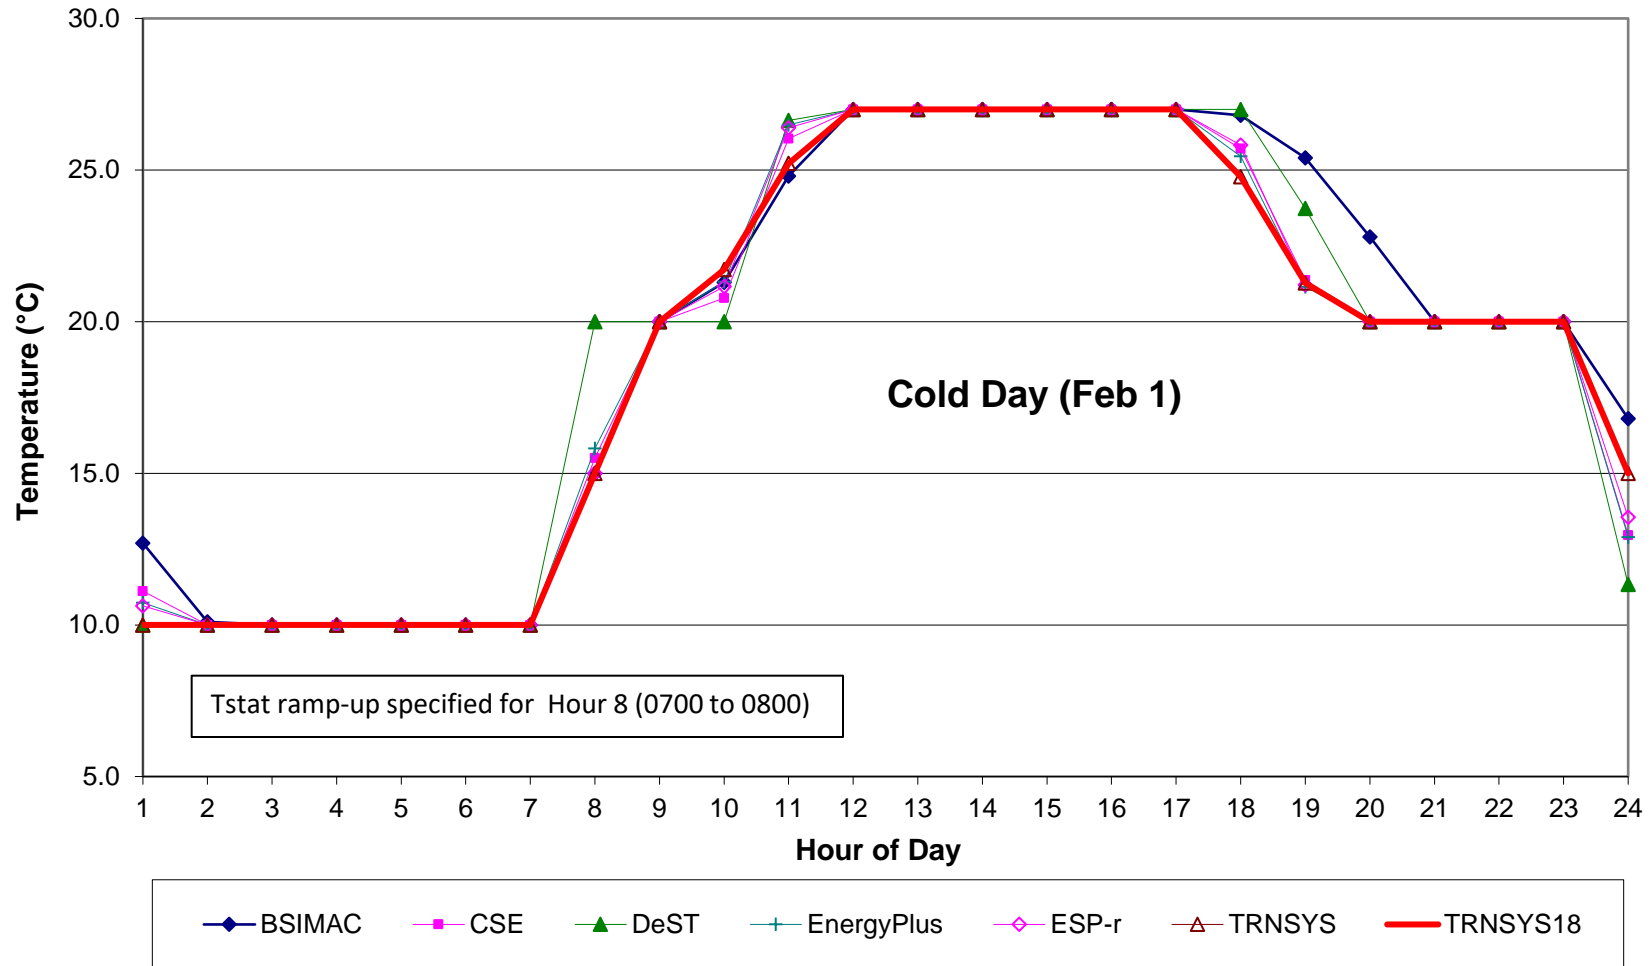


Figure B8-H19. Hourly Loads
Clear Cold Day, Case 940 (High Mass, Night Setback)
Heating (+), Sensible Cooling (-)

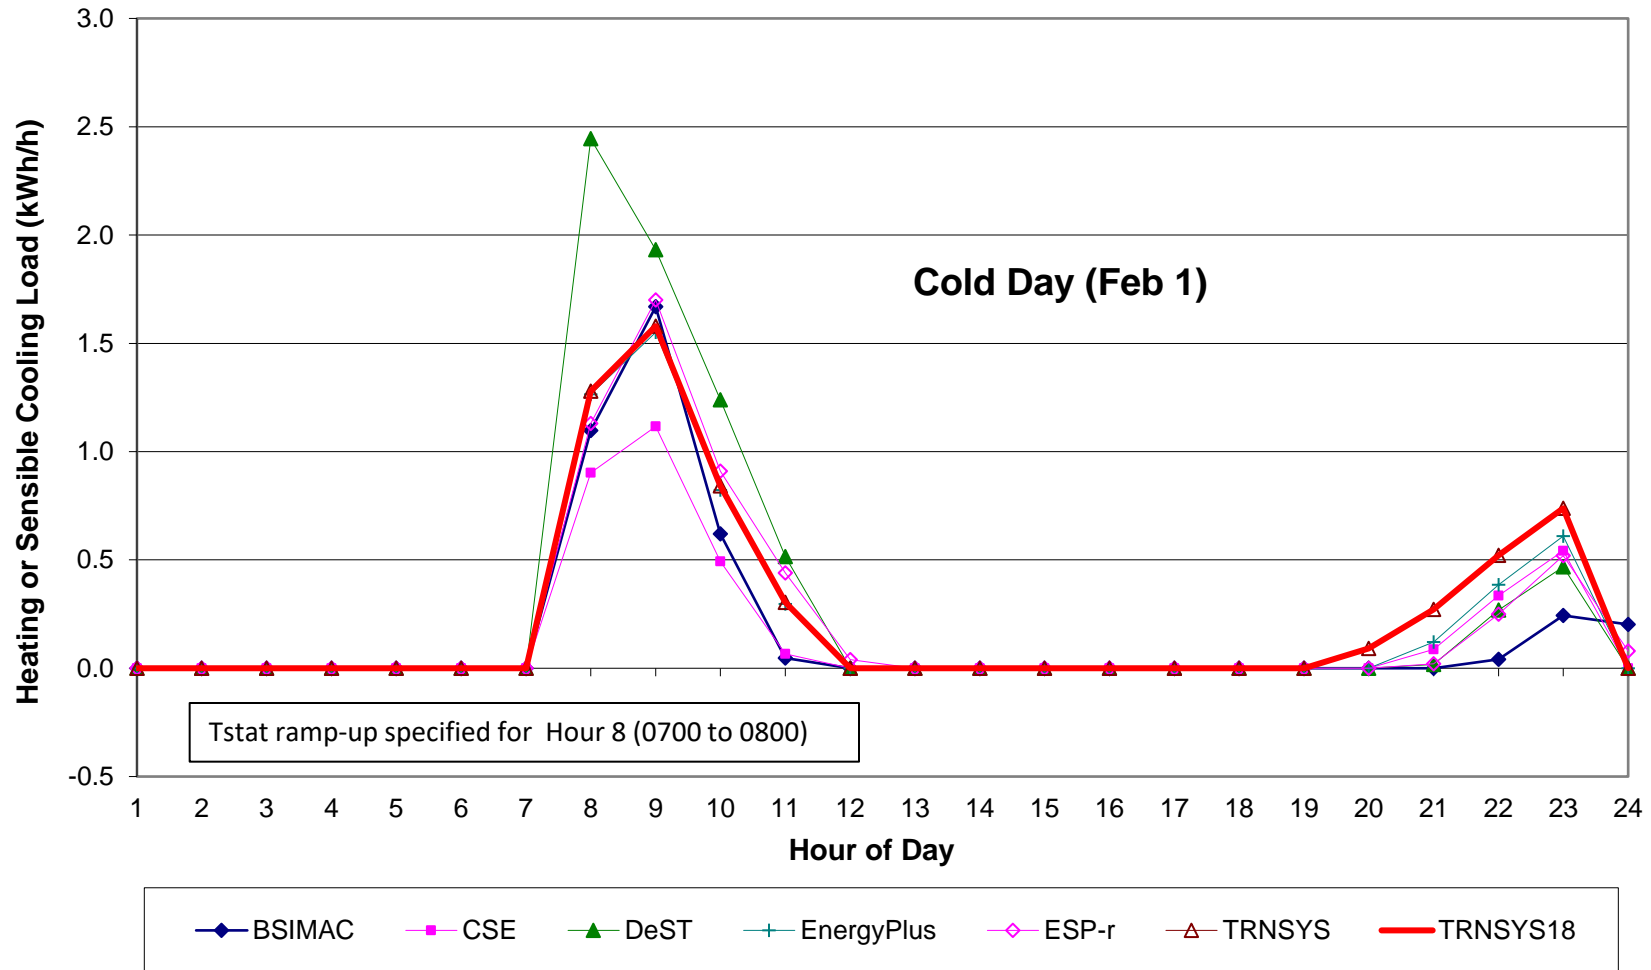


Figure B8-H20.
Hourly Conditioned Zone Temperatures
Clear Cold Day, Case 940

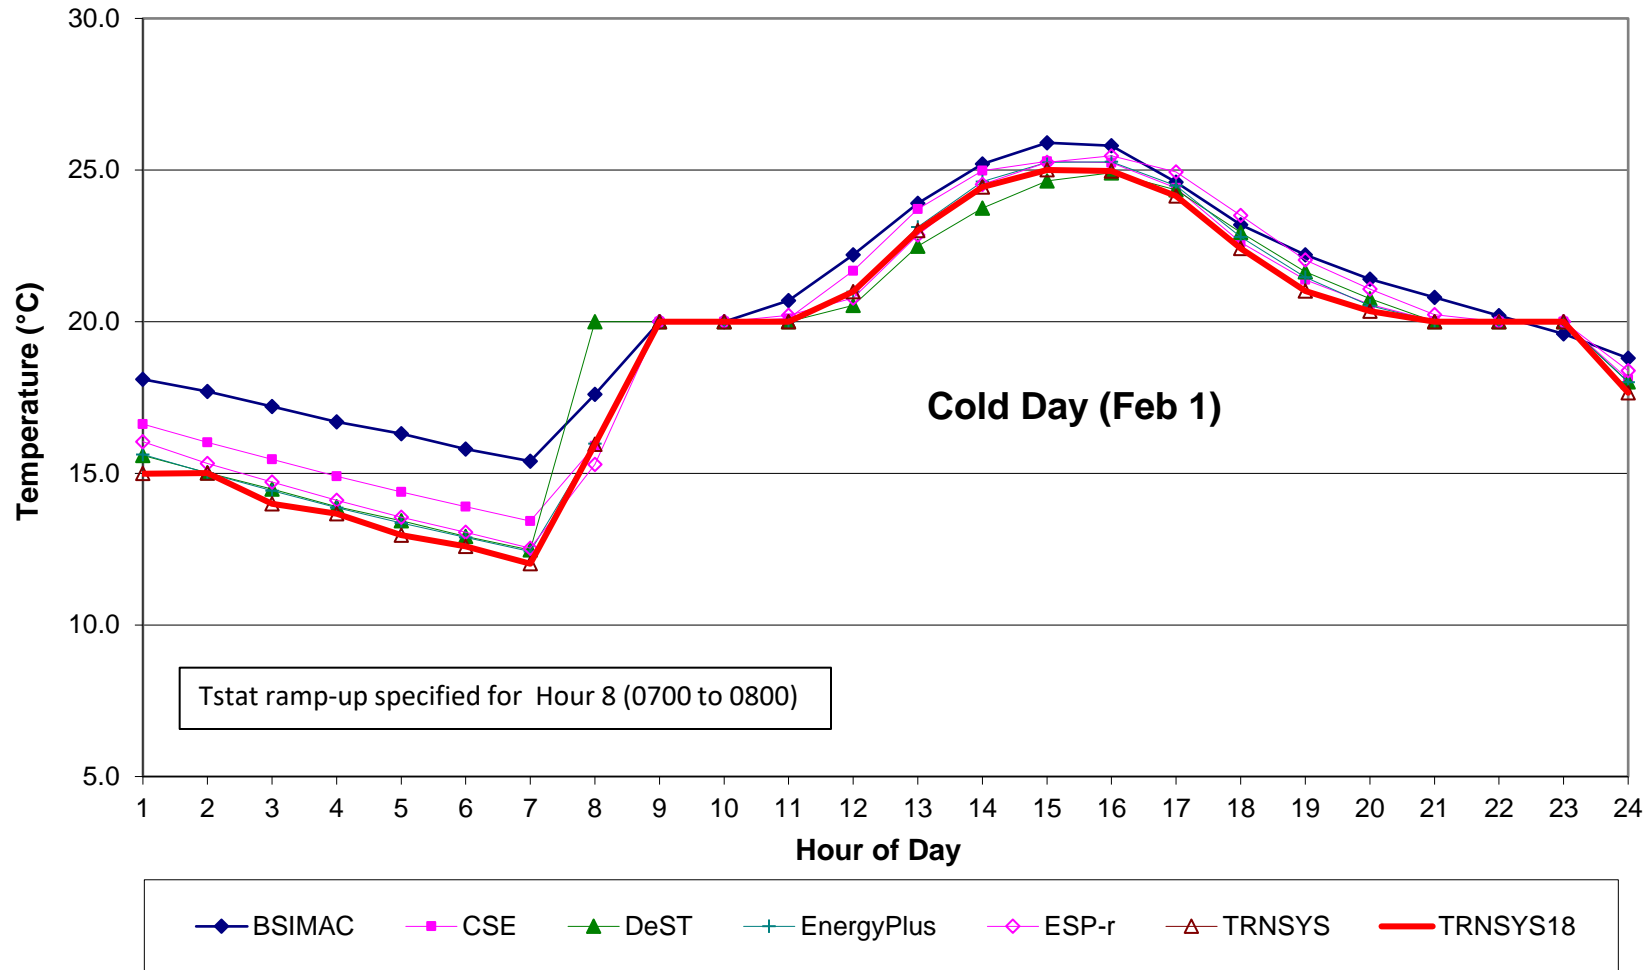


Figure B8-H21. Hourly Loads
Clear Cold Day, Case 660 (Low-E Window)
Heating (+), Sensible Cooling (-)

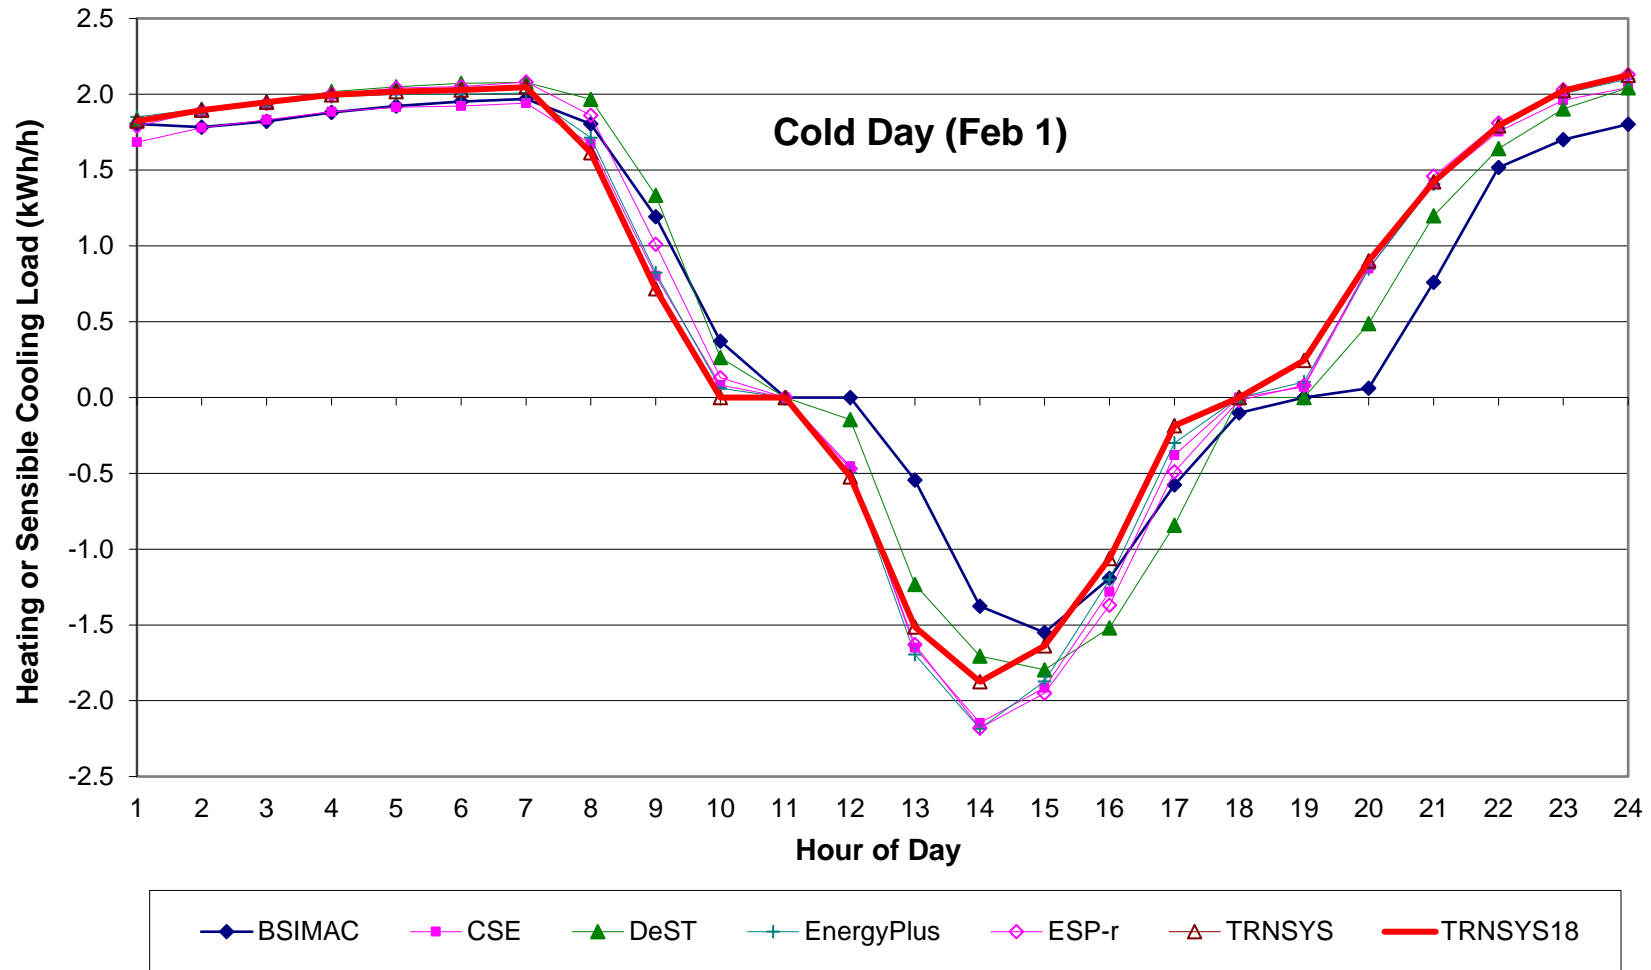


Figure B8-H22. Hourly Loads
Clear Hot Day, Case 660 (Low-E Window)
Heating (+), Sensible Cooling (-)


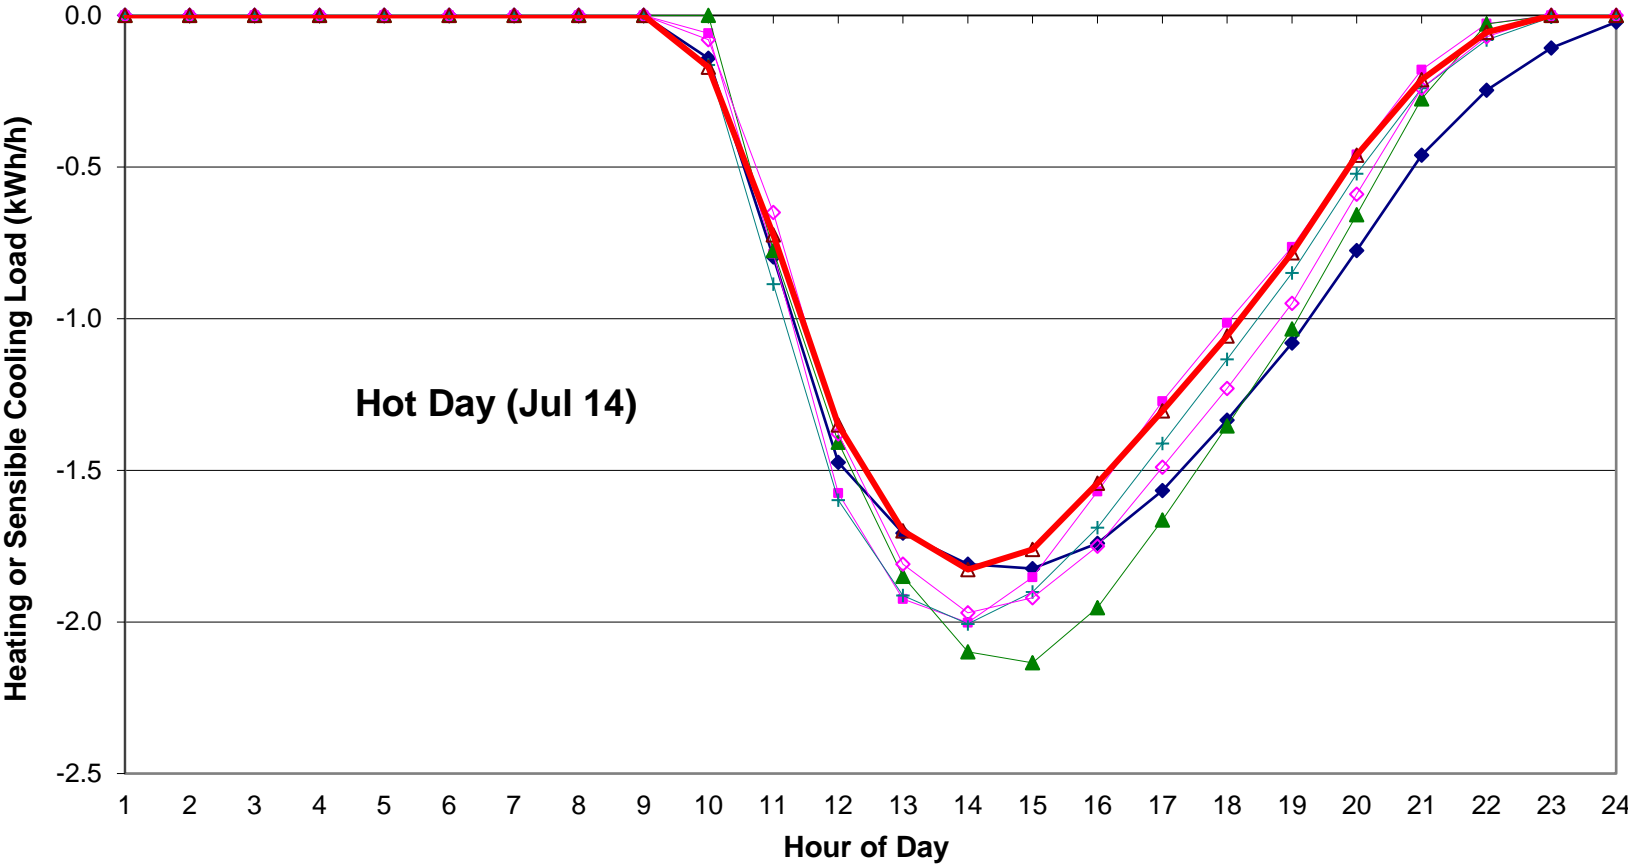


Figure B8-H23. Hourly Loads
Clear Cold Day, Case 670 (Single-Pane Window)
Heating (+), Sensible Cooling (-)


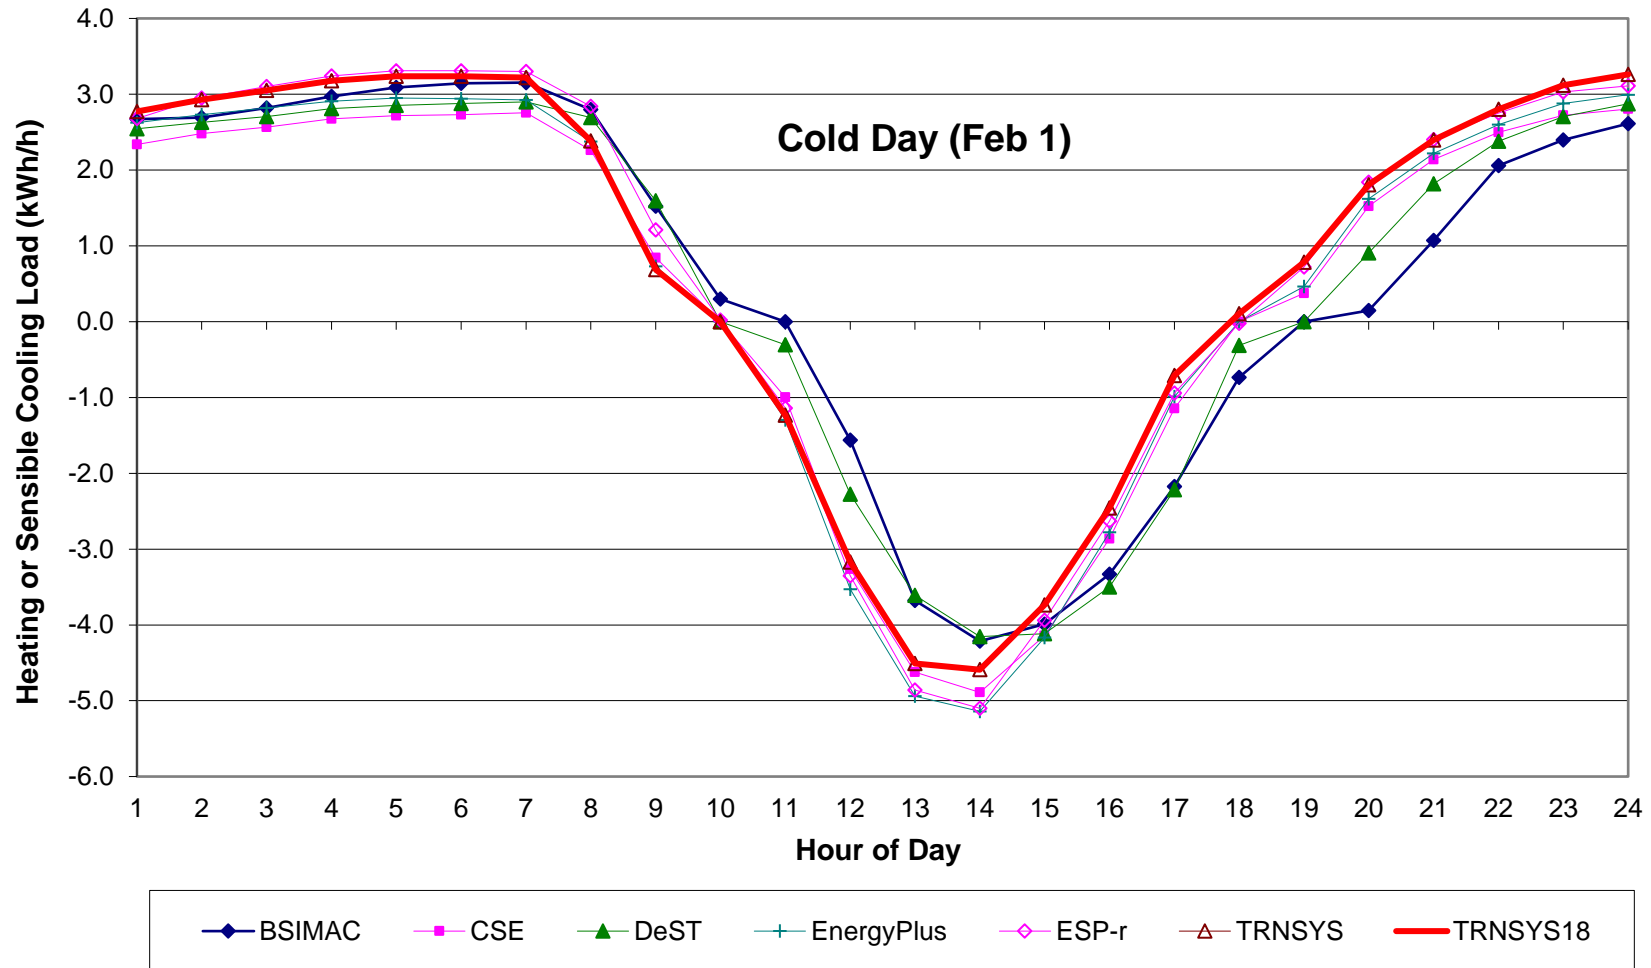


Figure B8-H24. Hourly Loads
Clear Hot Day, Case 670 (Single-Pane Window)
Heating (+), Sensible Cooling (-)

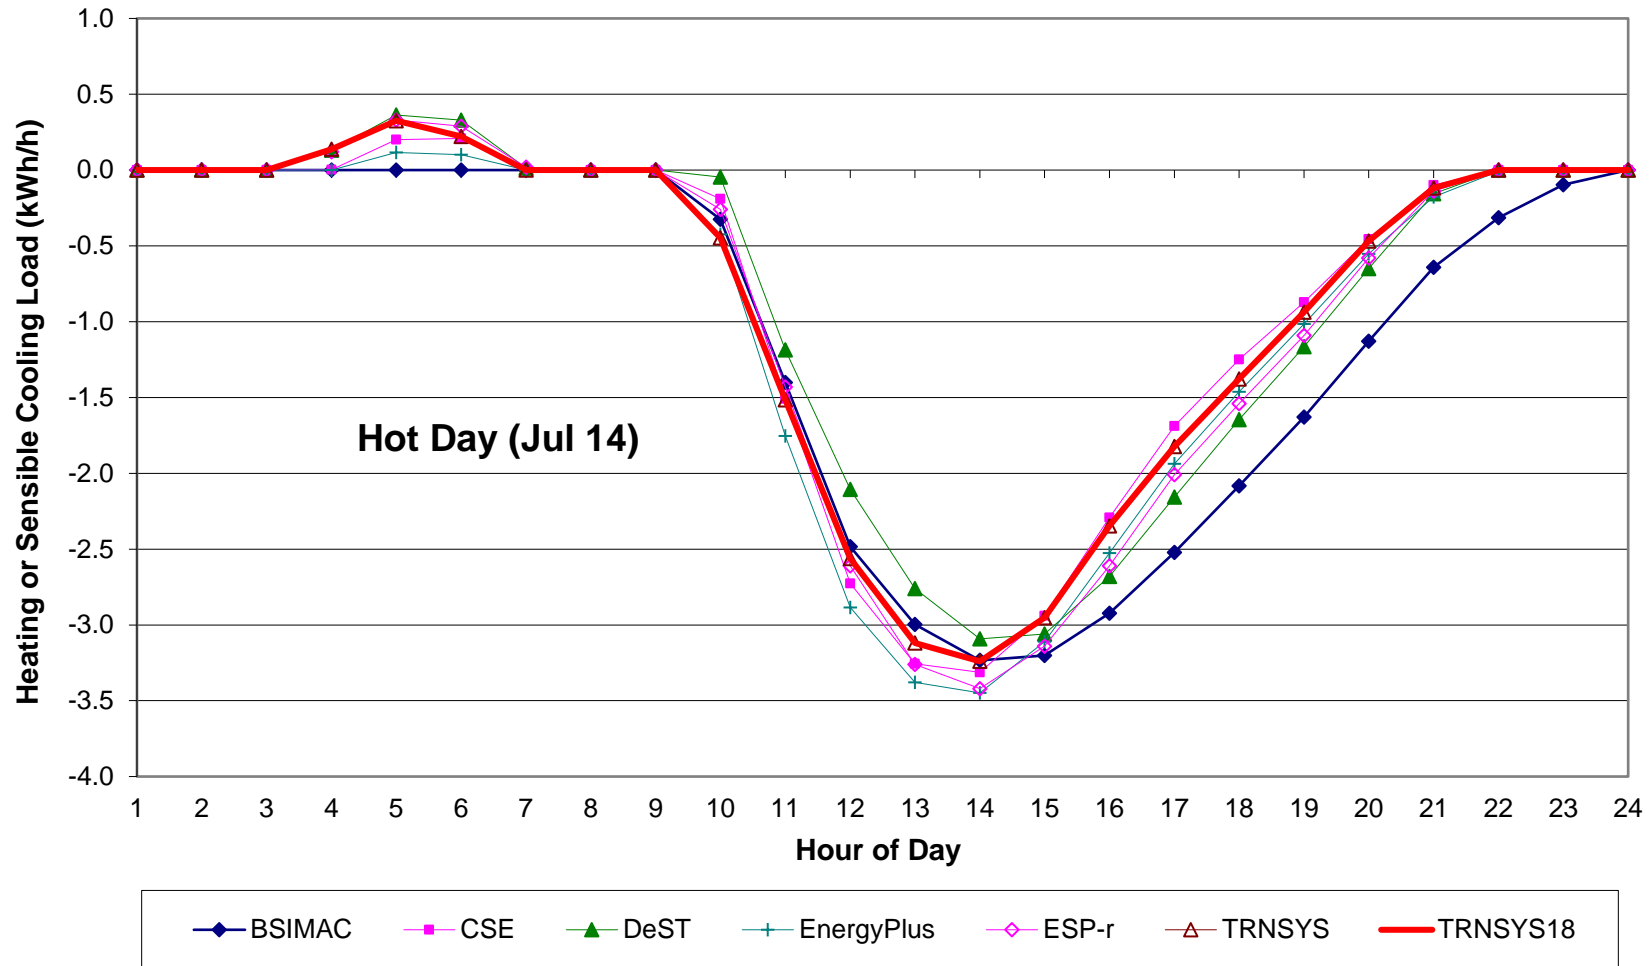

**Figure B8-H25. Hourly Loads
Clear Cold Day, Case 680 (Insulation)
Heating (+), Sensible Cooling (-)**

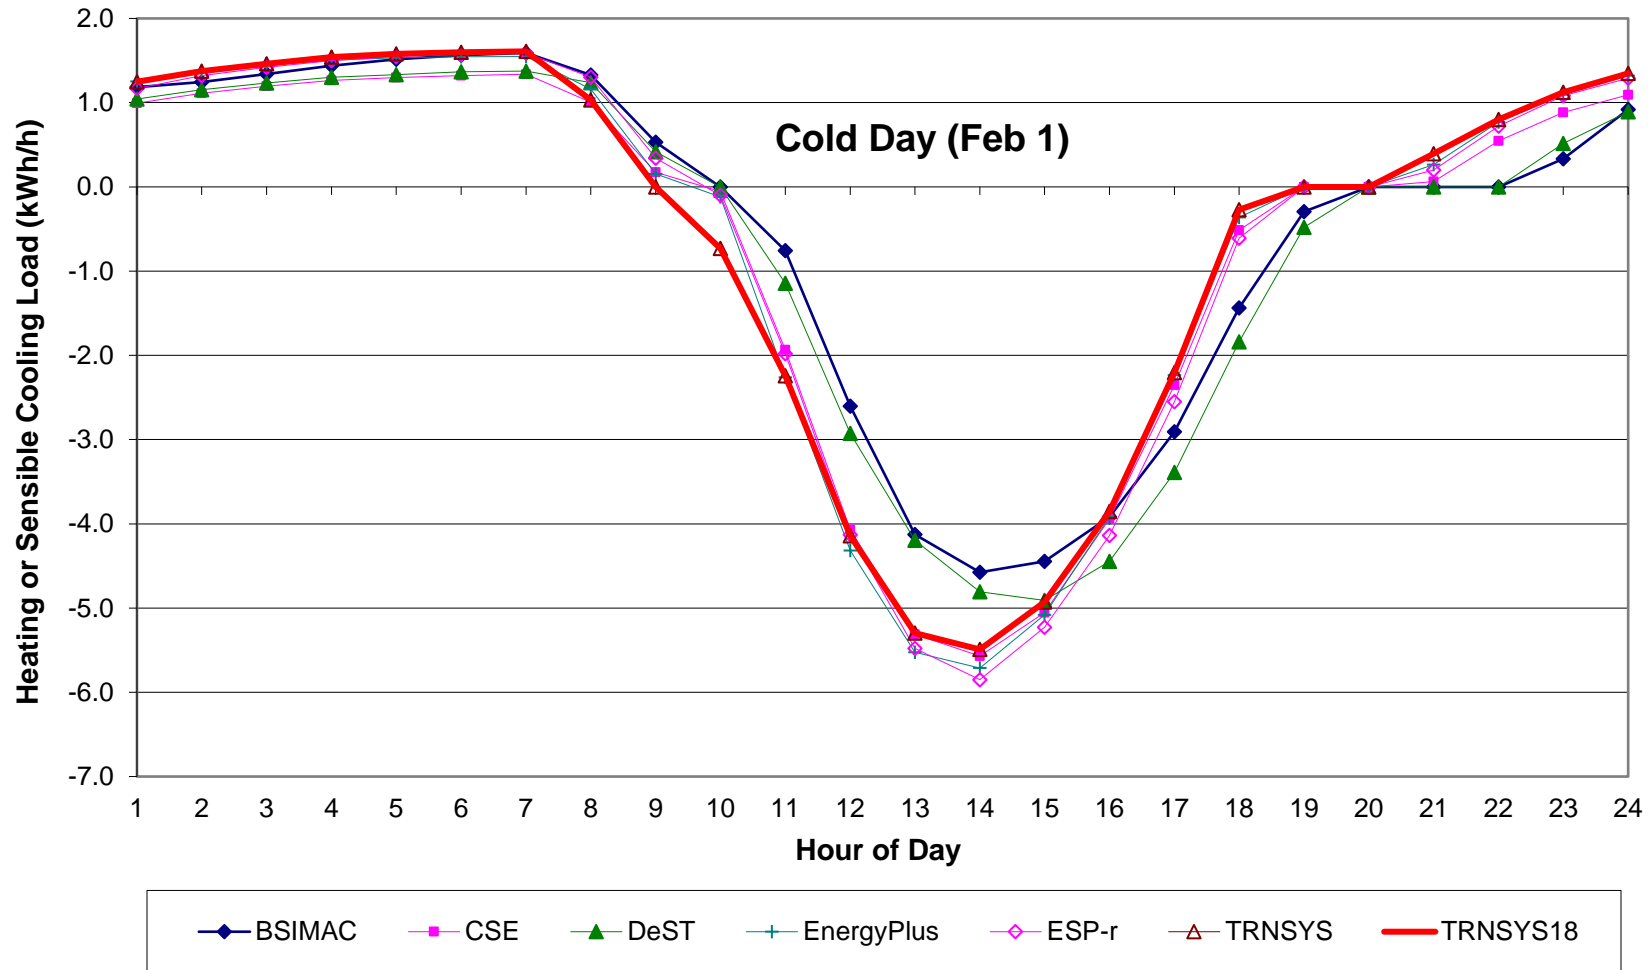


Figure B8-H26. Hourly Loads
Clear Hot Day, Case 680 (Insulation)
Heating (+), Sensible Cooling (-)


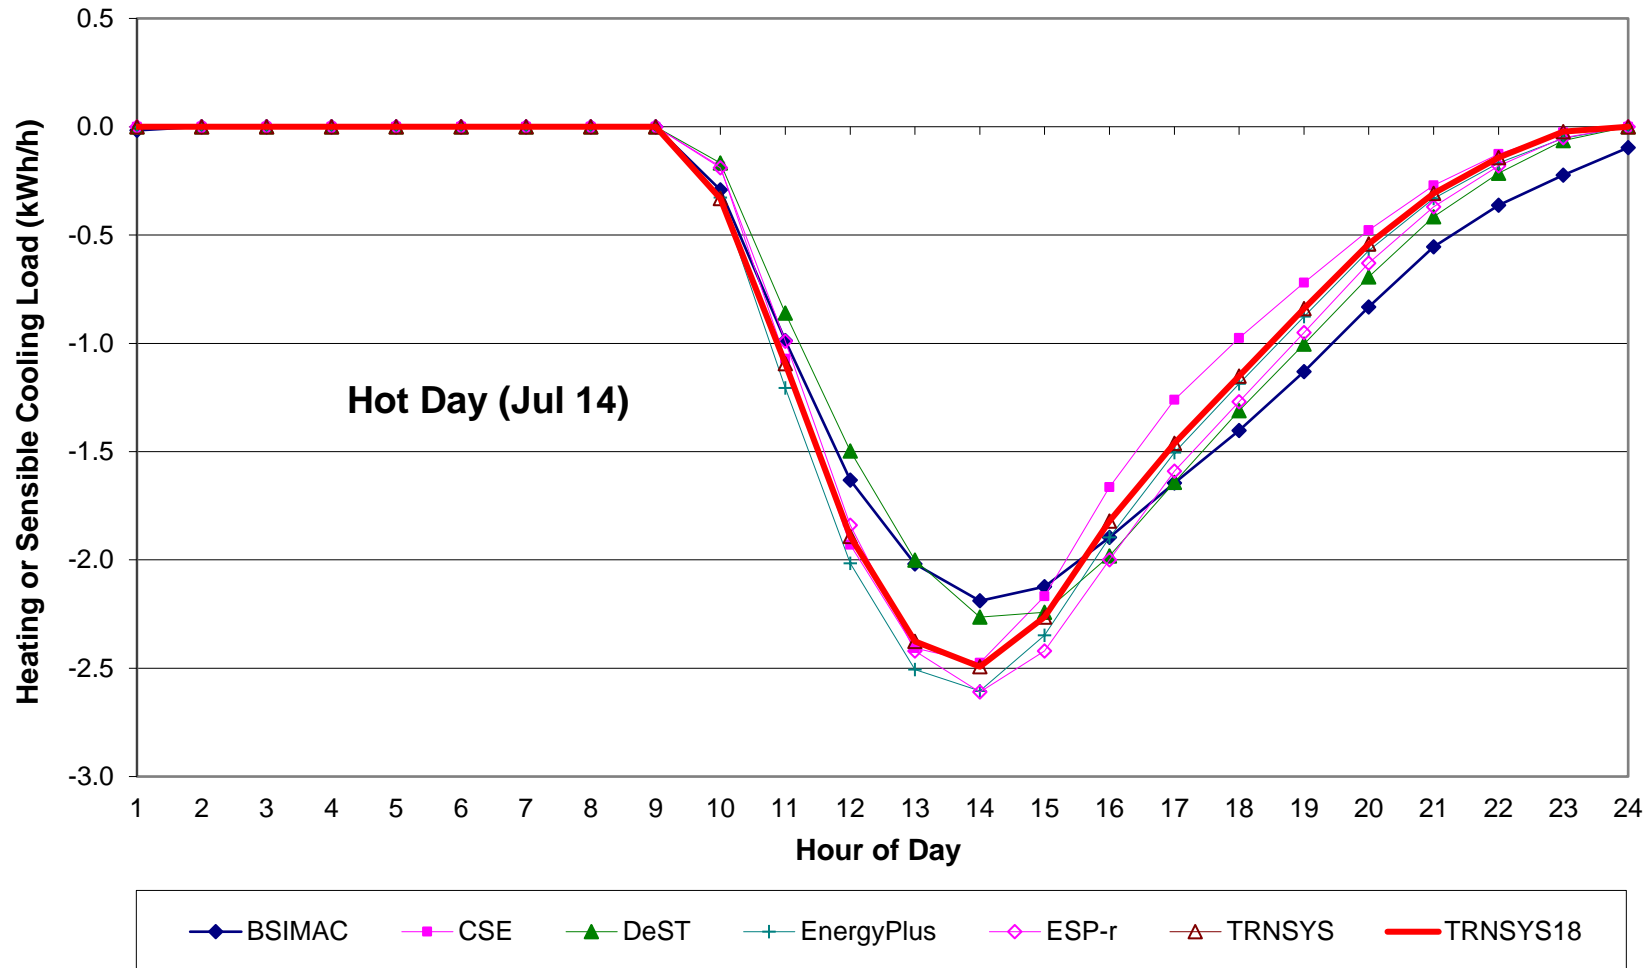


Figure B8-H27. Hourly Loads
Clear Cold Day, Case 685 (20/20 Tstat)
Heating (+), Sensible Cooling (-)

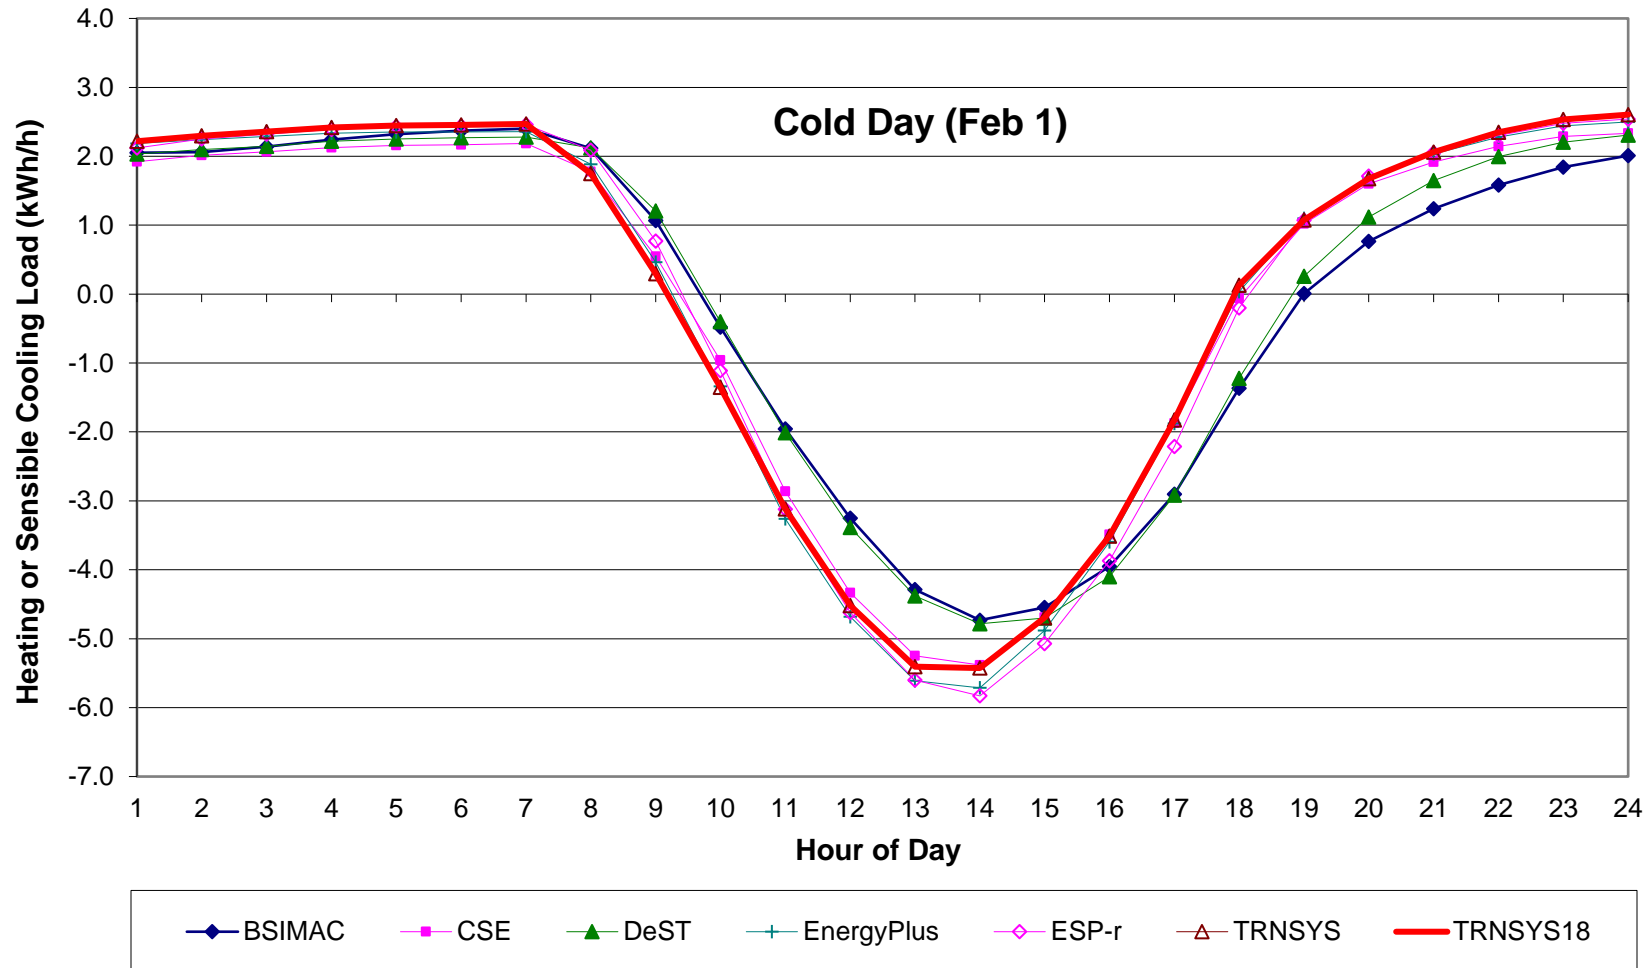

**Figure B8-H28. Hourly Loads
Clear Hot Day, Case 685 (20/20 Tstat)
Heating (+), Sensible Cooling (-)**

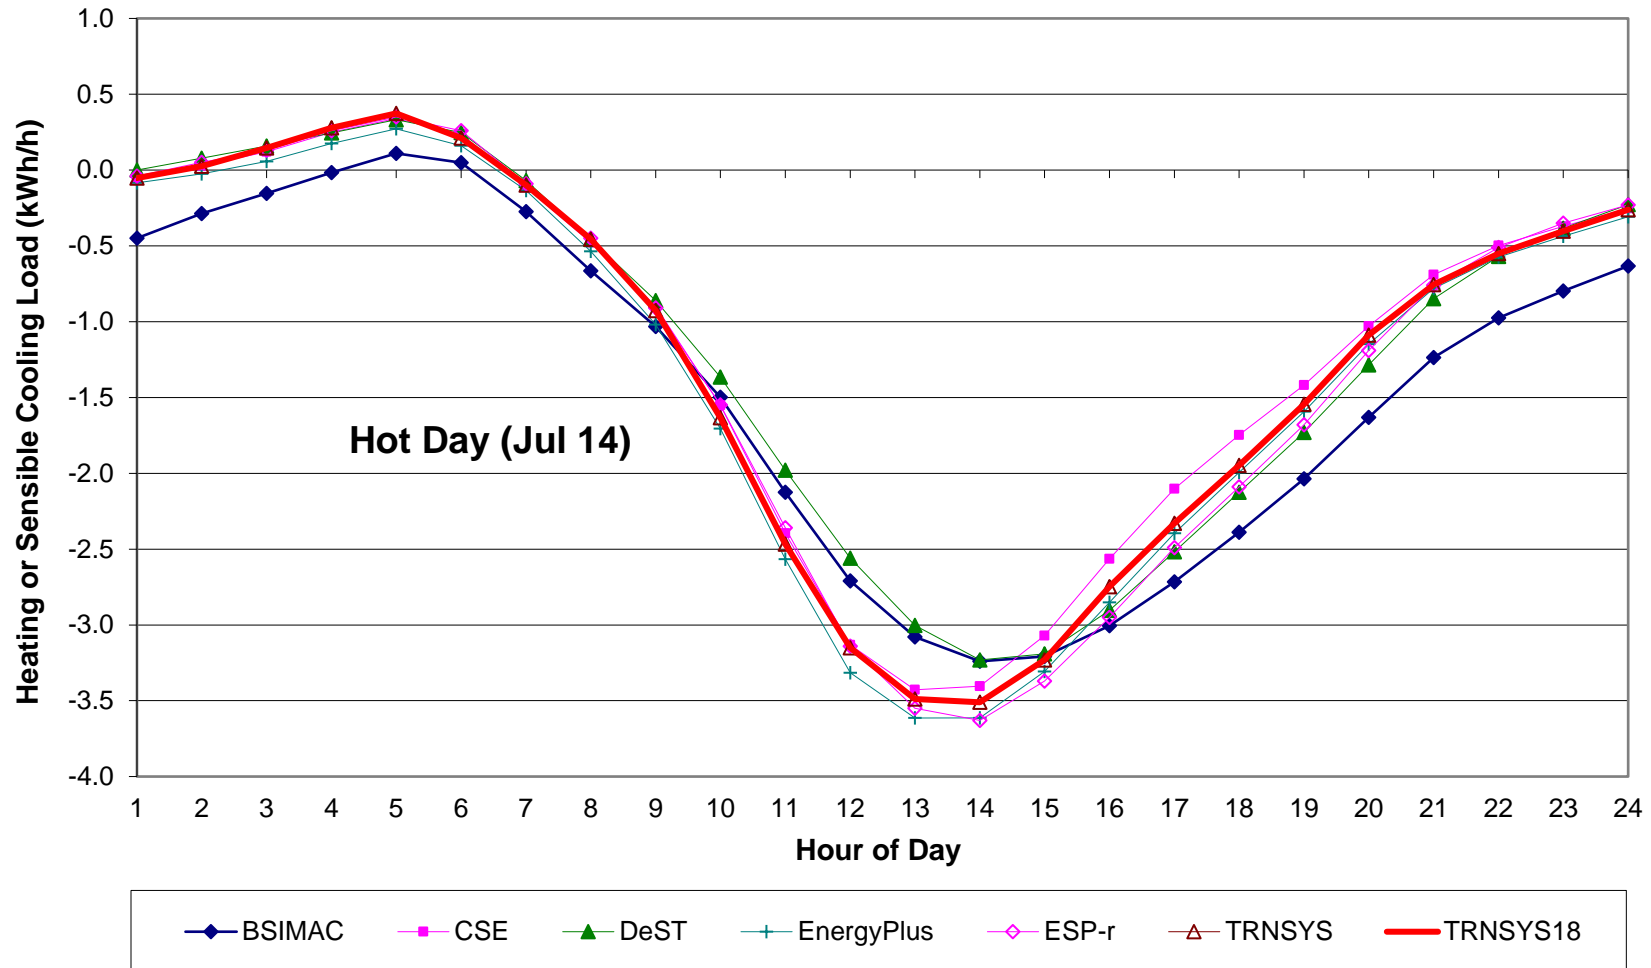


Figure B8-H29. Hourly Loads
Clear Cold Day, Case 695 (20/20, Insulation)
Heating (+), Sensible Cooling (-)



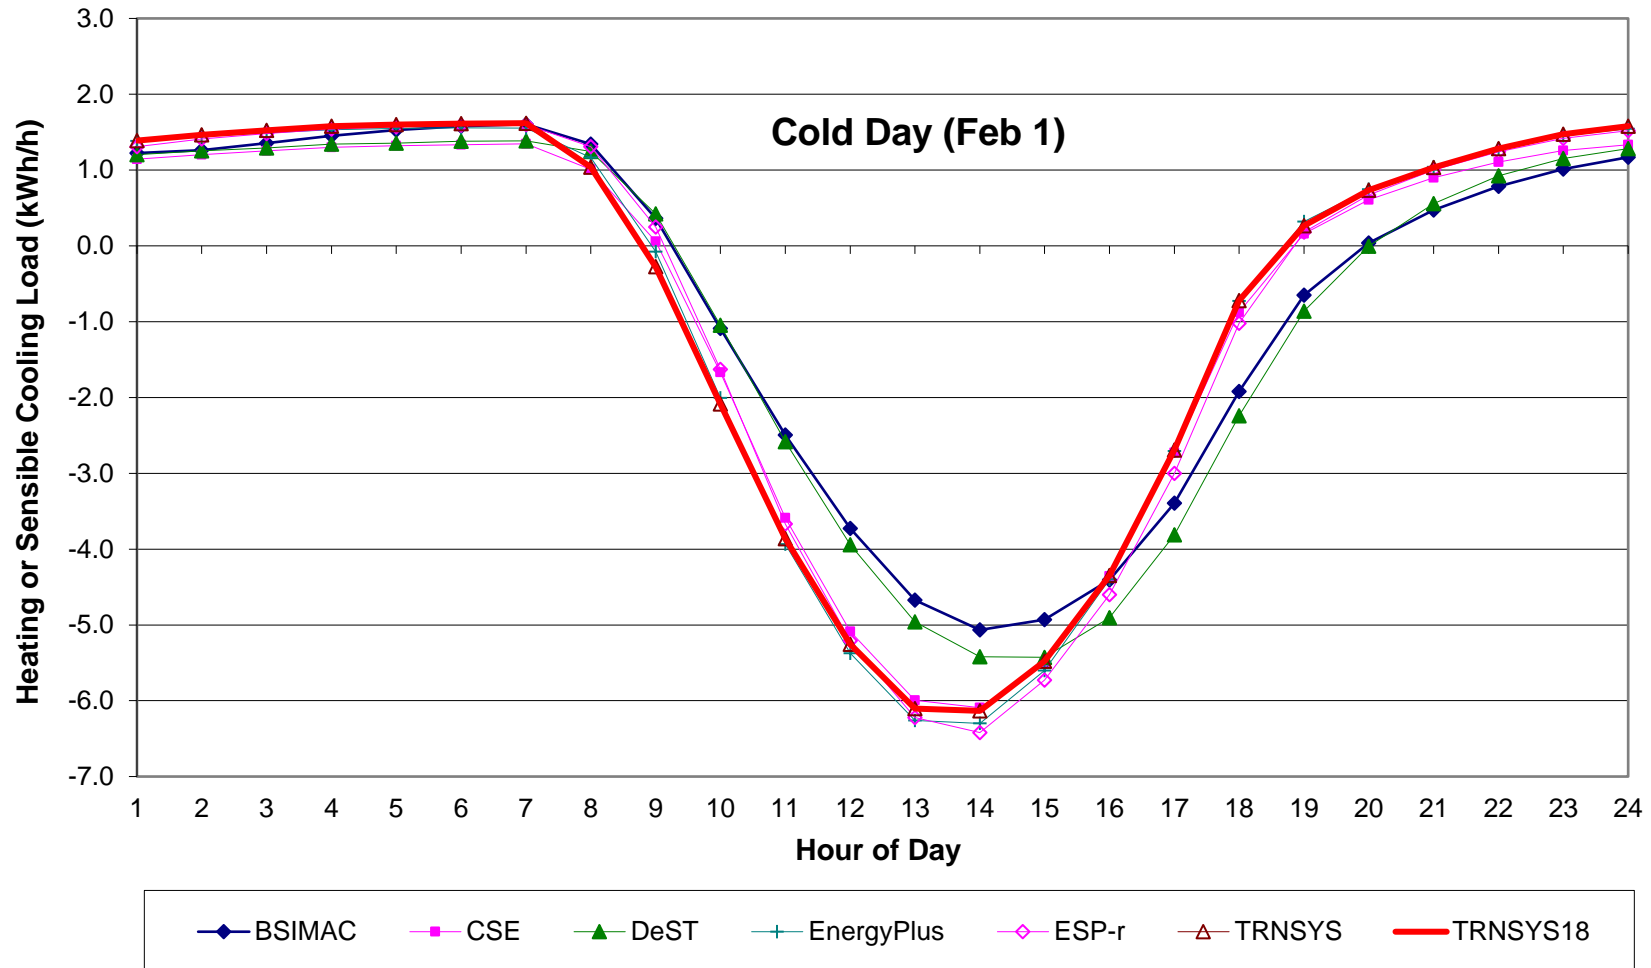


Figure B8-H30. Hourly Loads
Clear Hot Day, Case 695 (20/20, Insulation)
Heating (+), Sensible Cooling (-)

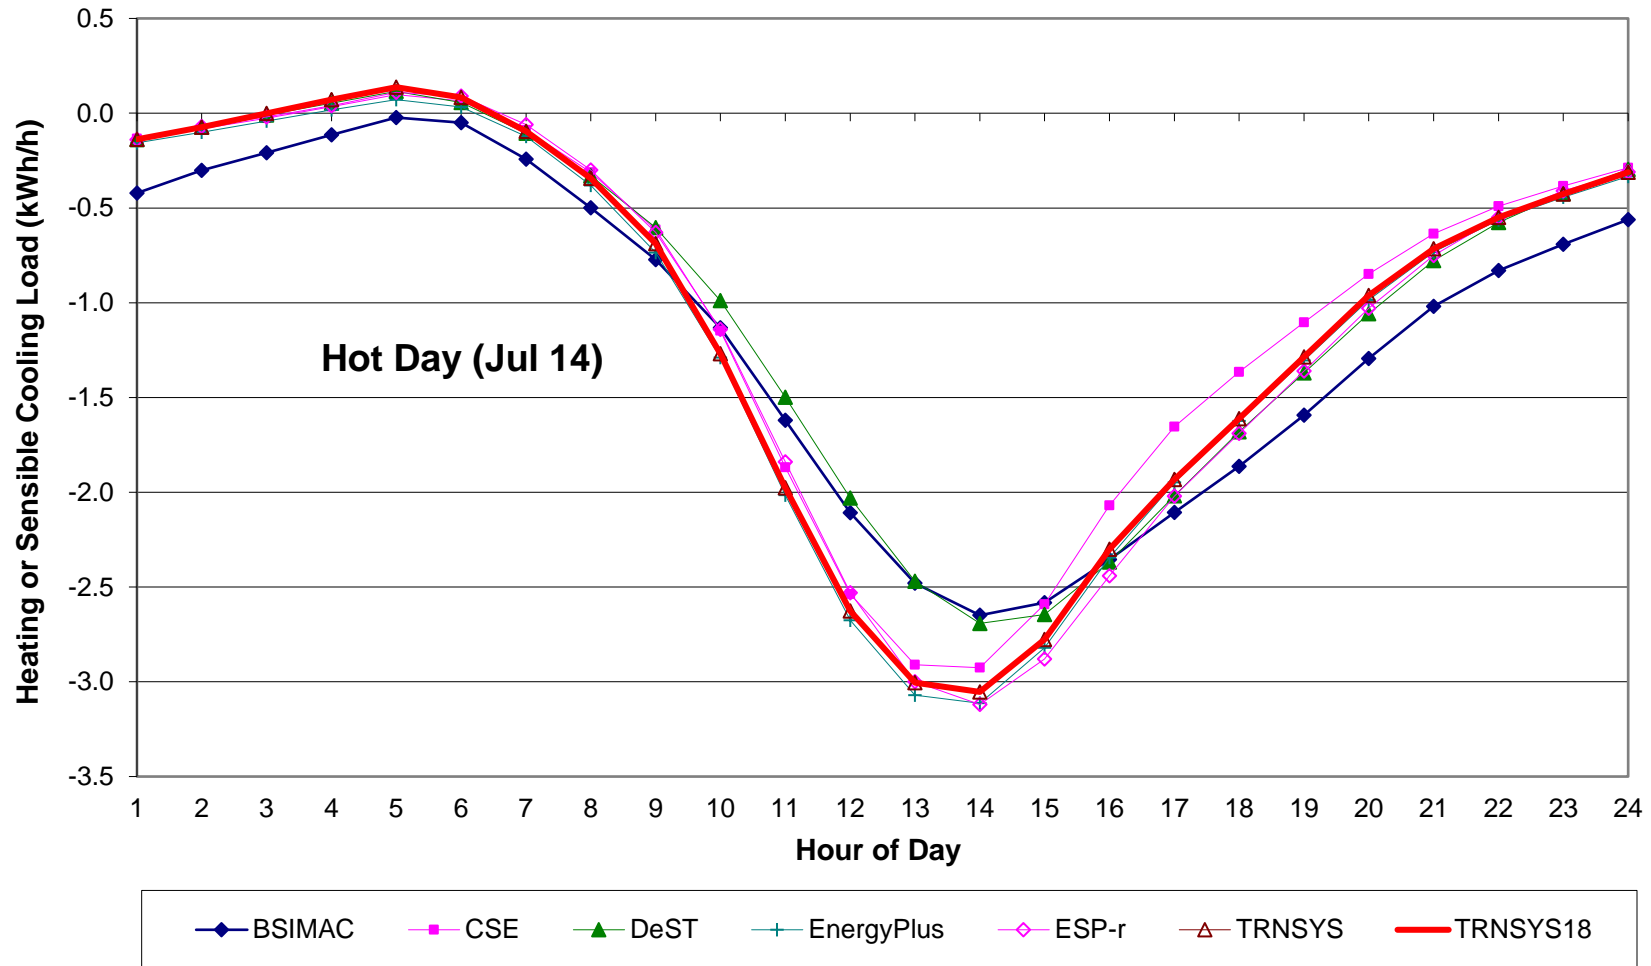

**Figure B8-H31. Hourly Loads
Clear Cold Day, Case 900 (High Mass)
Heating (+), Sensible Cooling (-)**

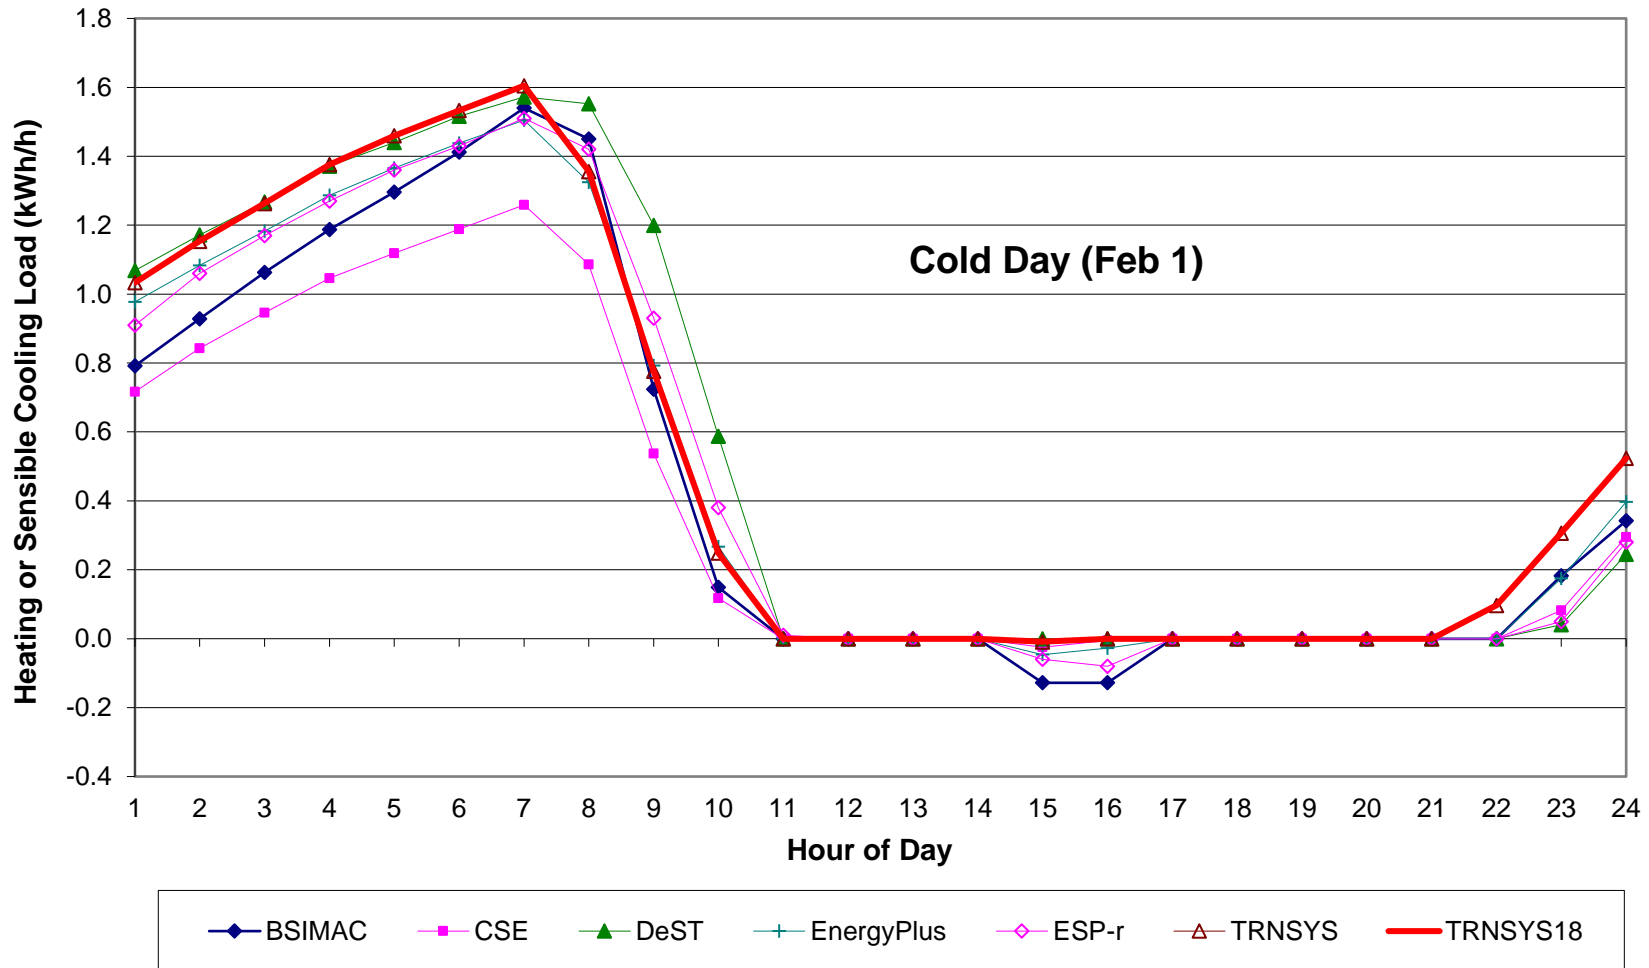

**Figure B8-H32. Hourly Loads
Clear Hot Day, Case 900 (High Mass)
Heating (+), Sensible Cooling (-)**

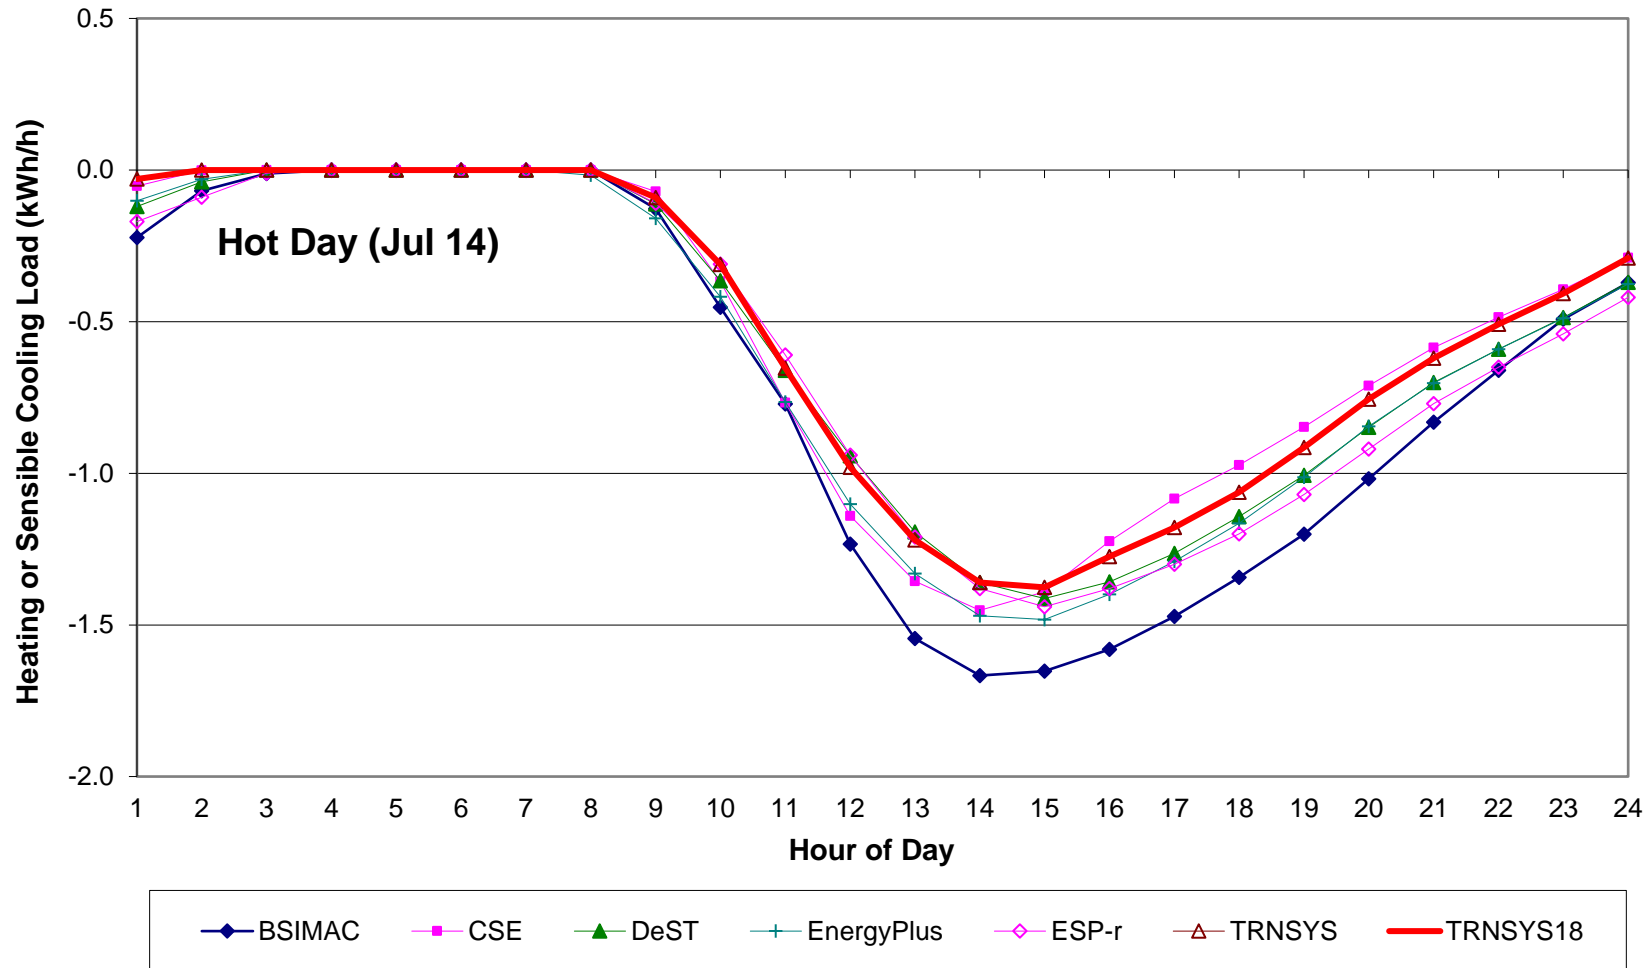


Figure B8-H33. Hourly Loads
Clear Cold Day, Case 980 (High Mass, Insulation)
Heating (+), Sensible Cooling (-)

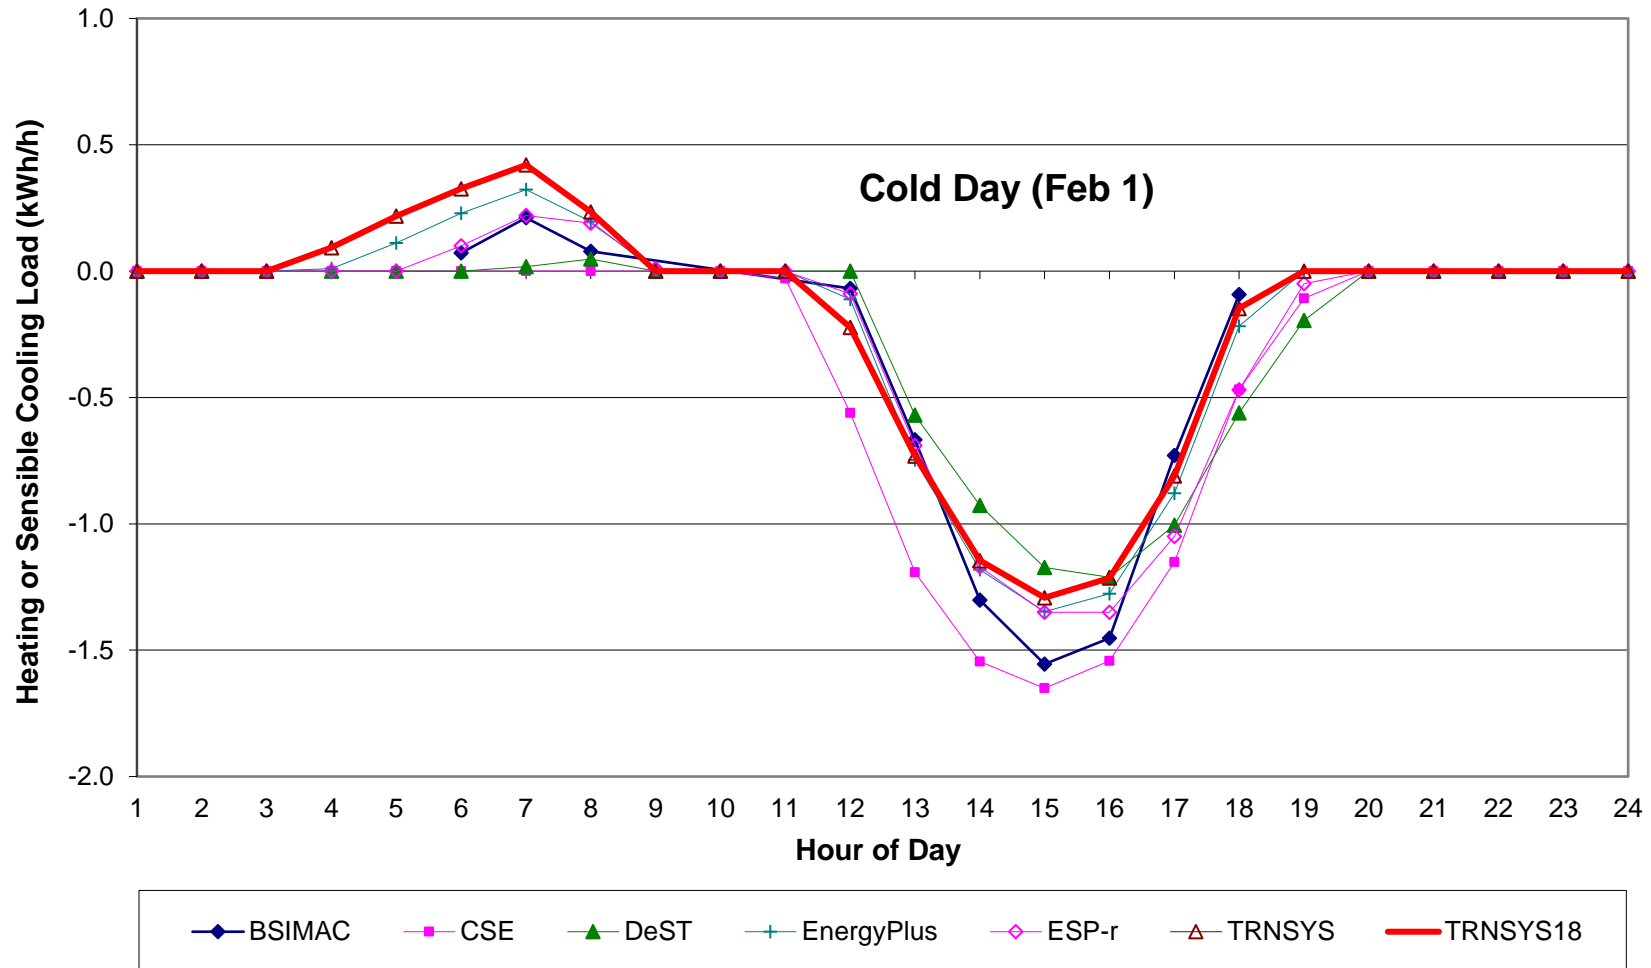


Figure B8-H34. Hourly Loads
Clear Hot Day, Case 980 (High Mass, Insulation)
Heating (+), Sensible Cooling (-)

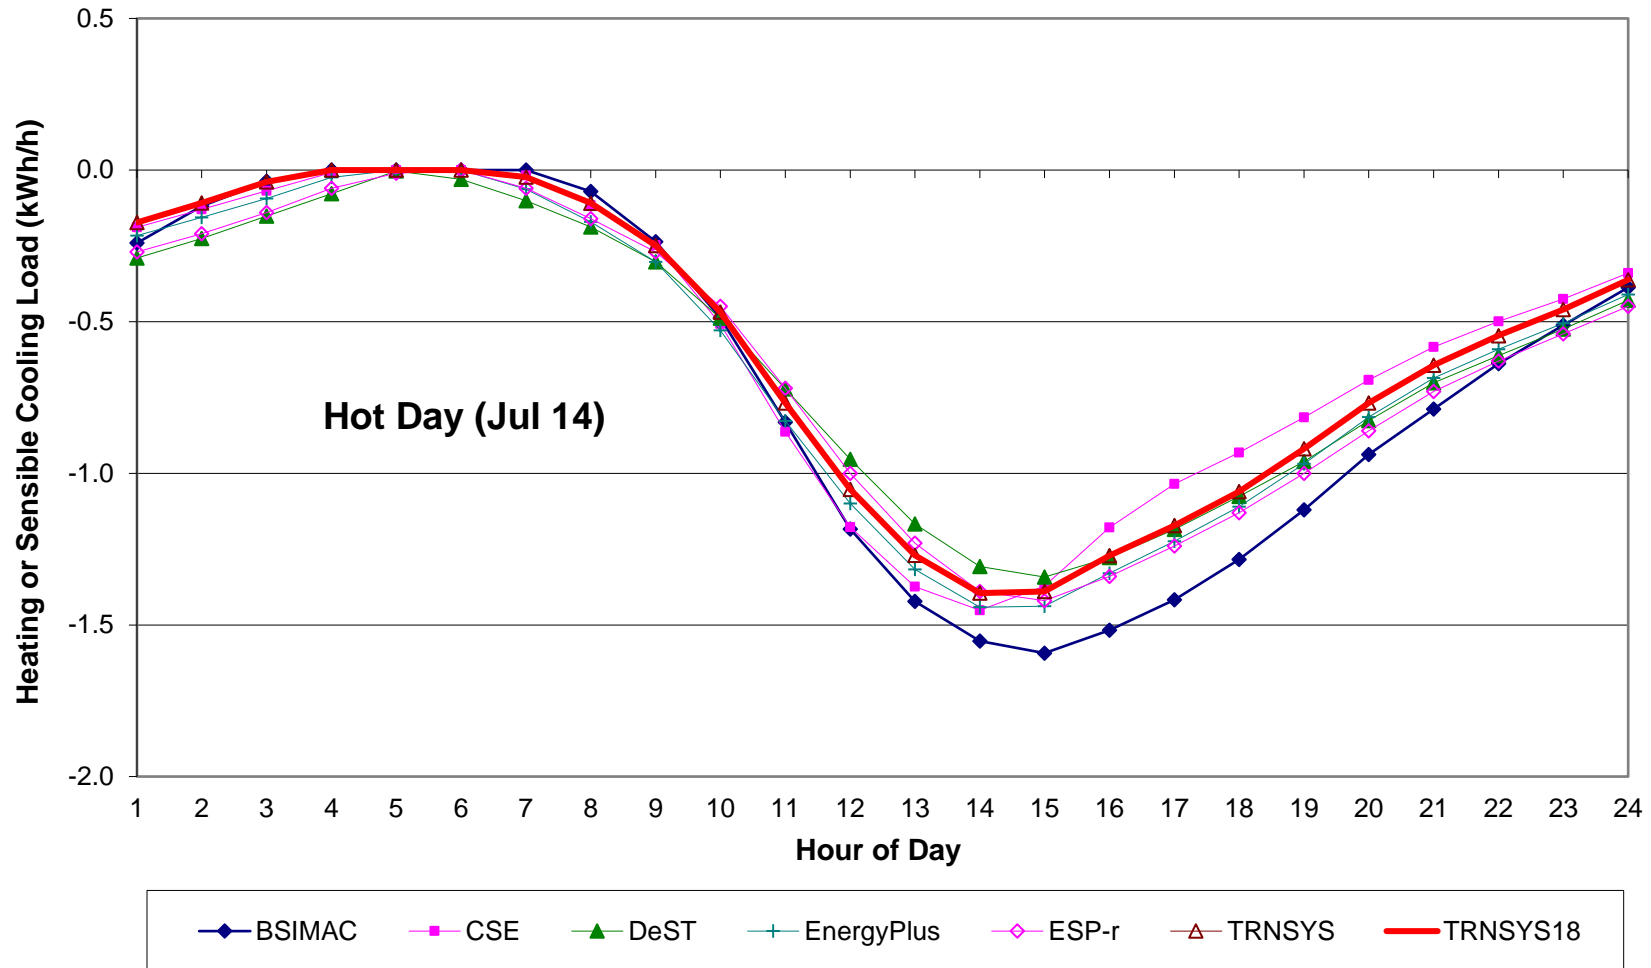


Figure B8-H35. Hourly Loads
Clear Cold Day, Case 985 (High Mass, 20/20 Tstat)
Heating (+), Sensible Cooling (-)

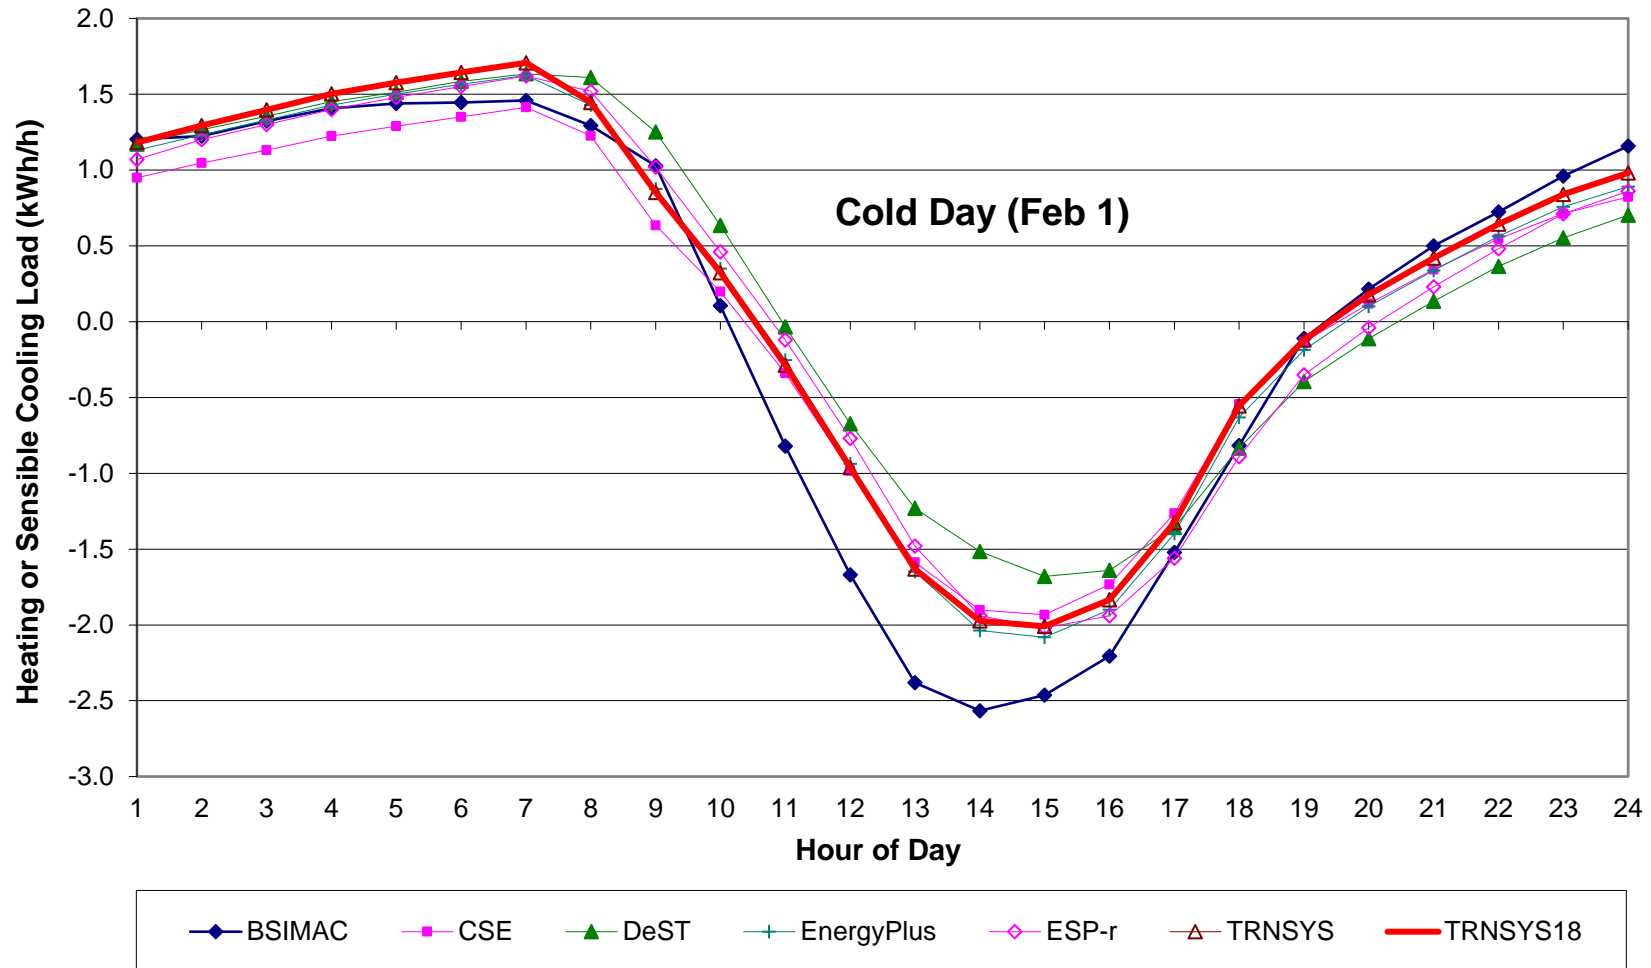


Figure B8-H36. Hourly Loads
Clear Hot Day, Case 985 (High Mass, 20/20 Tstat)
Heating (+), Sensible Cooling (-)

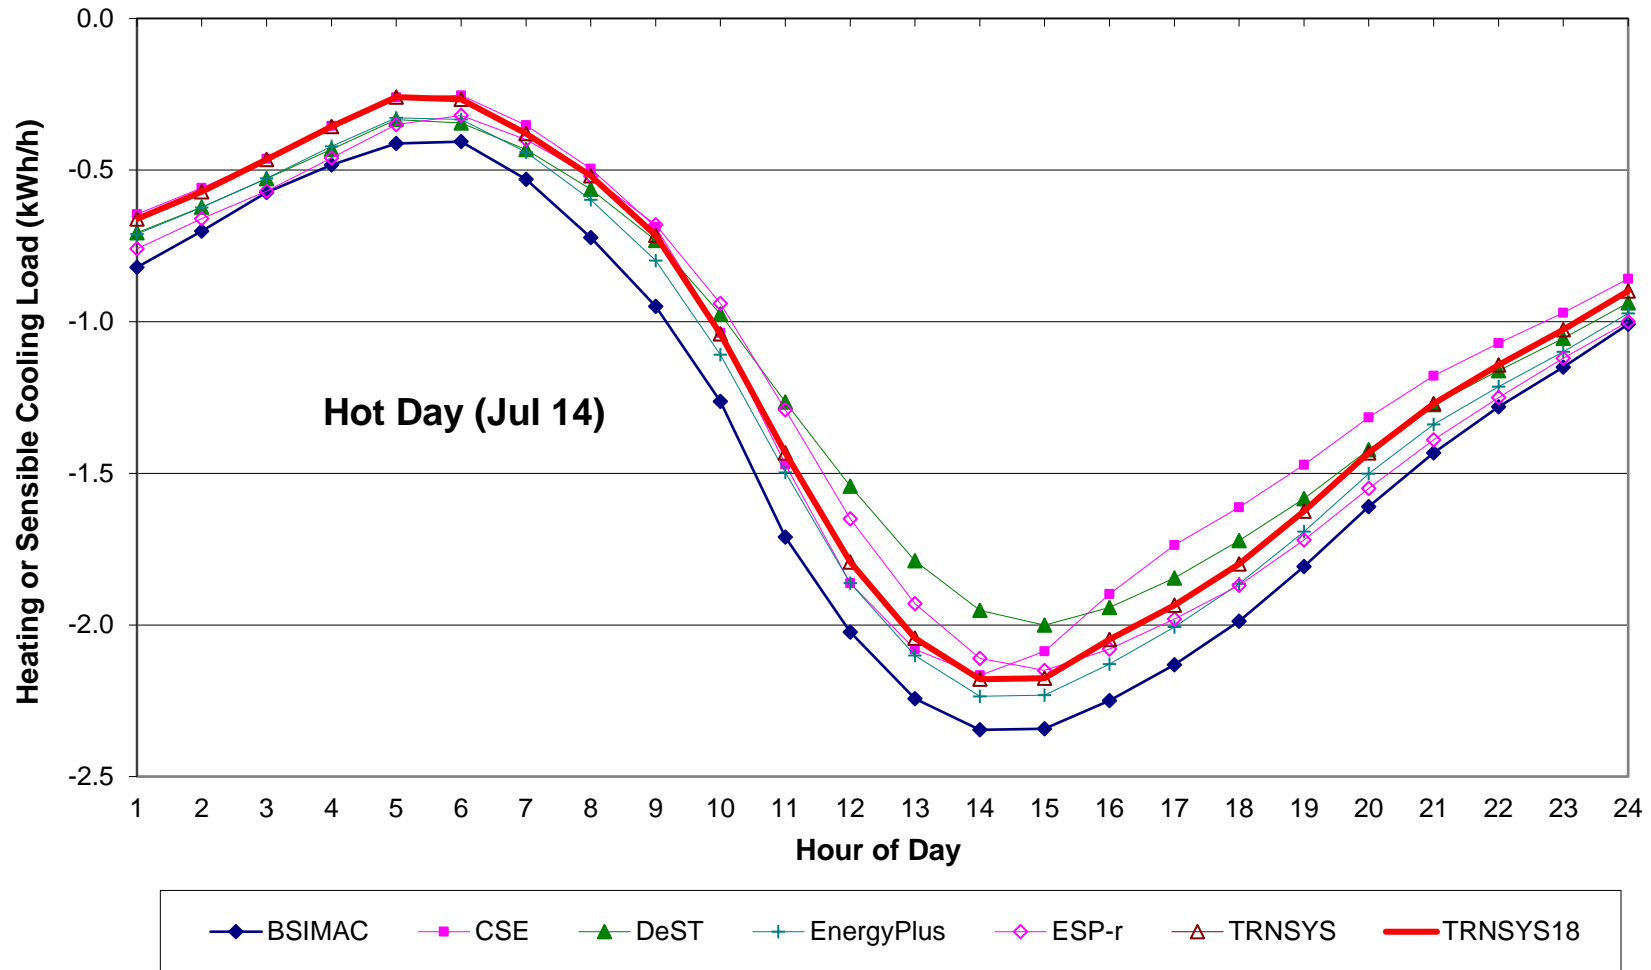


Figure B8-H37. Hourly Loads
Clear Cold Day, Case 995 (High Mass, 20/20, Insulation)
Heating (+), Sensible Cooling (-)

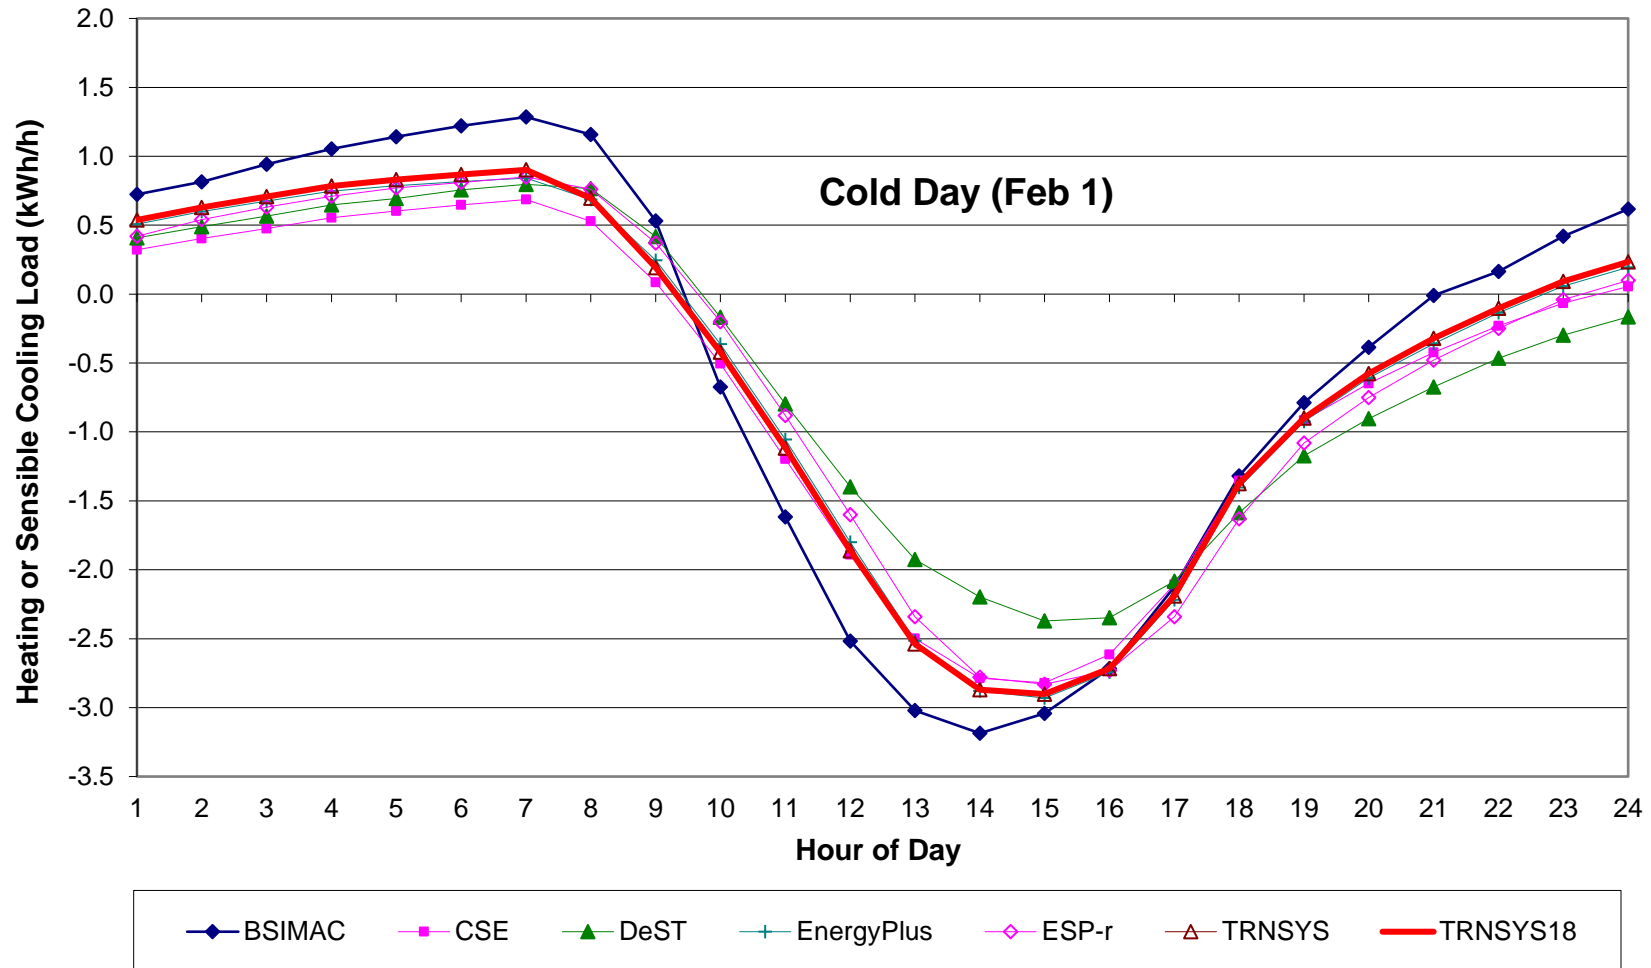


Figure B8-H38. Hourly Loads
Clear Hot Day, Case 995 (High Mass, 20/20, Insulation)
Heating (+), Sensible Cooling (-)

